
SPILL CONTINGENCY PLAN

Clean Up and Camp Service

FOX-C Dew Line Site EKALUGAD FJORD PROJECT



Prepared for: Public Works and Government Services Canada
Environmental Services Western Region
10250 Jasper Avenue, 5th Floor
Edmonton, Alberta, T5J 1S6
Attention: Brad Thompson, P.Eng

Prepared by: Qikiqtaaluk Corporation
P.O. Box 1228
Iqaluit, Nunavut, X0A 0H0



July 2005 (revision 2: July 2006)

EXECUTIVE SUMMARY

The clean up activities at Ekalugad Fjord shall be conducted over a period of three years starting in August 2005. Investigations performed at this abandoned former Intermediate Dew Line station (FOX-C) located in the Canadian Arctic have demonstrated the extent of environmental problems from past occupation.

This document describes requirements for fuel spill emergency planning to be implemented during the clean up and camp service works. It includes:

- a- Duties and Responsibilities
- b- Fuel and Lube Requirements and Storage Capacity
- c- Training and Drills
- d- Material and Equipment
- e- Emergency Procedures
- f- Reporting Requirements

The Ekalugad Fjord Clean Up project mainly consists in the management of immediate health and environmental risk problems such as contaminated soils, PCB amended paint, asbestos, and barrel contents (POL products). It also involves the decommissioning of abandoned facilities including landfill closure. For the camp service project, a remote construction camp will be operated and managed to accommodate the working crew. Approximately 40 persons will occupy the camp over a 75 day period from July 1 to September 15.

This project is administered by Public Works and Government Services Canada (PWGSC), acting on behalf of the owner, Indian and Northern Affairs Canada (INAC). Following competitive tenders, the clean up and camp services projects were granted to Qikiqtaaluk Corporation, a company owned by the Qikiqtani Inuit Association (QIA), the Inuit birthright organization representing the Baffin region of Nunavut.

The Ekalugad Fjord Clean Up project shall provide employment and training benefits for Inuit. It shall also attenuate local inputs from pollution to the nearby communities, thereby protecting health and future of the Inuit.

TABLE OF CONTENTS

EXECUTIVE SUMMARY	i
TABLE OF CONTENTS	ii
PREAMBLE	iii
1-GENERAL	1
2-FUEL AND LUBE REQUIREMENTS AND STORAGE CAPACITY	5
3-DUTIES AND RESPONSIBILITIES	6
4-TRAINING AND DRILLS	9
5-MATERIAL AND EQUIPMENT	10
5.1 SPILL PREVENTION	10
5.2 SPILL CONTAINMENT	10
6-SPILL RESPONSE PROCEDURES	13
7-POTENTIAL SPILL ANALYSIS	14
7.1 SCENARIO #1: DRUM STORAGE AREA	14
7.2 SCENARIO #2: MANAGEMENT OF WASTE IN SCATTERED DRUMS	15
7.3 SCENARIO #3: FUEL DELIVERY	17
8-REPORTING REQUIREMENTS	18
APPENDICES	
.1 MSDS of petroleum products and chemicals stored on site	
.2 Spill Contingency report	

List of Figures

Figure-1:	Ekalugad Fjord Project Site Layout	3
Figure-2:	Emergency Response Team	8
Figure-3:	Drum Storage and Spill kits Locations	12

List of Tables

Table-1:	Quantities of Petroleum Product stored on site	5
Table-2:	Roles of Key Personnel under the Site Superintendent for Spill Response	7

PREAMBLE

The Spill Contingency Plan shall be effective from August 2005 until October 2008, date to which the Ekalugad Fjord Clean Up and Camp Service Projects (61° 35' N and 60° 40' W) shall be completed.

The following formal distribution has been made of this Plan.

Harry Flaherty, Qikiqtaaluk Corporation, Iqaluit
Brad Thompson, PWGSC, Alberta
Robert Martin, INAC, Contaminated Sites Program, Iqaluit
Nunavut Water Board, Gjoa Haven

Additional copies and updates of this Plan may be obtained by writing to:

Philippe Simon, Ph.D., P.Eng.
Qikiqtaaluk Environmental Inc.
3333 Queen Mary road, suite 580
Montreal, PQ, H3V 1A2
psimon@qenv.ca

1-GENERAL

The spill emergency plan was developed to assist the Contractor in implementing measures to protect the environment and minimize impacts from spill events. It provides precise instructions to which all personnel shall be familiarized with during emergency situations. The Plan outlines procedures for responding to spills in a way to minimize potential health and safety hazards, environmental damage, and clean up costs.

The map presented on the following page shows the existing layout of the site. Ekalugad Fjord is located on the east coast of Baffin Island, Nunavut (68° 42' N, 68° 33' W), approximately 195 km south of Clyde River. The site (FOX-C) is about 1.5 km inland from the coast, on the south shore of Ekalugad Fjord. The operations station (upper site) is situated 770 m above sea level, overlooking the Fjord which discharges into Home Bay. The upper site contains areas of environmental concern such as patches of PCB and metal contaminated soil, four dumps, building materials contaminated with PCB amended paint and Asbestos (Module train), a POL drum storage area, and some 3,400 drums scattered on and around the site (some of which still contain POL products). Three buildings, two POL tanks and a collapsed antenna, which will have to be demolished, are also present on site.

The beaching area (lower site) is located in Qarmaralik Cove, about 3 km northwest of the upper site. From the beach, a gravel road leads to the fresh water lake area (lower site), located some 2.5 km away. The main environmental concern associated with the lower site are the 6,600 or so drums located in several caches and scattered along the road, the lake shore as well as in the river valley between the lake and the ocean. Some of these drums still contain POL products. The lower site also has potentially large volumes of hydrocarbon contaminated soils. Furthermore, there are 2 POL tanks and a refuelling pipeline to be demolished.

The upper site is located some 6.5 km from the beaching area by gravel road. The road which links the beach to the lake and to the upper site has been badly damaged by erosion throughout the years. In many places the road is impassable and will need repair.

The spill emergency plan insures that the Contractor will respect all applicable laws, regulations and requirements of federal and/or territorial authorities. The owner is acquiring all required permits, approvals and authorizations required for the project. The Contractor will comply with those permits and approvals obtained by the owner (INAC) to conduct this work. The Contractor will work in close collaboration with PWGSC and DIAND, and with all regulatory authorities to ensure full compliance

according to applicable federal or territorial laws, regulations and/or guidelines. The following documents shall be used as guidelines for spill containment:

- The Canadian Environmental Protection Act controls hazardous substances from their production and/or import, their consumption, storage and/or disposal. Furthermore, this act also includes procedures to handle specified levels of PCB contaminated materials, and requirements for PCB storage facilities.
- The Fisheries Act protects fish and their habitat from pollution, disturbance, or fish movement disturbances. Fisheries and Oceans Canada is responsible to review permit applications or restoration plans submitted by other agencies.
- The Transportation of Dangerous Goods Act and Regulations describe safety measures in the transportation of dangerous goods. The act applies to all handling of dangerous goods by any means of transport whether or not the goods originate from or are destined for any place(s) in Canada.
- The Territorial Land Use Regulations define regulatory measures to maintain appropriate environmental practices for any land use activities on territorial lands. These regulations require that land use permits be issued for such operations as the clean up work to be conducted at Ekalugad Fjord (use of heavy machinery, camp operation, use of explosives, construction of access roads, etc.).
- The Guidelines for Preparation of Hazardous Material Spill Contingency Plans describe parameters that should be considered in the development of hazardous material spill emergency plans. It also defines the information that should be incorporated into a comprehensive contingency plan.
- The Code of Practice for Used Oil Management defines appropriate environmental options for handling, storage, collection, recycling, transportation, reuse and/or disposal of used oils in Canada. It gives standard procedures to handle used oil generators. It also helps regulatory authorities to formulate provincial and/or regional strategies for used oil management.

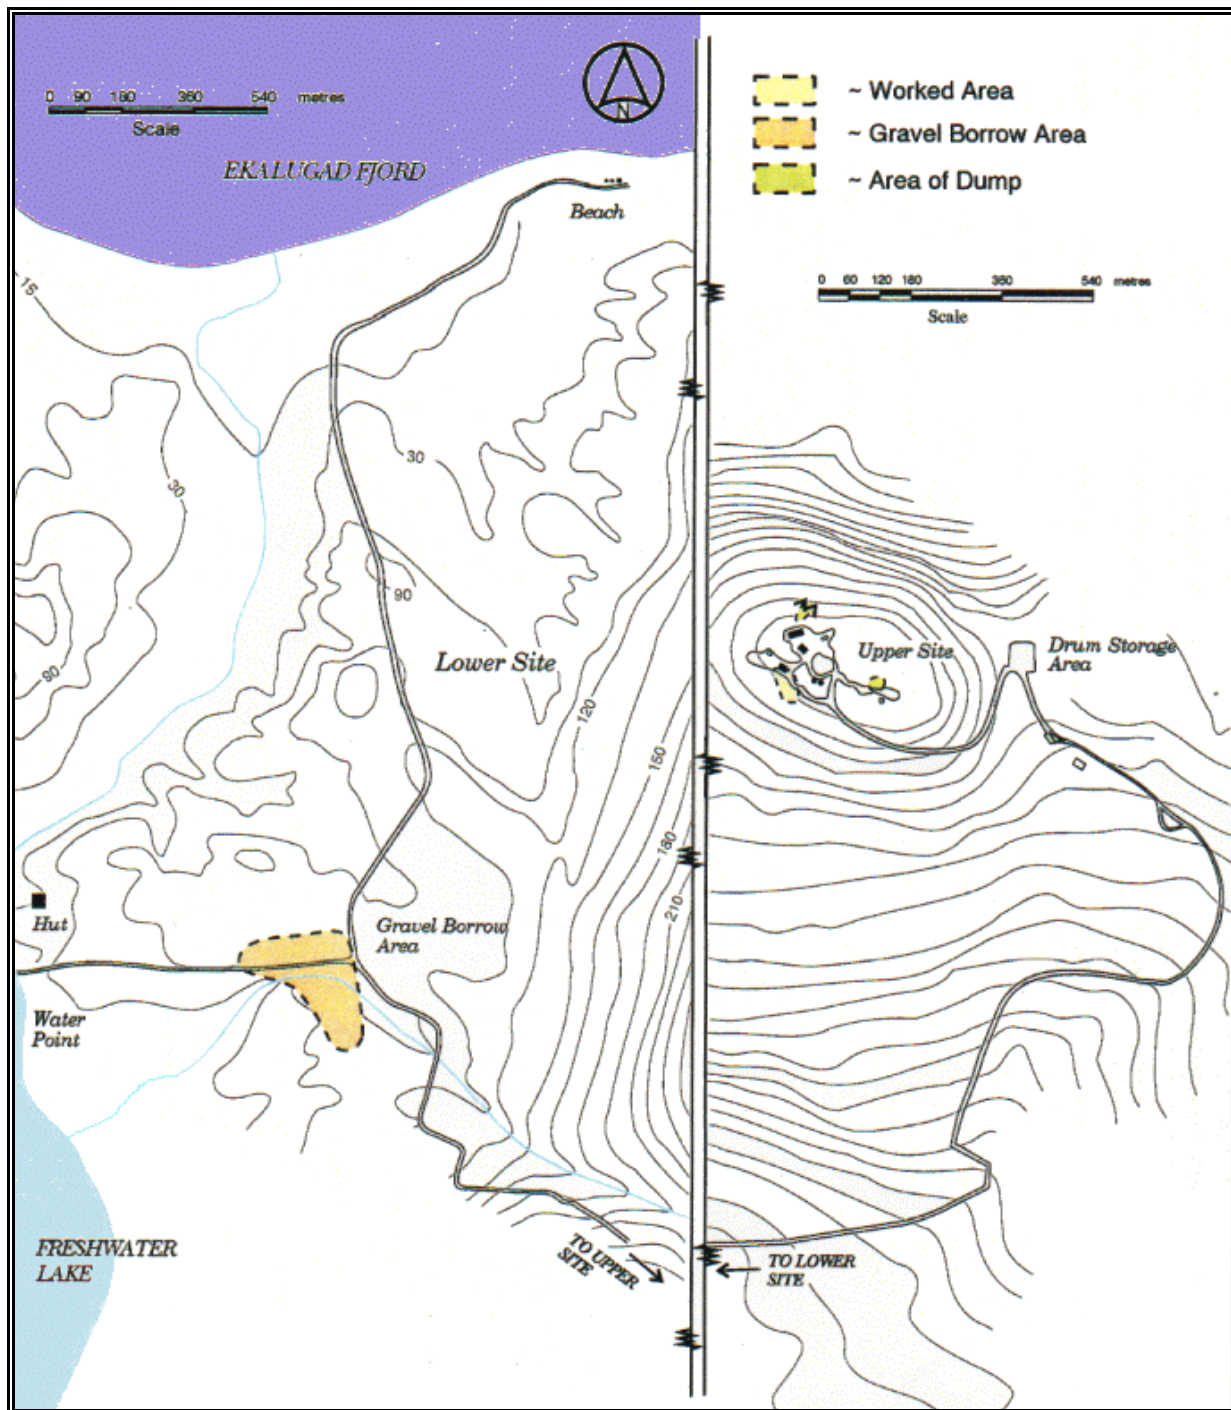


Figure-1: Ekalugad Fjord Project Site Layout

(courtesy of ESG)

- The NWT Environmental Protection Act governs the protection of the environment from contaminants. The act defines offenses and penalties as well as the powers of environmental inspectors.
- The Code of Practice for Used Oil Management defines appropriate environmental options for handling, storage, collection, recycling, transportation, reuse and/or disposal of used oils in Canada. It gives standard procedures to handle used oil generators. It also helps regulatory authorities to formulate provincial and/or regional strategies for used oil management.
- The NWT Environmental Protection Act governs the protection of the environment from contaminants. The act defines offenses and penalties as well as the powers of environmental inspectors.
- The NWT Spill Contingency Planning and Reporting Regulations describe requirements for spill reporting and emergency planning.
- The Field Guide for Oil Spill Response in Arctic Waters developed by the Emergency Prevention Preparedness and Response, a program of the Arctic Council, describes response methods and strategies for operations and provides technical support documentation.

2-FUEL AND LUBE REQUIREMENTS AND STORAGE CAPACITY

A variety of fuels, oils and other hazardous materials will be used during clean up activities at the Ekalugad Fjord site. The greatest volumes involved consist in diesel fuel. Other substances such as aviation fuel, lubricant oils, hydraulic fluid, antifreeze, fuel additives, gasoline, engine coolants, cleaning solvent (DIPSOL and SUPREX) are used but their volumes are small compared with diesel fuels. All these products are to be considered as potential environmental and safety hazards.

The following table summarizes the estimated quantities mobilized on site.

Table-1: Quantities of Petroleum Products stored on site

Liquids to be used	Estimated Volumes (Litres)
diesel fuel	356,640
Aviation Fuel (Jet A1)	41,000
Gasoline	10,250
Engine oil	4000
Transmission oil	1000
Differential oil	600
Hydraulic oil	1000
Coolant	600
DIPSOL	205
SUPREX	205

The MSDS of all these products are found in appendix 1. All petroleum products were delivered to the site (by marine shipment) in 205-Litre drums strapped on pallets. Once used, all these UN approved drums will be either sent back down south by marine shipping during site demobilization to the supplier to recover the deposit, or crushed and landfilled on site, if damaged. A variety of intermediate fuel tanks will also be used to:

- Supply the camp generator: 2 above ground fuel tanks having a capacity of 1360 litres each (i.e. 300 gal) located within the seacans in which gensets are installed. These fuel tanks will be filled from drums using a 12-Volt fuel pump (20gpm).

- Supply the different heavy equipments on the field: One 683 litre tank (150 gal) and two 1140 litres (250 gal) installed in the back of Ford F250 pick up trucks. These fuel tanks will be filled from drums using a 12-Volt fuel pump (20gpm). A 12-Volt fuel pump will also be used to transfer the fuel from these tanks for equipment reservoirs.

For all petroleum products stored in drums, the following storage facility is to be used:

The drum storage will be installed about mid way between the beach area and the water lake area, near borrow are #4, at distance away from highwater mark and traffic to comply with all conditions of permits (see figure 3 for location). Small berms will be constructed around the storage area (to contain spills from accidents), spill kits (see below) will be installed in the vicinity and restricted area/no smoking area placards will be posted. The area will be graded to have a smooth gravel pad prior to haul pallets from the beach (sealift unloading) to the storage area.

Hand operated pumps are to be used for fuel transfer operations with drums of gasoline, oils and lubricants.

3-DUTIES AND RESPONSIBILITIES

As part of the spill emergency response, the Contractor is responsible of implementing, through its site superintendent or its authorized representative, the following procedures:

- a- To communicate immediately the spill event to the PWGSC official (immediately shall mean upon discovery).
- b- To authorize the use of personnel and applicable equipment to contain the spill using the most reliable method.
- c- To eliminate all fire hazards and potential ignition sources near the spill area.
- d- To implement all required safety and security procedures at the site of the spill.
- e- To eliminate the source of the spill or reduce the rate of discharge, if such procedures can be implemented with respect to health and safety requirements.
- f- To contain the spill using the most appropriate methods for the situation (dykes, ditches, sorbent materials, containment booms and other barriers).
- g- To evaluate the possibilities of recovering spilled chemicals.
- h- To mobilize all available personnel, equipment and tools, as required.
- i- To obtain assistance from PWGSC (through its official), from DIAND (the owner) and/or from Environment Canada, if required. To consult and, if required, request assistance from the Canadian Coast Guard and/or and Fisheries and Oceans

- Canada if the spill affects water.
- j- To obtain additional assistance by hiring northern residents from local communities and/or specialized spill response firms, if required.
 - k- To comply with all applicable guidelines and regulations.
 - l- To assess on a preliminary basis, environmental impacts on marine, freshwater and terrestrial wildlife and on the general ecosystem and then to communicate with relevant authorities.
 - m- To provide documentation for all events and actions.
 - n- To report the event to the GN Spill Report Line and to prepare and submit a written spill report using the appropriate form (see below for the list of information required for such submittals).

As part of the spill emergency response, the Site Superintendent is responsible for the implementation of the following procedures:

- a- To ensure that appropriate resources required to respond and clean up the spill are made available.
- b- To supervise containment, clean up and restoration operations.
- c- To provide documentation for all events and actions.
- d- To notify relevant government authorities.

The site superintendent (i.e. Jean-Louis Bertrand - tel.: 604-759-0910 ext. 103), acting as the incident commander, will have authority over the following department/unit, each having a specific role for the spill response operations:

Table-2: Roles of Key personnel under the site superintendent for spill response

Department/Unit	Responsibility
Fire Chief	Ensure existing conditions do not present a fire/explosion hazard
Health & Safety Officer	Ensure spill response workers are not exposed to health and safety risks
Contractor's Site Engineer	Coordinate spill response methods and procedures
Medical / Rescue Unit	Provide assistance to victims (if required)
Spill Response Team Leader	Implement the containment and clean up activities
Containment Unit	Perform spill response

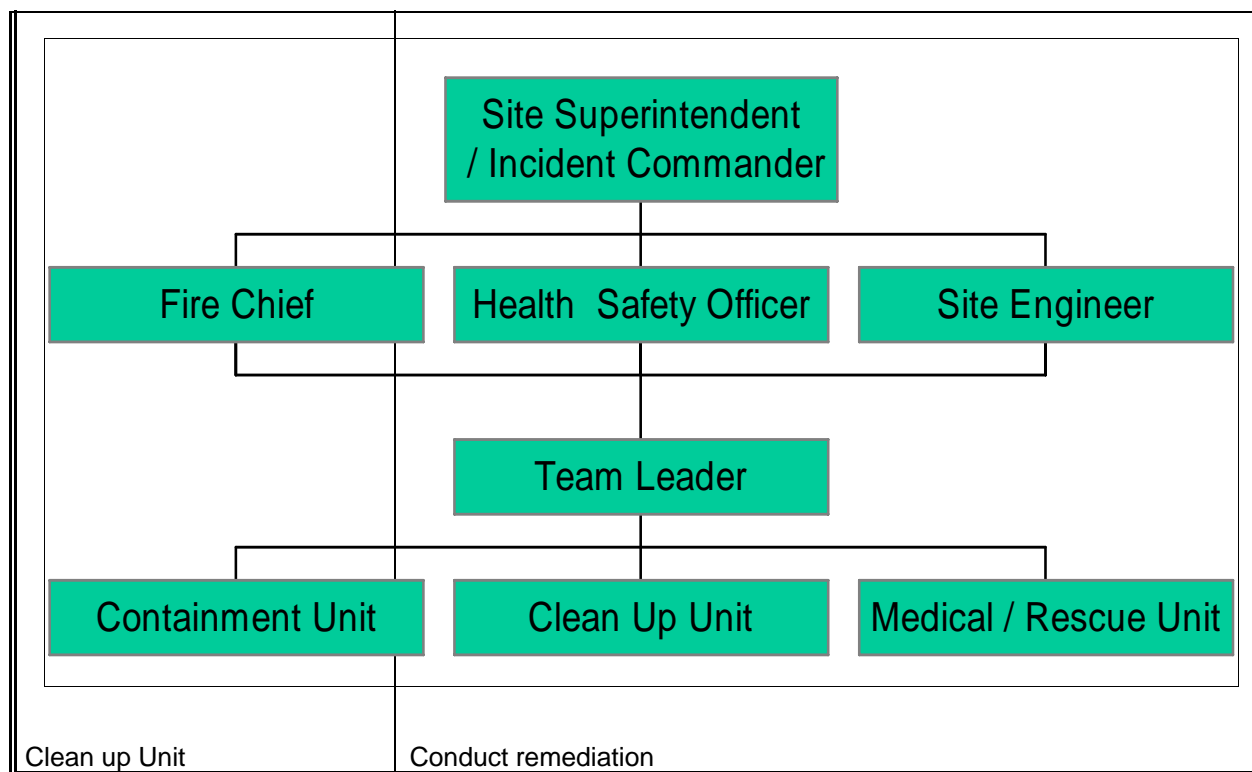


Figure-2: Emergency Response Team

Once a spill event is reported, the site superintendent, fire chief, health & safety officer and site engineer shall meet to establish a specific strategy for containing and controlling the spill and to initiate the clean up activities. They shall delegate a person - the Spill Response Team Leader - to oversee the implementation of the strategy. Members of the Ekalugad Fjord Fire / Rescue Team, under the direction of the Spill Response Team Leader shall then coordinate the activities of the Containment and Clean up Units. Figure-2 shows a graphic representation of the emergency team and chain of command.

Otherwise, the Contractor will ensure that any selected shipment company have prepared the contingency plans (emergency response plans {ERP}) required to face spill events, and that they can comply with all applicable regulations. The shipment company will be responsible to register their ERP, if required, with the Director General of the Transport of Dangerous Goods Directorate if materials identified for transport are exceeding volumes listed on schedule XII of the TDG regulations. The ERP shall contain information on the nature of risks from dangerous goods and contact names and numbers for emergency assistance.

If during transport, a spill of hazardous materials exceeds the volumes listed in Part 9, Table I of the TDG regulations, the shipment company authorities will have to immediately notify the relevant authorities using the contact lists defined in Table II of the same regulations. The shipment authority will also have to inform his/her employer, the owner of the transport vehicle, and the dangerous goods owner. The shipment authority's employer will then be required to submit a written report to the TDG Director General within 30 days following the spill event.

The Contractor will ensure that the selected shipment company reports the spill events, if those occur, using the appropriate spill response line. Quantities of substances which represent "a spill" are listed in schedule B of the NWT Spill Contingency and Reporting Regulation.

If a spill occurs on water during shipment of material, the shipment company will be responsible to deploy containment booms and recover as much fuel as possible with required and available equipment.

4-TRAINING AND DRILLS

All personnel on site shall be informed that any spill of fuel and/or hazardous liquids or solids, whatever the extent, has to be reported immediately to the site superintendent or his authorized representative.

The site superintendent and the health and safety officer shall select a group of 4 to 6 on-site workers to be assigned to spill containment in case of emergency. These persons shall be aware of available spill containment equipment, protective clothing and containers and shall be responsible to implement procedures and coordinate other workers if required. These persons shall also be aware that defensive actions and techniques employed will depend on a variety of factors. These include, but are not limited to:

- a- type of pollutant;
- b- degree of loss;
- c- topography of the nearby area; and
- d- proximity to water.

Also, they should know that the most common pollution incident potentially occurring at the Ekalugad Fjord site will probably be caused by fuel, oil or other hazardous fluid spills onto land or water resulting from:

- a- human error during transfer operations of fuel from storage drums to day tanks;
- b- rupture of lines, tanks or valves from accidental damage, deterioration or equipment

- failure; and
- c- leaks from fittings or valves.

Finally, the spill containment team shall be aware that, if a spill occurs, the protection of human health and safety shall be a priority. Even if emergency procedures are attempted to rapidly clean, contain and dispose released contaminants to minimize further environmental impact, human exposure during spill event is to be considered as a real concern and be prevented.

The Contractor site superintendent shall organize a drill with each rotating spill containment team near the beginning of each season. These drills shall mainly be used to determine the time required to mobilize equipment at the drum storage area.

5-MATERIAL AND EQUIPMENT

In order to prevent spills and provide an appropriate response in case of spill events, the Contractor maintains on-site appropriate equipment and material required. These equipment and materials are present on site. A list of spill prevention and spill containment equipment including protective clothing is presented below. Figure-3 presents the locations of hazardous material and spill kits on site. Spill kits have a capacity of 630 litres (see www.quatrex.ca - item Spill kit Q Ultra 75)

5.1 Spill Prevention

The materials and equipment used for spill prevention are essentially related to waste oil incineration, temporary fuel tank inspection, and temporary containment basin construction:

<u>Qty</u>	<u>Description</u>
1	roll of HDPE geomembrane
2	Westland waste oil burner

5.2 Spill Containment

The material and equipment to be used for spill containment and emergency response including protective clothing are:

<u>Qty</u>	<u>Description</u>
5	Containerized spill kits having 10 sorbent booms, 2 safety glasses. 2 Nitrile gloves, 100 sorbent sheets
10	Rolls of (38" x 144") sorbent sheets

5	100 metre long/8 inch diameter oil sorbent booms
1	Vacuum suction hose/tank installed on a trailer
2	1 ½" and 2" x 25 ft oil hose c/w kamlock fittings
10	Emergency eye wash station c/w saline solution
10	First aid kit
2	Case of disposable coveralls (50 per case)
2	Cat bulldozer (D6)
2	Cat excavators (320L and 322BL)
2	Cat integrated tool carriers (950 and IT38) c/w snow/gravel bucket, 4 ft forks, material handling arm
1	Cat dump trucks (D250)
3	Dump trucks (Mack and GMC)
1	Bobcat 763 skid loader
25	Fire extinguishers
4	Fire extinguishers, class ABC, 20 lbs dry chemical
1	high pressure air compressor c/w moisture separator, low pressure regulator, adaptor to recharge fire extinguishers and Scott paks
4	Scott air pak (Draeger)
8	spade nose shovels
1	Electric fuel pump - stationary 115 V, approx. 15 USGAL/min , explosion proof switch, water sediment filter
200	Leather work gloves
100	Rubber gloves
20	Nitrile gloves
15	Cartridge half mask respirator
1	Cartridge full face respirator
40	Organic vapour cartridges
120	Pre-filters and filter clips
500	Disposable dust masks
40	Rubber boots steel toe and shank
40	Safety goggles
100	Saranek & Tyvek suits

EKALUGAD FJORD

MAIN DRUM STORAGE AREA

CAMP DRUM STORAGE AREA
APPROXIMATELY 150 DRUMS STORED
(FUEL FOR CAMP GENERATORS)

SPILL KIT
LOCATION

SPILL KIT
LOCATION

SPILL KIT
LOCATION

SPILL KIT
LOCATION

BARREL DUMP #3
DEBRIS AREAS

VEHICLE AND
EQUIPMENT
DEBRIS AREAS

BARREL DUMP #2
DEBRIS AREAS

BARREL DUMP #1
DEBRIS AREAS

BORROW AREA 4

BEACH ROAD
CROSSING 1

WATERCOURSE

ACCESS ROAD

FUEL LINE

FUEL TANK
(TYP. FOR 2)

6-SPILL RESPONSE PROCEDURES

Following a spill event, specific procedures shall be implemented by the person who first noticed the emergency situation. These procedures are as follows:

- a- Immediately warn other personnel working near the spill area.
- b- Evacuate the area if health and safety are judged to be threatened.
- c- If not, take appropriate measures to stop, contain and identify the nature of the spill.
- d- Report to the PWGSC site representative and the Contractor's site superintendent all relevant information concerning the spill event such as the type and volume of contaminant, the location and approximate size of the spill, the actions already taken to stop and contain the spill and all other observations including the presence of wildlife and meteorological conditions. Notify INAC Water Resources Inspector at (867) 975-4298.

The spill clean up approaches shall be discussed with PWGSC and INAC. INAC will communicate with Environment Canada. The selected methods shall be based on criteria where the impacts on human health and safety, wildlife, land, water and other environmental parameters are minimized.

To manage a spill incident, some emergency clean up guidelines shall be followed by the Contractor when applicable. These incorporate some of the material previously described and include:

- e- Sorbent materials will be used to contain the spill and/or to minimize its movement.
- f- Appropriate protective clothing and other safety devices will be used to handle spilled materials.
- g- When the spill occurs on land, dykes may be constructed to limit the spill movement providing granular material is sufficiently available. Snow dikes covered with an impermeable liner may also be used if snow still remains. Otherwise, containment booms will be installed in front of the plume and secured to make sure these sorbent barriers do not get saturated.
- h- Any free product settled in ditches, trenches or any other ground cavities will be removed using equipment such as pumps, buckets or skimmers. Recovered fluids will be temporarily stored in appropriate containers.
- i- Any spill areas will be cleaned up to an extent where land, water and other disturbed environmental systems are restored and the site is left as close as possible to its original state.

7-POTENTIAL SPILL ANALYSIS

As part of the analysis of potential spills, their fates and effects, three potential sources of spills have been identified for the Ekalugad Fjord clean up and camp service projects. The first is the drum storage area located at the middle site. The second is related to the management of scattered waste drums (to be cleaned up) located everywhere on-site. The third consists in the fuel delivery using fuel tanks on pick-up trucks. Each of these three sources are analysed in detail in the following pages.

7.1- Scenario #1: Drum Storage Area

The drum storage area will consist of a levelled pad where pallets will be staged/stockpiled. All pallets of drums will be somewhat independent and, therefore the spillage of one drum should not affect the others.

Two potential situations could occur that would cause a spill:

- 1) the accidental spillage of fuel during transfer into temporary tanks;
- 2) the rupture of drums, possibly from a violent impact caused by the collision of a vehicle or piece of heavy equipment.

In the first case, the spilled volume would be, at worst, 45 gallons, which represents the entire volume of one drum. In the other case, we can assume that the impact would occur at mid-height on two stacked pallets and, at worst, sixteen drums would be affected. Therefore the spilled volume should not exceed a total volume of 720 gallons.

In either case the spillage flowrate would be moderate to high and we can assume that the entire volume would be spilled within 15 to 20 minutes.

The general direction of migration would be along the natural drainage pathway. The high water mark is to be located minimum 100 metres down-gradient from the drum storage area. It is unlikely that the spilled fuel would reach the lake because the porous sandy soil along the way would soak up part of fuel, and also because the low slope will not allow for rapid flow of fuel, thereby providing enough time for the spill response procedures to take effect.

The spill would be communicated by the witness of the scene to the site superintendent, or in his absence, the assistant site superintendent. The latter would then go down the chain of command and advise the appropriate persons of the immediate actions to be taken. Radio communication is to be used at all times on the site and key team members will carry a radio with them at all times.

The personnel responsibilities are outlined in previous sections of this document. The witness of the spill would be advised to try to stop the source of the spill, while waiting for backup help to arrive; his actions would be immediate. The Contractor site engineer would coordinate the spill response activities carried out by the containment unit. Members of this unit would be mobilized to the spill site. The drum storage area can be reached from any other area of the site within a maximum of 25 minutes.

Mobilization of containment equipment to the spill site can be carried out rapidly. A bulldozer and bucket loader will be present in close proximity and can reach the site of the spill within a matter of minutes. A sand and gravel pit is also located in the vicinity, if required for berm construction. Spill response kits containing sorbent material will be kept next to the drum storage location. Containment would be carried out by the construction of soil berms and the installation of sorbent booms. After containment, clean up equipment can be mobilized to the site. A list of equipment is presented in previous sections of this document.

Safety hazards associated with the spill event includes the risk of fire. This can be minimized by preventing personnel from smoking near the spill scene. Risks to personnel (from inhalation and dermal contact) can be prevented by the proper use of personnel protective equipment.

Measures and procedures to prevent such events from occurring include regular inspection of the drum storage area and containment system, and safety rules concerning the use of vehicles and heavy equipment on site, especially in close proximity of this area (e.g., speed limits, training of heavy equipment operators, restricted area posting, safety orientation of workers, etc.).

7.2- Scenario #2: Management of Waste in Scattered Drums

Various abandoned fuel caches, waste drums and dumps potentially containing contaminated petroleum products and/or solvent are to be managed/remediated. During operations, the likelihood of spillage exists.

Two potential situations could occur that would cause a spill:

- 1) the sudden breakage of tank piping or fittings containing POL product during clean up;
- 2) the rupture of a drum/tank found in dumps, possibly from a violent impact caused by the collision of a vehicle or piece of heavy equipment.

Any incident causing the spillage of one drum or a remaining unknown small tanks, would bring the fuel to flow onto the surrounding area.

The rupture of unknown tanks during clean up operations might cause the loss of most significant volume, but based on previous investigations, this is unlikely. In this case, the spilled fluid would probably flow towards the natural cavity formed by the waste landfill which would serve as natural containment

In either case, it is most unlikely that any sensitive receptor would be impacted from the spills because of the fuel infiltrating into the soil and bedrock, as well as the rapidity of response measures.

The spill would be communicated by the witness of the scene to the site superintendent, or in his absence, the assistant site superintendent. The latter would then go down the chain of command and advise the appropriate persons of the immediate actions to be taken. Radio communication will be used at all times on the site and key team members will carry a radio with them at all times.

The personnel responsibilities are outlined in previous sections of this document. The witness of the spill would be advised to try to stop the source of the spill, while waiting for backup help to arrive; his actions would be immediate. The Contractor site engineer would coordinate the spill response activities carried out by the containment unit. Members of this unit would be mobilized to the impacted site. All impacted site can be reached from any other area of the site within a maximum of 25 minutes. Response to a spill at any clean up site would probably be more rapid when compared with potential impacts knowing that mitigating measures are to be implemented.

Mobilization of containment equipment to the spill site can be carried out rapidly. Bucket loaders and other heavy equipment shall be present in close proximity and can reach the site of the spill within a matter of minutes. Sand and gravel pits/stockpiles are also located in the vicinity, if required for berm construction. Spill response kits, sorbent material, pumps, hose and many other equipment are located in the storage warehouse nearby. Containment would be carried out by the

construction of soil berms and the installation of sorbent booms. After containment, clean up equipment can be mobilized to the site. A list of equipment is presented in previous sections of this document.

Safety hazards associated with the spill event includes the risk of fire. This can be minimized by preventing personnel from smoking near the spill scene. Risks to personnel (from inhalation and dermal contact) can be prevented by the proper use of personnel protective equipment.

Measures and procedures to prevent such events from occurring include training of staff (Hazwoper) and safety rules concerning the use of vehicles and heavy equipment on site, especially while in operations with waste/scattered drum handling, and landfill excavation (e.g., speed limits, training of heavy equipment operators, etc.).

7.3- Scenario #3: Fuel Delivery

The fuel delivery operations (small tanks - 250-350 gal - installed on pick-up trucks) to supply fuel to heavy equipment and to carry fuel from the drum storage area to the upper site operations are carrying some risks of spillage.

Any accident involving the fuel delivery pick-up trucks could result in the loss of its entire volume of fuel. Such an accident could occur almost anywhere on site, any place the pick-up trucks have access to.

Heavy equipment works at least 30 metres away from any body of water. Therefore the fuel delivery should not ever get closer than 30 metres from bodies of water. Any fuel spill at that distance would not rapidly reach the receptor.

Any spills would be communicated by the witness of the scene to the site superintendent, or in his absence, the assistant site superintendent. The latter would then go down the chain of command and advise the appropriate persons of the immediate actions to be taken. Radio communication will be used at all times on the site and key team members will carry a radio with them at all times.

The personnel responsibilities are outlined in previous sections of this document. The witness of the spill would be advised to try to stop the source of the spill, while waiting for backup help to arrive; his actions would be immediate. The Contractor site engineer would coordinate the spill response activities carried out by the containment unit. Members of this unit would be mobilized

to the spill area. All areas at Ekalugad Fjord can be reached from any other area of the site within a maximum of 15-25 minutes (once roads will all be repaired/maintained).

Mobilization of containment equipment to the spill site can be carried out rapidly. Sorbent booms may be required to contain the oil slick and prevent further spreading or migration to any discharge stream; those are present at the middle site and the lower site. If the construction of an oil-water separator in the discharge stream is necessary, the following equipment and materials would be required: heavy equipment (loader or excavator), sand and gravel, piping, and tarp/geomembrane. All these equipment and materials could be mobilized within 20 to 30 minutes. If the fuel reaches the discharge stream, spill response measures may have to be implemented further down stream. After containment, clean up equipment will be mobilized to the area. A list of equipment is presented in previous sections of this document. However, due to the size of temporary fuel tanks used for delivery/supply, potential impact from spill are likely to be rapidly contained.

Safety hazards associated with the spill event includes the risk of fire. This can be minimized by preventing personnel from smoking near the spill scene. Risks to personnel (from inhalation and dermal contact) can be prevented by the proper use of personnel protective equipment.

Measures and procedures to prevent such events from occurring include regular safety rules concerning the use of vehicles site, especially in close proximity to sensitive areas (e.g., speed limits, training of truck drivers, etc.).

8-REPORTING REQUIREMENTS

Spills will be immediately reported using the **24 Hour Spill Report Line (867) 920-8130 (NWT)**. Immediately shall mean upon discovery. Failure to report can lead to fines. A written spill report will then be prepared by the Contractor with the assistance of the Engineer and submitted to the PWGSC site representative and the Spill Report Line supervisor (see Appendix 2). This report will include:

- a- date and time of the incident;
- b- location or map coordinates and direction of spill movement if not at steady-state;
- c- party responsible for the spill;
- d- type and estimated quantities of spilled contaminant(s);
- e- specific cause of the incident;
- f- status of the spill indicating if spilled materials are still moving or now at steady-state;

- g- approximate surface of contaminated area;
- i- factors affecting spill or recovery such as temperature, wind, etc.;
- j- status on containment actions indicating whether a) naturally, b) booms, dykes or other, c) no containment has been implemented;
- k- corrective action taken or proposed to clean, contain or dispose spilled material;
- l- whether assistance is required and in what form;
- m- whether the spill poses a hazard to persons or property (*i.e.*, fire, drinking water);
- n- comments and recommendations;
- o- name, position and employer of the person reporting the spill; and
- p- name, position department of the person to whom the spill is reported.

Apart from reporting requirements, the Contractor, through its site superintendent, may require special assistance. These could be implemented for the following reasons:

- .1 If assistance and coordination are required for spill response, Environment Canada (Nunavut Office), INAC and the Environmental Protection Service of the Government of Nunavut can be contacted at:

Environment Canada	(867) 979-6808
Environment Canada (24-hour emergencies)	(867) 920-5131
INAC Water Resources Inspector	(867) 975-4298
GN Environmental Protection Service	(867) 975-5910 or 975-5907

- .2 If medical assistance and coordination are required when injuries occurred during spill incident/spill response and/or critical incident stress is observed after an event, the Baffin Regional Hospital (general enquiries) shall be contacted at:

Baffin Regional Hospital	(867) 979-7300
---------------------------------	-----------------------

Other emergency assistance numbers are found in the Ekalugad Project Clean Up and Camp Service Health and Safety Plan.

- .3 Qikiqtaaluk Corporation site superintendent and/or project managers can be reached at:
- | | |
|---|----------------------|
| Jean-Louis Bertrand (site superintendent) | 604-759-0910 ext 103 |
| Harry Flaherty (project manager) | 867-979-8400 |
| Philippe Simon (project manager) | 514-940-3332 |
| | 514-779-3332 (24-hr) |

APPENDIX -1-

MSDS of petroleum products and chemicals stored on site

**Shell Canada Limited**
Material Safety Data SheetEffective Date: 2005-11-07
Supersedes: 2002-11-06Class B3 Combustible Liquid
Class D2B Other Toxic Effects - Skin Irritant**1. PRODUCT AND COMPANY IDENTIFICATION**

PRODUCT: LOW SULPHUR DIESEL CP-43
SYNONYMS: Diesel
Automotive Gas Oil
PRODUCT USE: Fuel Solvent
MSDS Number: 320-043

MANUFACTURER
Shell Canada Limited
P.O. Box 100, Station M
400-4th Ave. S.W.
Calgary, AB Canada
T2P 2H5

TELEPHONE NUMBERS
Shell Emergency Number 1-800-661-7378
CANUTEC 24 HOUR EMERGENCY NUMBER 613-996-6666
For general information: 1-800-661-1600
For MSDS information: 403-691-3982
(From 7:30 to 4:30 Mountain Time) 403-691-2220

This MSDS was prepared by the Toxicology and Product Stewardship Section of Shell Canada Limited.

*An asterisk in the product name designates a trade mark(s) of Shell Canada Limited, used under license by Shell Canada Products.

2. COMPOSITION/INFORMATION ON INGREDIENTS

Component Name	CAS Number	% Range	WHMIS Controlled
Fuels, Diesel, No. 2	68476-34-6	100	Yes

See Section 8 for Occupational Exposure Guidelines.

3. HAZARDS IDENTIFICATION

Physical Description: Liquid Clear To Yellow Hydrocarbon Odour

Routes of Exposure: Exposure will most likely occur through skin contact or inhalation.
Hazards:

Vapour concentrations above the recommended exposure level are irritating to the eyes and respiratory tract, may cause headaches and dizziness, are anesthetic and may have other central nervous system effects.

Combustible Liquid.

Irritating to skin.

Vapours are moderately irritating to the eyes.

Ingestion may result in vomiting. Avoid aspiration of vomitus into lungs as small quantities may result in aspiration pneumonitis.

Vapours are moderately irritating to the respiratory passages.

Handling:

Eliminate all ignition sources.

Avoid prolonged exposure to vapours.

Wear suitable gloves and eye protection.

Bond and ground transfer containers and equipment to avoid static accumulation.

Empty containers are hazardous, may contain flammable / explosive dusts, liquid residue or vapours. Keep away from sparks and open flames.

For further information on health effects, see Section 11

4. FIRST AID

- Eyes:** Flush eyes with water for at least 15 minutes while holding eyelids open. If irritation occurs and persists, obtain medical attention.
- Skin:** Wash contaminated skin with mild soap and water for 15 minutes. If irritation occurs and persists, obtain medical attention.
- Ingestion:** DO NOT INDUCE VOMITING! OBTAIN MEDICAL ATTENTION IMMEDIATELY. Guard against aspiration into lungs by having the individual turn on to their left side. If vomiting occurs spontaneously keep head below hips to prevent aspiration of liquid into the lungs. Do not give anything by mouth to an unconscious person.
- Inhalation:** Remove victim from further exposure and restore breathing, if required. Obtain medical attention.
- Notes to Physician:** The main hazard following accidental ingestion is aspiration of the liquid into the lungs producing chemical pneumonitis. If more than 2.0 mL/kg has been ingested, vomiting should be induced with supervision. If symptoms such as loss of gag reflex, convulsions or unconsciousness occur before vomiting, gastric lavage with a cuffed endotracheal tube should be considered.

5. FIRE FIGHTING MEASURES

- Extinguishing Media:** Dry Chemical
Carbon Dioxide
Foam
Water Fog
- Firefighting Instructions:** Caution - Combustible. Do not use a direct stream of water as it may spread fire. Do not enter confined fire space without adequate protective clothing and an approved positive pressure self-contained breathing apparatus. Vapour forms a flammable/explosive mixture with air between upper and lower flammable limits. Vapours may travel along ground and flashback along vapour trail may occur. Avoid inhalation of smoke. Product will float and can be reignited on surface of water. Delayed lung damage can be experienced after exposure to combustion products, sometimes hours after the exposure.

Hazardous Combustion Products: A complex mixture of airborne solid, liquid, particulates and gases will evolve when this material undergoes pyrolysis or combustion. Carbon dioxide, carbon monoxide and unidentified organic compounds may be formed upon combustion.

6. ACCIDENTAL RELEASE MEASURES

Issue warning "Combustible". Eliminate all ignition sources. Isolate hazard area and restrict access. Handling equipment must be grounded. Try to work upwind of spill. Avoid direct contact with material. Wear appropriate breathing apparatus (if applicable) and protective clothing. Stop leak only if safe to do so. Dike and contain land spills; contain water spills by booming. Use water fog to knock down vapours; contain runoff. Absorb residue or small spills with absorbent material and remove to non-leaking containers for disposal. Recommended materials: Clay or Sand Flush area with water to remove trace residue. Dispose of recovered material as noted under Disposal Considerations. Notify appropriate environmental agency(ies).

7. HANDLING AND STORAGE

Handling: Combustible. Avoid excessive heat, sparks, open flames and all other sources of ignition. Fixed equipment as well as transfer containers and equipment should be grounded to prevent accumulation of static charge. Vapours are heavier than air and will settle and collect in low areas and pits, displacing breathing air. Extinguish pilot lights, cigarettes and turn off other sources of ignition prior to use and until all vapours are gone. Vapours may accumulate and travel to distant ignition sources and flashback. Do not cut, drill, grind, weld or perform similar operations on or near containers. Empty containers are hazardous, may contain flammable/explosive dusts, residues or vapours. Do not pressurize drum containers to empty them. Wash with soap and water prior to eating, drinking, smoking, applying cosmetics or using toilet facilities. Launder contaminated clothing prior to reuse. Use good personal hygiene.

Storage: Store in a cool, dry, well ventilated area, away from heat and ignition sources. Keep container tightly closed.

8. EXPOSURE CONTROLS / PERSONAL PROTECTION

THE FOLLOWING INFORMATION, WHILE APPROPRIATE FOR THIS PRODUCT, IS GENERAL IN NATURE. THE SELECTION OF PERSONAL PROTECTIVE EQUIPMENT WILL VARY DEPENDING ON THE CONDITIONS OF USE.

OCCUPATIONAL EXPOSURE LIMITS (Current ACGIH TLV/TWA unless otherwise noted):

Diesel fuel, as total hydrocarbons: 100 mg/m³

Skin Notation: Absorption through skin, eyes and mucous membranes may contribute significantly to the total exposure.

Mechanical Ventilation: Concentrations in air should be maintained below the recommended threshold limit value if unprotected personnel are involved. Use explosion-proof ventilation as required to control vapour concentrations. Make up air should always be supplied to balance air exhausted (either generally or locally). For personnel entry into confined spaces (i.e. bulk storage tanks) a proper confined space entry procedure must be followed including ventilation and testing of tank atmosphere. Local ventilation recommended where mechanical ventilation is ineffective in controlling airborne concentrations below the recommended occupational exposure limit.

PERSONAL PROTECTIVE EQUIPMENT:

Eye Protection: Chemical safety goggles and/or full face shield to protect eyes and face, if product is handled such that it could be splashed into eyes. Provide an eyewash station in the area.

Skin Protection: Impervious gloves (viton, nitrile) should be worn at all times when handling this material. In confined spaces or where the risk of skin exposure is much higher, impervious clothing should be worn. Safety showers should be available for emergency use.

Respiratory Protection: If exposure exceeds occupational exposure limits, use an appropriate NIOSH-approved respirator. Use a NIOSH-approved chemical cartridge respirator with organic vapour cartridges or use a NIOSH-approved supplied-air respirator. For high airborne concentrations, use a NIOSH-approved supplied-air respirator, either self-contained or airline breathing apparatus, operated in positive pressure mode.

9. PHYSICAL DATA

Physical State:	Liquid
Appearance:	Clear To Yellow
Odour:	Hydrocarbon Odour
Odour Threshold:	Not available
Freezing/Pour Point:	Cloud Point-43 °C
Boiling Point:	150 - 330 °C
Density:	< 850 kg/m ³ @ 15 °C
Vapour Density (Air = 1):	Not available
Vapour Pressure (absolute):	Not available
pH:	Not available
Flash Point:	Pensky-Martens CC > 40 °C
Lower Explosion Limit:	1 % (vol.)
Upper Explosion Limit:	8 % (vol.)
Autoignition Temperature:	250 °C
Viscosity:	1.3 - 2.1 cSt @ 40 °C
Evaporation Rate (n-BuAc = 1):	Not available
Partition Coefficient (log K _{OW}):	Not available
Water Solubility:	Insoluble
Other Solvents:	Hydrocarbon Solvents

10. STABILITY AND REACTIVITY

Chemically Stable:	Yes
Hazardous Polymerization:	No
Sensitive to Mechanical Impact:	No
Sensitive to Static Discharge:	Yes

Hazardous Decomposition Products:
Incompatible Materials:
Conditions of Reactivity:

Thermal decomposition products are highly dependent on combustion conditions.
 Avoid strong oxidizing agents.
 Avoid excessive heat, open flames and all ignition sources.

11. TOXICOLOGICAL INFORMATION

Ingredient (or Product if not specified)
 Fuels, Diesel, No. 2

Toxicological Data
 LD50 Dermal Rabbit > 5000 mg/kg
 LD50 Oral Rat = 9000 mg/kg

Routes of Exposure: Exposure will most likely occur through skin contact or inhalation.
Irritancy: This product is expected to be irritating to skin but is not predicted to be a skin sensitizer.
Acute Toxicity: Vapour concentrations above the recommended exposure level are irritating to the eyes and respiratory tract, may cause headaches and dizziness, are anesthetic and may have other central nervous system effects.
Chronic Effects: Prolonged and repeated contact with skin can cause defatting and drying of the skin resulting in skin irritation and dermatitis. Prolonged exposure to high vapour concentration can cause headache, dizziness, nausea, blurred vision and central nervous system depression.
Pre-existing Conditions: Pre-existing eye, skin and respiratory disorders may be aggravated by exposure to this product.
Carcinogenicity and Mutagenicity: The International Agency for Research on Cancer (IARC) considers that this product is not classifiable as to its carcinogenicity to humans. Middle distillates have caused skin cancers in laboratory animals when applied repeatedly and left in place between applications. This effect is believed to be caused by the continuous irritation of the skin. Good personal hygiene should be maintained to avoid this risk. The American Conference of Governmental Industrial Hygienists (ACGIH) has classified this product as A3 - confirmed animal carcinogen with unknown relevance to humans.

12. ECOLOGICAL INFORMATION

Do not allow product or runoff from fire control to enter storm or sanitary sewers, lakes, rivers, streams, or public waterways. Block off drains and ditches. Provincial regulations require and federal regulations may require that environmental and/or other agencies be notified of a spill incident. Spill area must be cleaned and restored to original condition or to the satisfaction of authorities. May cause physical fouling of aquatic organisms.

Biodegradability: Not readily biodegradable.
Bioaccumulation: Potential for bioaccumulation.
Partition Coefficient (log K_{ow}): Not available

Aquatic Toxicity
 May be harmful to aquatic life.

Ingredient: **Toxicological Data**
Fuels, Diesel, No. 2 EL50 - growth rate Algae (72hr) 10 - 100 mg/L.
 EL50 Daphnia Magna (48hr) 10 - 100 mg/L.
 LL50 (WAF method) Rainbow Trout (96hr) 10 - 100 mg/L.

Definition(s): LL and EL are the lethal loading concentration and effective loading concentration respectively. The concentration represents the amount of substance added to the system to obtain a toxic concentration. They replace the traditional LC and EC for low solubility substances.
WAF is the water accommodated fraction. A slightly soluble hydrocarbon is stirred into water and the insoluble portions are removed. The remaining solution is the water accommodated fraction.

13. DISPOSAL CONSIDERATIONS

Waste management priorities (depending on volumes and concentration of waste) are: 1. recycle (reprocess), 2. energy recovery (cement kilns, thermal power generation), 3. incineration, 4. disposal at a licensed waste disposal facility. Do not attempt to combust waste on-site. Incinerate at a licensed waste disposal site with approval of environmental authority.

14. TRANSPORTATION INFORMATION

Canadian Road and Rail Shipping Classification:

UN Number	UN1202
Proper Shipping Name	DIESEL FUEL
Hazard Class	Class 3 Flammable Liquids
Packing Group	PG III
Additional Information	Not Regulated in Containers Less Than or Equal to 450 Litres.
Shipping Description	DIESEL FUEL Class 3 UN1202 PG III Not Regulated in Containers Less Than or Equal to 450 Litres.

15. REGULATORY INFORMATION

This product has been classified in accordance with the hazard criteria of the *Controlled Products Regulations* (CPR) and the MSDS contains all the information required by the CPR.

WHMIS Class:	Class B3 Combustible Liquid Class D2B Other Toxic Effects - Skin Irritant
DSL/NDSL Status:	This product, or all components, are listed on the Domestic Substances List, as required under the Canadian Environmental Protection Act.
Other Regulatory Status:	No Canadian federal standards.

16. ADDITIONAL INFORMATION

LABEL STATEMENTS

Hazard Statement :	Combustible Liquid. Irritating to skin.
Handling Statement:	Eliminate all ignition sources. Avoid prolonged exposure to vapours. Wear suitable gloves and eye protection. Bond and ground transfer containers and equipment to avoid static accumulation. Empty containers are hazardous, may contain flammable / explosive dusts, liquid residue or vapours. Keep away from sparks and open flames.
First Aid Statement :	Wash contaminated skin with soap and water. Flush eyes with water. If overcome by vapours remove to fresh air. Do not induce vomiting. Obtain medical attention.
Revisions:	This MSDS has been reviewed and updated. Changes have been made to: Section 1 Section 3 Section 5 Section 8 Section 9 Section 12

**Shell Canada Limited**
Material Safety Data Sheet

Effective Date: 2005-08-15

Supersedes: 2002-08-14

Class B3 Combustible **Class D2B** Other Toxic
Liquid Effects - Skin Irritant**1. PRODUCT AND COMPANY IDENTIFICATION**

PRODUCT: SHELL JET A-1 WITH AJA
SYNONYMS: Aviation Turbine Fuel (Kerosene Type)
May contain anti-icing additive (Diethylene Glycol Monomethyl Ether)
PRODUCT USE: Fuel Solvent
MSDS Number: 142-017

MANUFACTURER
Shell Canada Limited
P.O. Box 100, Station M
400-4th Ave. S.W.
Calgary, AB Canada
T2P 2H5

TELEPHONE NUMBERS
Shell Emergency Number 1-800-661-7378
CANUTEC 24 HOUR EMERGENCY NUMBER 613-996-6666
For general information: 1-800-661-1600
For MSDS information: 403-691-3982
(From 7:30 to 4:30 Mountain Time) 403-691-2220

This MSDS was prepared by the Toxicology and Product Stewardship Section of Shell Canada Limited.

*An asterisk in the product name designates a trade-mark(s) of Shell Canada Limited, used under license by Shell Canada Products.

2. COMPOSITION/INFORMATION ON INGREDIENTS

Component Name	CAS Number	% Range	WHMIS Controlled
Kerosene (Petroleum), Hydrodesulfurized	64742-81-0	60 - 100	Yes

See Section 8 for Occupational Exposure Guidelines.

3. HAZARDS IDENTIFICATION**Physical Description:** Liquid Bright Clear Hydrocarbon Odour**Routes of Exposure:** Exposure will most likely occur through skin contact or inhalation.**Hazards:**

	Combustible Liquid. Irritating to skin. Vapours are moderately irritating to the eyes. Ingestion may result in vomiting. Avoid aspiration of vomitus into lungs as small quantities may result in aspiration pneumonitis. Vapours are moderately irritating to the respiratory passages.
Handling:	Eliminate all ignition sources. Avoid prolonged exposure to vapours. Wear suitable gloves and eye protection. Bond and ground transfer containers and equipment to avoid static accumulation. Empty containers are hazardous, may contain flammable / explosive dusts, liquid residue or vapours. Keep away from sparks and open flames.

For further information on health effects, see Section 11.

4. FIRST AID

Eyes:	Flush eyes with water for at least 15 minutes while holding eyelids open. If irritation occurs and persists, obtain medical attention.
Skin:	Wash contaminated skin with mild soap and water for 15 minutes. If irritation occurs and persists, obtain medical attention.
Ingestion:	DO NOT INDUCE VOMITING! OBTAIN MEDICAL ATTENTION IMMEDIATELY. Guard against aspiration into lungs by having the individual turn on to their left side. If vomiting occurs spontaneously keep head below hips to prevent aspiration of liquid into the lungs.
Inhalation:	Remove victim from further exposure and restore breathing, if required. Obtain medical attention.
Notes to Physician:	The main hazard following accidental ingestion is aspiration of the liquid into the lungs producing chemical pneumonitis. If more than 2.0 mL/kg has been ingested, vomiting should be induced with supervision. If symptoms such as loss of gag reflex, convulsions or unconsciousness occur before vomiting, gastric lavage with a cuffed endotracheal tube should be considered.

5. FIRE FIGHTING MEASURES

Extinguishing Media:	Carbon Dioxide Foam Dry Chemical Water Fog
Firefighting Instructions:	Caution - Combustible. Vapour forms a flammable/explosive mixture with air between upper and lower flammable limits. Vapours may travel along ground and flashback along vapour trail may occur. Product will float and can be reignited on surface of water. Do not use a direct stream of water as it may spread fire. Containers exposed to intense heat from fires should be cooled with water to prevent vapour pressure buildup which could result in container rupture. Container areas exposed to direct flame contact should be cooled with large quantities of water as needed to prevent weakening of container structure. Do not enter confined fire space without adequate protective clothing and an approved positive pressure self-contained breathing apparatus.

Hazardous Combustion Products:

A complex mixture of airborne solid, liquid, particulates and gases will evolve when this material undergoes pyrolysis or combustion. Carbon dioxide, carbon monoxide and unidentified organic compounds may be formed upon combustion.

6. ACCIDENTAL RELEASE MEASURES

Issue warning "Combustible". Eliminate all ignition sources. Isolate hazard area and restrict access. Handling equipment must be grounded. Try to work upwind of spill. Avoid direct contact with material. Wear appropriate breathing apparatus (if applicable) and protective clothing. Stop leak only if safe to do so. Dike and contain land spills; contain water spills by booming. Use water fog to knock down vapours; contain runoff. Absorb residue or small spills with absorbent material and remove to non-leaking containers for disposal. Recommended materials: Clay or Sand Flush area with water to remove trace residue. Dispose of recovered material as noted under Disposal Considerations. Notify appropriate environmental agency(ies).

7. HANDLING AND STORAGE

Handling: Avoid excessive heat, sparks, open flames and all other sources of ignition. Fixed equipment as well as transfer containers and equipment should be grounded to prevent accumulation of static charge. Vapours are heavier than air and will settle and collect in low areas and pits, displacing breathing air. Extinguish pilot lights, cigarettes and turn off other sources of ignition prior to use and until all vapours are gone. Vapours may accumulate and travel to distant ignition sources and flashback. Do not cut, drill, grind, weld or perform similar operations on or near containers. Empty containers are hazardous, may contain flammable/explosive dusts, residues or vapours. Do not pressurize drum containers to empty them. Wash with soap and water prior to eating, drinking, smoking, applying cosmetics or using toilet facilities. Launder contaminated clothing prior to reuse. Use good personal hygiene. Combustible.

Storage: Store in a cool, dry, well ventilated area, away from heat and ignition sources. Keep container tightly closed.

8. EXPOSURE CONTROLS / PERSONAL PROTECTION

THE FOLLOWING INFORMATION, WHILE APPROPRIATE FOR THIS PRODUCT, IS GENERAL IN NATURE. THE SELECTION OF PERSONAL PROTECTIVE EQUIPMENT WILL VARY DEPENDING ON THE CONDITIONS OF USE.

OCCUPATIONAL EXPOSURE LIMITS (Current ACGIH TLV/TWA unless otherwise noted):

Kerosene/Jet fuels, as total hydrocarbon vapour (skin) : 200 mg/m³ (Application restricted to conditions in which there are negligible aerosol exposures.)

Skin Notation: Absorption through skin, eyes and mucous membranes may contribute significantly to the total exposure.

Mechanical Ventilation: Use explosion-proof ventilation as required to control vapour concentrations. Concentrations in air should be maintained below the recommended threshold limit value if unprotected personnel are involved. Local ventilation recommended where mechanical ventilation is ineffective in controlling airborne concentrations below the recommended occupational exposure limit. Make up air should always be supplied to balance air exhausted (either generally or locally). For personnel entry into confined spaces (i.e. bulk storage tanks) a proper confined space entry procedure must be followed including ventilation and testing of tank atmosphere.

PERSONAL PROTECTIVE EQUIPMENT:

Eye Protection: Chemical safety goggles and/or full face shield to protect eyes and face, if product is handled such that it could be splashed into eyes. Provide an eyewash station in the area.

Skin Protection: Avoid contact with skin. Use protective clothing and gloves manufactured from nitrile. Safety showers should be available for emergency use.

Respiratory Protection: Avoid breathing vapour or mists. If exposure has the potential to exceed occupational exposure limits, use an appropriate NIOSH-approved respirator. Use a NIOSH-approved chemical cartridge respirator with organic vapour cartridges or use a NIOSH-approved supplied-air respirator.

9. PHYSICAL DATA

Physical State:	Liquid
Appearance:	Bright Clear
Odour:	Hydrocarbon Odour
Odour Threshold:	Not available
Freezing/Pour Point:	Freeze Point < -47 °C
Boiling Point:	145 - 300 °C
Density:	775 - 840 kg/m ³ @ 15 °C
Vapour Density (Air = 1):	Not available
Vapour Pressure (absolute):	1 - 1.4 kPa @ 37.8 °C
pH:	Not available
Flash Point:	Tag Closed Cup > 43 °C
Lower Explosion Limit:	0.7 % (vol.)
Upper Explosion Limit:	5 % (vol.)
Autoignition Temperature:	210 °C
Viscosity:	< 8 cSt @ -20 °C
Evaporation Rate (n-BuAc = 1):	Not available
Partition Coefficient (log K_{OW}):	3.3 - 6
Water Solubility:	Insoluble
Other Solvents:	Hydrocarbon Solvents

10. STABILITY AND REACTIVITY

Chemically Stable:	Yes
Hazardous Polymerization:	No
Sensitive to Mechanical Impact:	No
Sensitive to Static Discharge:	Yes
Hazardous Decomposition Products:	Thermal decomposition products are highly dependent on combustion conditions.
Incompatible Materials:	Avoid strong oxidizing agents.

Conditions of Reactivity: Avoid excessive heat, open flames and all ignition sources.

11. TOXICOLOGICAL INFORMATION

Ingredient (or Product if not specified)	Toxicological Data
Kerosene (Petroleum), Hydrodesulfurized	LD50 Dermal Rabbit > 2000 mg/kg LD50 Oral Rat > 5000 mg/kg
Routes of Exposure: Irritancy:	Exposure will most likely occur through skin contact or inhalation. This product is expected to be irritating to skin but is not predicted to be a skin sensitizer.
Chronic Effects:	Prolonged and repeated contact with skin can cause defatting and drying of the skin resulting in skin irritation and dermatitis. Prolonged exposure to high vapour concentration can cause headache, dizziness, nausea, blurred vision and central nervous system depression.
Pre-existing Conditions: Carcinogenicity and Mutagenicity:	Pre-existing eye, skin and respiratory disorders may be aggravated by exposure to this product. The International Agency for Research on Cancer (IARC) considers that this product is not classifiable as to its carcinogenicity to humans. Middle distillates have caused skin cancers in laboratory animals when applied repeatedly and left in place between applications. This effect is believed to be caused by the continuous irritation of the skin. Good personal hygiene should be maintained to avoid this risk.

12. ECOLOGICAL INFORMATION

Do not allow product or runoff from fire control to enter storm or sanitary sewers, lakes, rivers, streams, or public waterways. Block off drains and ditches. Provincial regulations require and federal regulations may require that environmental and/or other agencies be notified of a spill incident. Spill area must be cleaned and restored to original condition or to the satisfaction of authorities. May cause physical fouling of aquatic organisms.

Biodegradability:	Not readily biodegradable. Rapid volatilization.
Bioaccumulation:	Potential for bioaccumulation.
Partition Coefficient (log K _{OW}):	3.3 - 6

Aquatic Toxicity

Product is expected to be toxic to aquatic organisms.

Ingredient:	Toxicological Data
Kerosene	EL50 - growth rate (WAF method) Algae (72hr) 1 - 10 mg/L.
(Petroleum),	EL50 (WAF method) Daphnia Magna (48hr) 1 - 10 mg/L.
Hydrodesulfurized	LL50 (WAF method) Rainbow Trout (96hr) 1 - 10 mg/L.

Definition(s): LL and EL are the lethal loading concentration and effective loading concentration respectively. The concentration represents the amount of substance added to the system to obtain a toxic concentration. They replace the traditional LC and EC for low solubility substances.
WAF is the water accommodated fraction. A slightly soluble hydrocarbon is stirred into water and the insoluble portions are removed. The remaining solution is the water accommodated fraction.

13. DISPOSAL CONSIDERATIONS

Waste management priorities (depending on volumes and concentration of waste) are: 1. recycle (reprocess), 2. energy recovery (cement kilns, thermal power generation), 3. incineration, 4. disposal at a licenced waste disposal facility. Do not attempt to combust waste on-site. Incinerate at a licenced waste disposal site with approval of environmental authority.

14. TRANSPORTATION INFORMATION

Canadian Road and Rail Shipping Classification:

UN Number	UN1863
Proper Shipping Name	FUEL, AVIATION, TURBINE ENGINE
Hazard Class	Class 3 Flammable Liquids
Packing Group	PG III
Additional Information	Not Regulated in Containers Less Than or Equal to 450 Litres.
Shipping Description	FUEL, AVIATION, TURBINE ENGINE Class 3 UN1863 PG III Not Regulated in Containers Less Than or Equal to 450 Litres.

15. REGULATORY INFORMATION

This product has been classified in accordance with the hazard criteria of the *Controlled Products Regulations (CPR)* and the MSDS contains all the information required by the CPR.

WHMIS Class:	Class B3 Combustible Liquid Class D2B Other Toxic Effects - Skin Irritant
DSL/NDL Status:	This product, or all components, are listed on the Domestic Substances List, as required under the Canadian Environmental Protection Act.
Other Regulatory Status:	No Canadian federal standards.

16. ADDITIONAL INFORMATION

LABEL STATEMENTS

Hazard Statement : Combustible Liquid.
Irritating to skin.

- Handling Statement:** Eliminate all ignition sources.
Avoid prolonged exposure to vapours.
Wear suitable gloves and eye protection.
Bond and ground transfer containers and equipment to avoid static accumulation.
Empty containers are hazardous, may contain flammable / explosive dusts, liquid residues or vapours. Keep away from sparks and open flames.
- First Aid Statement :** Wash contaminated skin with soap and water.
Flush eyes with water.
If overcome by vapours remove to fresh air.
Do not induce vomiting.
Obtain medical attention.
- Revisions:** This MSDS has been reviewed and updated.
Changes have been made to:
Section 3
Section 4
Section 5
Section 7
Section 8
Section 9
Section 12
Section 14

**Shell Canada Limited**
Material Safety Data SheetEffective Date: 2005-07-26
Supersedes: 2002-08-14Class B2 Flammable
LiquidClass D2A Other Toxic
Effects - CarcinogenClass D2B Other Toxic
Effects - Eye Irritant**1. PRODUCT AND COMPANY IDENTIFICATION**

PRODUCT: REGULAR UNLEADED GASOLINE
SYNONYMS: Automotive Fuel
Petrol
PRODUCT USE: Fuel
MSDS Number: 211-001

MANUFACTURER
Shell Canada Limited
P.O. Box 100, Station M
400-4th Ave. S.W.
Calgary, AB Canada
T2P 2H5

TELEPHONE NUMBERS
Shell Emergency Number
CANUTEC 24 HOUR EMERGENCY NUMBER

1-800-861-7378
613-896-6666

For general information:
For MSDS information:
(From 7:30 to 4:30 Mountain Time)

1-800-861-1600
403-691-3982
403-691-2220

This MSDS was prepared by the Toxicology and Product Stewardship Section of Shell Canada Limited.

*An asterisk in the product name designates a trade-mark(s) of Shell Canada Limited, used under license by Shell Canada Products.

2. COMPOSITION/INFORMATION ON INGREDIENTS

Component Name	CAS Number	% Range	WHIMIS Controlled
Gasoline	86290-81-5	> 90	Yes
Ethyl Alcohol	64-17-5	0 - 10	Yes
Benzene	71-43-2	< 1.5	Yes

See Section 8 for Occupational Exposure Guidelines.

3. HAZARDS IDENTIFICATION

Physical Description: Liquid Clear Typical Gasoline Odour

Routes of Exposure: Exposure will most likely occur through skin contact or inhalation.

Hazards:

Vapour concentrations above the recommended exposure level are irritating to the eyes and respiratory tract, may cause headaches and dizziness, are anesthetic and may have other central nervous system effects.

Flammable Liquid.

Irritating to eyes.

May cause cancer.

Ingestion may result in vomiting. Avoid aspiration of vomitus into lungs as small quantities may result in aspiration pneumonitis.

May be absorbed by skin contact. Prolonged immersion in liquid may lead to chemical burns.

Handling:

Eliminate all ignition sources.

Wear suitable gloves and eye protection.

Bond and ground transfer containers and equipment to avoid static accumulation.

Avoid prolonged exposure to vapours.

Empty containers are hazardous, may contain flammable / explosive dusts, liquid residue or vapours. Keep away from sparks and open flames.

For further information on health effects, see Section 11.

4. FIRST AID

- Eyes:** Flush eyes with water for at least 15 minutes while holding eyelids open. If irritation occurs and persists, obtain medical attention.
- Skin:** Wash contaminated skin with mild soap and water for 15 minutes. If irritation occurs and persists, obtain medical attention.
- Ingestion:** DO NOT INDUCE VOMITING! OBTAIN MEDICAL ATTENTION IMMEDIATELY. Guard against aspiration into lungs by having the individual turn on to their left side. If vomiting occurs spontaneously keep head below hips to prevent aspiration of liquid into the lungs.
- Inhalation:** Remove victim from further exposure and restore breathing, if required. Obtain medical attention.
- Notes to Physician:** The main hazard following accidental ingestion is aspiration of the liquid into the lungs producing chemical pneumonitis. If more than 2.0 mL/kg has been ingested, vomiting should be induced with supervision. If symptoms such as loss of gag reflex, convulsions or unconsciousness occur before vomiting, gastric lavage with a cuffed endotracheal tube should be considered.

5. FIRE FIGHTING MEASURES

- Extinguishing Media:** Dry Chemical
Carbon Dioxide
Foam
Water Fog
- Firefighting Instructions:** Extremely flammable. Do not use water except as a fog. Product will float and can be reignited on surface of water. Vapour forms a flammable/explosive mixture with air between upper and lower flammable limits. Avoid breathing vapours. Avoid inhalation of smoke. Vapours may travel along ground and flashback along vapour trail may occur. Do not enter confined fire space without adequate protective clothing and an approved positive pressure self-contained breathing apparatus.

Hazardous Combustion Products: Carbon dioxide, carbon monoxide and unidentified organic compounds may be formed upon combustion.

6. ACCIDENTAL RELEASE MEASURES

Issue warning "Flammable". Eliminate all ignition sources. Isolate hazard area and restrict access. Handling equipment must be grounded. Try to work upwind of spill. Avoid direct contact with material. Wear appropriate breathing apparatus (if applicable) and protective clothing. Stop leak only if safe to do so. Dike and contain land spills; contain water spills by booming. Use water fog to knock down vapours; contain runoff. Absorb residue or small spills with absorbent material and remove to non-leaking containers for disposal. Recommended materials: Clay or Sand Flush area with water to remove trace residue. Dispose of recovered material as noted under Disposal Considerations.

7. HANDLING AND STORAGE

Handling: Extremely flammable. Fixed equipment as well as transfer containers and equipment should be grounded to prevent accumulation of static charge. Avoid breathing vapours and prolonged or repeated contact with skin. Vapours may accumulate and travel to distant ignition sources and flashback. Do not use as a cleaning solvent. Never siphon by mouth. Empty containers are hazardous, may contain flammable/explosive dusts, residues or vapours. Do not cut, drill, grind, weld or perform similar operations on or near containers. Provide adequate ventilation. Launder contaminated clothing prior to reuse. Wash with soap and water prior to eating, drinking, smoking, applying cosmetics or using toilet facilities.

Storage: Store in a cool, dry, well ventilated area, away from heat and ignition sources. Protect against physical damage to containers.

8. EXPOSURE CONTROLS / PERSONAL PROTECTION

THE FOLLOWING INFORMATION, WHILE APPROPRIATE FOR THIS PRODUCT, IS GENERAL IN NATURE. THE SELECTION OF PERSONAL PROTECTIVE EQUIPMENT WILL VARY DEPENDING ON THE CONDITIONS OF USE.

OCCUPATIONAL EXPOSURE LIMITS (Current ACGIH TLV/TWA unless otherwise noted):

Gasoline: 300 ppm (STEL: 500 ppm)

Ethanol: 1000 ppm

Benzene (skin) : 0.5 ppm (STEL: 2.5 ppm)

Skin Notation: Absorption through skin, eyes and mucous membranes may contribute significantly to the total exposure.

**Mechanical
Ventilation:**

Concentrations in air should be maintained below lower explosive limit at all times or below the recommended threshold limit value if unprotected personnel are involved. Use explosion-proof ventilation as required to control vapour concentrations. Make up air should always be supplied to balance air exhausted (either generally or locally). For personnel entry into confined spaces (i.e. bulk storage tanks) a proper confined space entry procedure must be followed including ventilation and testing of tank atmosphere.

PERSONAL PROTECTIVE EQUIPMENT:

- Eye Protection:** Chemical safety goggles and/or full face shield to protect eyes and face, if product is handled such that it could be splashed into eyes. Provide an eyewash station in the area.
- Skin Protection:** Avoid contact with skin. Use protective clothing and gloves manufactured from nitrile.
- Respiratory Protection:** Avoid breathing vapour or mists. If exposure has the potential to exceed occupational exposure limits, use an appropriate NIOSH-approved respirator. For limited time exposures (< 1 hour) exceeding the OEL, use an organic vapour cartridge. For longer exposures or high concentrations, use a NIOSH-approved supplied-air respirator.

9. PHYSICAL DATA

Physical State:	Liquid
Appearance:	Clear
Odour:	Typical Gasoline Odour
Odour Threshold:	< 0.25 ppm
Freezing/Pour Point:	Not available
Boiling Point:	35 - 220 °C
Density:	720 - 760 kg/m ³ @ 15 °C
Vapour Density (Air = 1):	3.5
Vapour Pressure (absolute):	< 107 kPa @ 38 °C
Specific Gravity (Water = 1):	0.74
pH:	Not applicable
Flash Point:	Tag Closed Cup -30 °C
Lower Explosion Limit:	1.4 % (vol.)
Upper Explosion Limit:	7.6 % (vol.)
Autoignition Temperature:	280 °C
Viscosity:	< 1 cSt @ 38 °C
Evaporation Rate (n-BuAc = 1):	Not available
Partition Coefficient (log K _{ow}):	2.3
Water Solubility:	Insoluble
Other Solvents:	Hydrocarbon Solvents
Formula:	C ₄ - C ₁₁

10. STABILITY AND REACTIVITY

Chemically Stable:	Yes
Hazardous Polymerization:	No
Sensitive to Mechanical Impact:	No
Sensitive to Static Discharge:	Yes
Incompatible Materials:	Avoid contact with strong oxidizing agents and acids.
Conditions of Reactivity:	Avoid excessive heat, open flames and all ignition sources.

11. TOXICOLOGICAL INFORMATION

Ingredient (or Product if not specified)		Toxicological Data
Gasoline		LD50 Dermal Rabbit > 5 mL/kg
		LD50 Oral Rat > 18 mL/kg

Ethyl Alcohol	LD50 Dermal Rabbit = 20000 mg/kg LD50 Oral Mouse = 3450 mg/kg LC50 Inhalation Rat = 20000 ppm for 10 hours LD50 Oral Rat = 7060 mg/kg
Benzene	LC50 Inhalation Rat = 13700 ppm for 4 hours LD50 Oral Rat = 930 - 5600 mg/kg

Routes of Exposure:	Exposure will most likely occur through skin contact or inhalation.
Irritancy:	Based on the ingredients, this product would be expected to be irritating to the eyes.
Acute Toxicity:	Vapour concentrations above the recommended exposure level are irritating to the eyes and respiratory tract, may cause headaches and dizziness, are anesthetic and may have other central nervous system effects.
Chronic Effects:	Prolonged and repeated contact with skin can cause defatting and drying of the skin resulting in skin irritation and dermatitis. Prolonged exposure to high vapour concentration can cause headache, dizziness, nausea, blurred vision and central nervous system depression. Prolonged and repeated exposure may cause serious injury to blood forming organs, resulting in anemia and similar conditions.
Carcinogenicity and Mutagenicity:	According to the International Agency for Research on Cancer (IARC) this product is considered to be possibly carcinogenic to humans. Epidemiological studies indicate that long term inhalation of benzene vapour can cause leukaemia in man. Benzene has also produced chromosomal aberrations in peripheral blood lymphocytes.

12. ECOLOGICAL INFORMATION

Do not allow product or runoff from fire control to enter storm or sanitary sewers, lakes, rivers, streams, or public waterways. Block off drains and ditches. Provincial regulations require and federal regulations may require that environmental and/or other agencies be notified of a spill incident. Spill area must be cleaned and restored to original condition or to the satisfaction of authorities.

Biodegradability:	Not readily biodegradable. Rapid volatilization.
Bioaccumulation:	Potential for bioaccumulation.
Partition Coefficient (log K_{ow}):	2.3

Aquatic Toxicity
May be harmful to aquatic life.

Ingredient:	Toxicological Data
Gasoline	EL50 - growth rate (WAF method) Algae (72hr) 1 - 10 mg/L EL50 (WAF method) Daphnia Magna (48hr) 1 - 10 mg/L LL50 (WAF method) Rainbow Trout (96hr) 1 - 10 mg/L
Ethyl Alcohol	
Benzene	EL50 - growth rate Algae (72hr) 10 - 100 mg/L EL50 Daphnia Magna (48hr) 10 - 100 mg/L LL50 Rainbow Trout (96hr) 1 - 10 mg/L

13. DISPOSAL CONSIDERATIONS

Waste management priorities (depending on volumes and concentration of waste) are: 1. recycle (reprocess), 2. energy recovery (cement kilns, thermal power generation), 3. incineration, 4. disposal at a licenced waste disposal facility. Do not attempt to combust waste on-site. Incinerate at a licenced waste disposal site with approval of environmental authority.

14. TRANSPORTATION INFORMATION

Canadian Road and Rail Shipping Classification:

UN Number	UN1203
Proper Shipping Name	GASOLINE
Hazard Class	Class 3 Flammable Liquids
Packing Group	PG II
Additional Information	Marine Pollutant
Shipping Description	GASOLINE Class 3 UN1203 PG II Marine Pollutant

15. REGULATORY INFORMATION

This product has been classified in accordance with the hazard criteria of the *Controlled Products Regulations (CPR)* and the MSDS contains all the information required by the CPR.

WHMIS Class:	Class B2 Flammable Liquid Class D2A Other Toxic Effects - Carcinogen Class D2B Other Toxic Effects - Eye Irritant
DSL/NDL Status:	This product, or all components, are listed on the Domestic Substances List, as required under the Canadian Environmental Protection Act. This product and/or all components are listed on the U.S. EPA TSCA Inventory.
Other Regulatory Status:	No Canadian federal standards.

16. ADDITIONAL INFORMATION

LABEL STATEMENTS

Hazard Statement :	Flammable Liquid. Irritating to eyes. May cause cancer.
Handling Statement:	Eliminate all ignition sources. Wear suitable gloves and eye protection. Bond and ground transfer containers and equipment to avoid static accumulation. Avoid prolonged exposure to vapours. Empty containers are hazardous, may contain flammable / explosive dusts, liquid residue or vapours. Keep away from sparks and open flames.

REGULAR UNLEADED GASOLINE

211-001
Revision Number: 5

First Aid Statement : Wash contaminated skin with soap and water.
Flush eyes with water.
If overcome by vapours remove to fresh air.
Do not induce vomiting.
Obtain medical attention.

Revisions: This MSDS has been reviewed and updated.
A WHMIS class has been added to this MSDS.
The ingredients have changed. Other information may also be affected by that change.

MATERIAL SAFETY DATA SHEET



Product: DIPSOL

MAGNUS CHEMICALS LIMITED
1271 AMPERE
BOUCHERVILLE, QUEBEC, J4B 5Z5

EMERGENCY PHONE: 450-655-1344 FAX: 450-655-5428 (8:30 to 16:30)
(613) 996-6666 (CANUTEC)

1- PRODUCT INFORMATION:

Product Manufacturer: MAGNUS CHEMICALS LIMITED
Product Identifier: Dipsol
Product Use: General use solvent for light paint-brush degreasing.

2- HAZARDOUS INGREDIENTS:

MATERIAL or COMPOUND:	C.A.S. No.:	PERCENT: W/W	THRESHOLD LIMIT		LD50 oral, rat
			VALUE (TLV) PPM:	mg/m3	
Aliphatic naphtha	NAV	60-100	200	1250	NAV
Aromatic hydrocarbon	64742-94-5	15-40	100	550	> 500 mg/kg
NAP: Not Applicable, NAV: Not Available					

3- PHYSICAL DATA:

Physical State: Liquid.
Appearance and Odor: Clear colorless liquid, citrus odor.
Odour Threshold: Not available.
Specific Gravity: 0.813
Vapor Pressure: 0.5 kpa at 38oC
Vapor Density: 4.7-5.4 (air=1)
Evaporation Rate: 0.04 (butyl acetate= 1)
Boiling Point: 182 to 210oC
Freezing Point: Not applicable.
pH: Not applicable.
Coefficient of Water/Oil Distribution: .. Not available.
Percent Volatile: 100%
Solubility in Water: Negligible.

4- FIRE AND EXPLOSION HAZARD DATA

Conditions of Flammability: Temperature above flash point.
Extinguishing Media: CO2, dry chemical, foam.
Flash Point and Method: 60oC TCC
Flammable Limits - UEL: 6.0
Flammable Limits - LEL: 0.9
Auto-Ignition Temperature: Not available.
Hazardous Combustion Product: Carbon monoxide.
Sensitivity to Mechanical Impact / Static Discharge: Ground the container.
Unusual Fire And Explosion Hazards: None known.

MATERIAL SAFETY DATA SHEET



Product: DIPSOL

5- REACTIVITY DATA

Stability, If Not, Under Which Condition: Stable.
Incompatibility - Materials to Avoid: ... Oxidizer.
Hazardous Polymerization: Will not occur.
Corrosion: None known.
Hazardous Decomposition Products: Not available.

6- PREVENTIVE MEASURES

Environmental Data: Not available.
Handling: Practice good industrial hygiene when handling this product.
Personal Protective Equipment:
 Eye Protection: Safety glasses.
 Hand Protection: Neoprene, gauntlet type.
 Respiratory Protective Equipment: .. When TLV is exceeded, an approved respirator is advised.
 Other Protective Equipment: Determined by the application.
Recommended Disposal: Disposal should be in accordance with applicable regulations.
Spill Response: Extinguish all ignition sources, Absorb with a commercial absorbent, Ventilate the area.
Storage Requirements: Store in a well ventilated area, away from ignition source.
Ventilation Requirements: Provide ventilation capable of maintaining emissions below the TLV.

7- TOXICOLOGICAL PROPERTIES

ROUTE OF ENTRY: Eyes and skin contact. Inhalation.

7.1 - EFFECTS OF ACUTE EXPOSURE:

Eye Contact: Possibility of a light irritation.
Skin Contact: Possibility of a light irritation.
Inhalation: In high concentration, may cause irritation.
Ingestion: Low toxicity.

7.2 - EFFECTS OF CHRONIC EXPOSURE:

Carcinogenicity: Not applicable.
Reproductive Toxicity: Not applicable.
Teratogenicity: Not applicable.
Mutagenicity: Not applicable.
Synergistic Product: Not available.
Sensitization: Not available.

8- SUGGESTED FIRST AID

Eye Contact: Rinse with plenty of water during at least 15 minutes.
Skin Contact: Wash with soap and water.
Inhalation: Remove victim to fresh air.
If Swallowed: Do not induce vomiting.
Other First Aid: Contact a physician.

MATERIAL SAFETY DATA SHEET



Product: DIPSOL

9- ADDITIONAL INFORMATION

TDG Classification: Not-regulated.
WHMIS Classification: B3

10- PREPARATION INFORMATION

Preparation: MAGNUS Industrial Hygiene Department TEL: 450-655-1344
FAX: 450-655-5428

Code. : 018294

Date of Preparation: 11/06/2004

The opinions expressed herein are those of qualified experts within MAGNUS CHEMICALS LIMITED. We believe that the information contained herein is current as of the date of this Material Safety Data Sheet. Since the use of this information and of these opinions and the conditions of use of the product are not within the control of MAGNUS CHEMICALS LIMITED, it is the user's obligation to determine the conditions of safe use of the product.

msds02/dipsola



MATERIAL SAFETY DATA SHEET

Product: SUPREX

MAGNUS CHEMICALS LIMITED
1271 AMPERE
BOUCHERVILLE, QUEBEC, J4B 5Z5

EMERGENCY PHONE: 450-655-1344 FAX: 450-655-5428 (8:30 to 16:30)
(613) 996-6666 (CANUTEC)

1- PRODUCT INFORMATION:

Product Manufacturer: MAGNUS CHEMICALS LIMITED
Product Identifier: Suprex
Product Use: General purpose degreaser.

2- HAZARDOUS INGREDIENTS:

MATERIAL or COMPOUND:	C.A.S. No.:	PERCENT: W/W	THRESHOLD LIMIT		LD50/LC50
			VALUE (TLV) PPM:	mg/m3	

Not applicable.

NAP: Not Applicable, NAV: Not Available

3- PHYSICAL DATA:

Physical State: Liquid.
Appearance and Odor: Clear yellow liquid with a light pine odor.
Odour Threshold: Not available.
Specific Gravity: 1.02
Vapor Pressure: Not available.
Vapor Density: Not available.
Evaporation Rate: < 1 (butyl acetate = 1).
Boiling Point: Near 100oC
Freezing Point: Near 0oC
pH: 11.7 (10% solution)
Coefficient of Water/Oil Distribution: .. Not available.
Percent Volatile: 84%
Solubility in Water: 100%

4- FIRE AND EXPLOSION HAZARD DATA

Conditions of Flammability: None known.
Extinguishing Media: Not applicable.
Flash Point and Method: Not applicable.
Flammable Limits - UEL: Not applicable.
Flammable Limits - LEL: Not applicable.
Auto-Ignition Temperature: Not applicable.
Hazardous Combustion Product: Oxide of carbon.
Sensitivity to Mechanical Impact / Static Discharge: Not applicable.
Unusual Fire And Explosion Hazards: None known.



MATERIAL SAFETY DATA SHEET

Product: SUPREX

5- REACTIVITY DATA

Stability, If Not, Under Which Condition: Stable.
Incompatibility - Materials to Avoid: ... Acid.
Hazardous Polymerization: Will not occur.
Corrosion: None known.
Hazardous Decomposition Products: Not available.

6- PREVENTIVE MEASURES

Environmental Data: Not available.
Handling: Handle and open container with care.
Personal Protective Equipment:
 Eye Protection: Safety glasses.
 Hand Protection: Gloves if necessary.
 Respiratory Protective Equipment: .. Not normally necessary.
 Other Protective Equipment: Not normally necessary.
Recommended Disposal: Disposal should be in accordance with applicable regulations.
Spill Response: Wash the area with water.
Storage Requirements: Avoid freezing.
Ventilation Requirements: Mechanical (general).

7- TOXICOLOGICAL PROPERTIES

ROUTE OF ENTRY: Skin contact. Eye contact.

7.1 - EFFECTS OF ACUTE EXPOSURE:

Eye Contact: Irritation.
Skin Contact: Possibility of a light irritation.
Inhalation: Negligible effects.
Ingestion: Gastric discomfort.

7.2 - EFFECTS OF CHRONIC EXPOSURE:

Carcinogenicity: Not applicable.
Reproductive Toxicity: Not applicable.
Teratogenicity: Not applicable.
Mutagenicity: Not applicable.
Synergistic Product: Not available.
Sensitization: Not available.

8- SUGGESTED FIRST AID

Eye Contact: Rinse with plenty of water.
Skin Contact: Wash with plenty of water during at least 15 minutes.
Inhalation: Remove victim to fresh air.
If Swallowed: Drink plenty of water.
Other First Aid: Contact a physician.



MATERIAL SAFETY DATA SHEET

Product: SUPREX

9- ADDITIONAL INFORMATION

TDG Classification: Not regulated.
WHMIS Classification: Not regulated.

10- PREPARATION INFORMATION

Preparation: MAGNUS Industrial Hygiene Department TEL: 450-655-1344
FAX: 450-655-5428

Code. : 030044

Date of Preparation: 05/31/2004

The opinions expressed herein are those of qualified experts within MAGNUS CHEMICALS LIMITED. We believe that the information contained herein is current as of the date of this Material Safety Data Sheet. Since the use of this information and of these opinions and the conditions of use of the product are not within the control of MAGNUS CHEMICALS LIMITED, it is the user's obligation to determine the conditions of safe use of the product.

LS07 / suprexa

APPENDIX -2-

Spill Contingency report

Information of Incident

Section A

Date of Incident _____	Time _____	<div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> ° <div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> ' <div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> " W
		<div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> ° <div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> ' <div style="display: inline-block; width: 30px; height: 30px; border: 1px solid black;"></div> " N
Location _____	Coordinates: _____	

Check the Direction of Spill Movement:

(State the bearing if possible)

N ☐ NW ☐ W ☐ SW ☐ S ☐ SE ☐ E ☐ NE ☐

Bearing: _____ Rate of Movement: _____

Party Responsible for Spill _____ Type of Substance that Spilled _____

Estimated Quantity of Substance _____

Specific Cause of Incident

Section B

Please state the causes of the incident above in the following space provided

Status of Incident

Section C

<div data-bbox="230 1463 769 1482"><p>Approximate surface area of contamination</p></div> <div data-bbox="248 1528 586 1551"><p>Containmant Actions Taken:</p></div> <div data-bbox="290 1589 683 1753"><ul style="list-style-type: none"><input type="checkbox"/> Occurred Naturally<input type="checkbox"/> Booms used<input type="checkbox"/> Dyke used<input type="checkbox"/> No containment implemented<input type="checkbox"/> Other (specify)</div> <div data-bbox="328 1785 769 1822"><p>_____</p><p>_____</p></div>	<div data-bbox="959 1413 1401 1476"><p>List any factors affecting the spill such as: wind, temperature, etc.</p></div> <div data-bbox="959 1478 1401 1812"></div>
---	---

Action Proposed to Clean, Contain or Dispose of Spilled Substance

Section D

Hazards of Spill Section E
<input type="checkbox"/> Flammable <input type="checkbox"/> Combustible <input type="checkbox"/> Health hazard (specify) <input type="checkbox"/> Corrosive <input type="checkbox"/> Explosive <input type="checkbox"/> Radioactive <input type="checkbox"/> Other (specify)

Information if Assistance is Required Section F	
Organization <input type="text"/>	
Contact Person <input type="text"/>	
Contact Number <input type="text"/>	Alternate Number <input type="text"/>
Hours of Operation: <input type="text"/>	

Comments and Recommendations Section G

Information on Person Making Report Section H		
() -		
Full Name	Contact Number	Position & Department
Employer		
Submitted to	Reporter's Signature	Date