


NOTES:

1. TIE CABLE TRAY GROUND TO BURIED GROUNDING CONDUCTOR AT EVERY THIRD SUPPORT ALONG PUMP PAD.

- - COPPER CLAD GROUND ROD 19Ø X 3M DRIVEN 300 BELOW GRADE
- - BOLTED COMPRESSION OR MECHANICAL COMPRESSION CONNECTION
- - BURIED GROUND CONDUCTOR 2/0 AWG BARE CU.

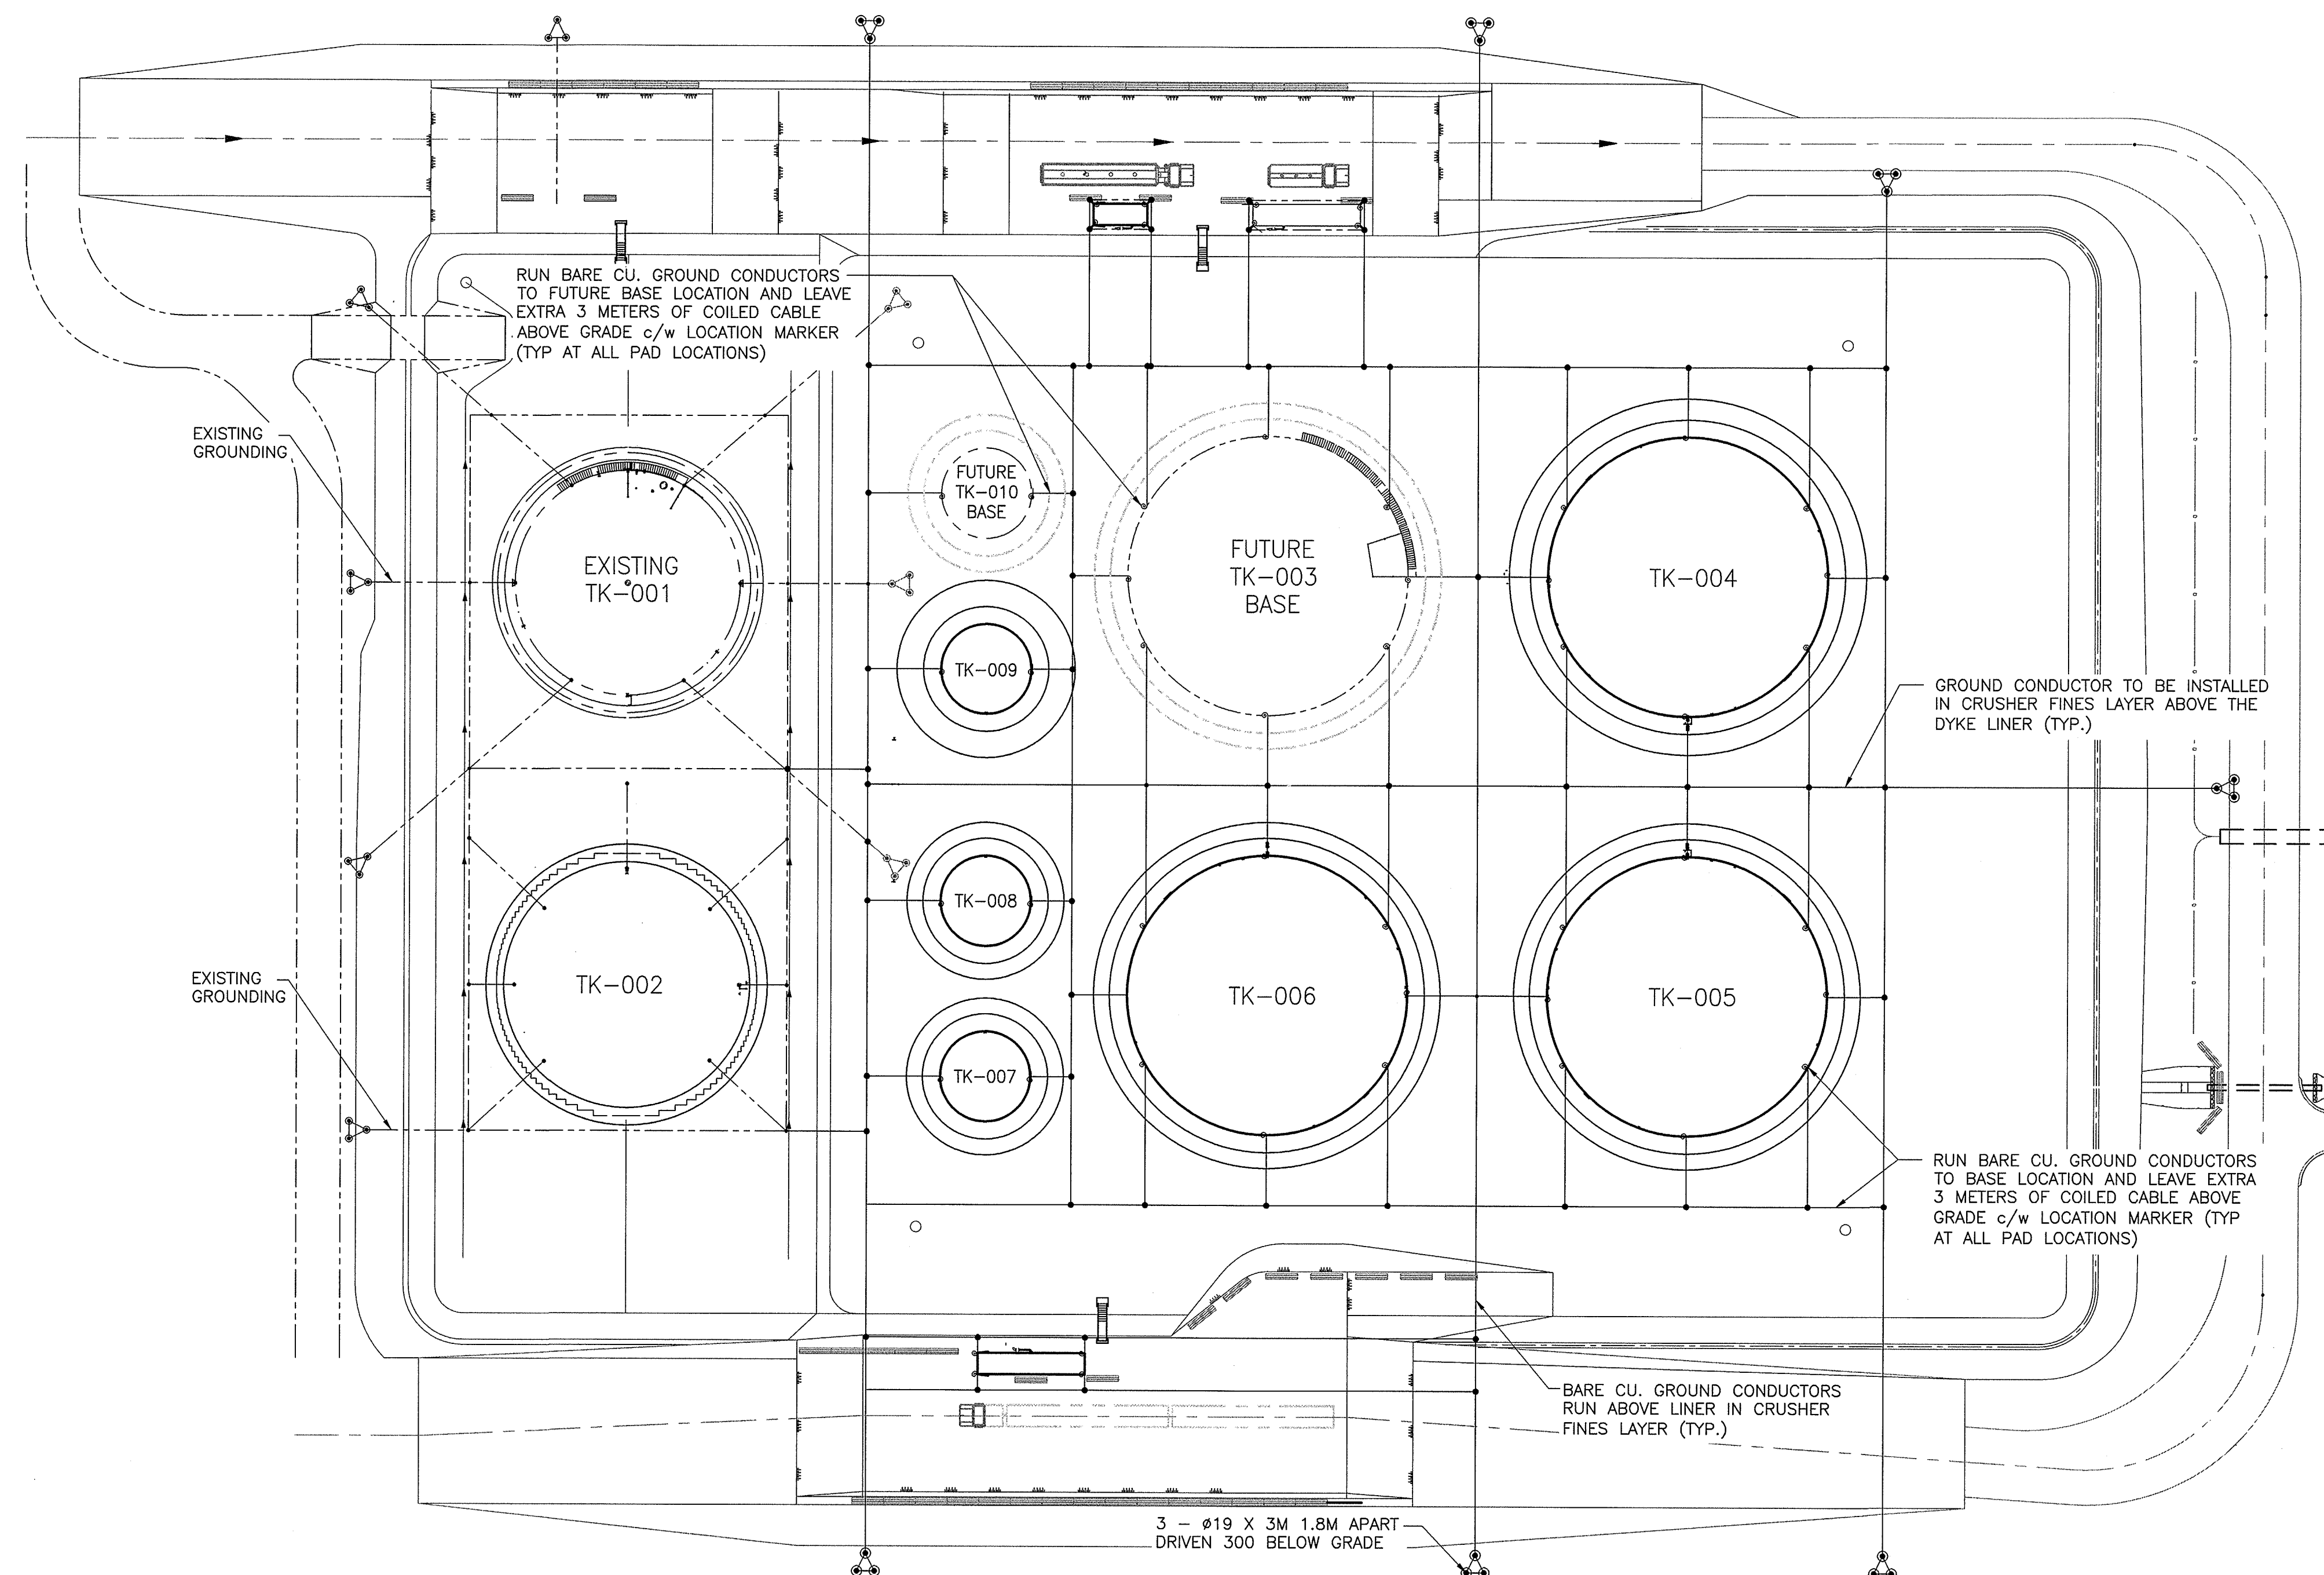

0 5 10 15 20 25
SCALE IN METRES

[illegible]

\$DATAENTRY\$\$