



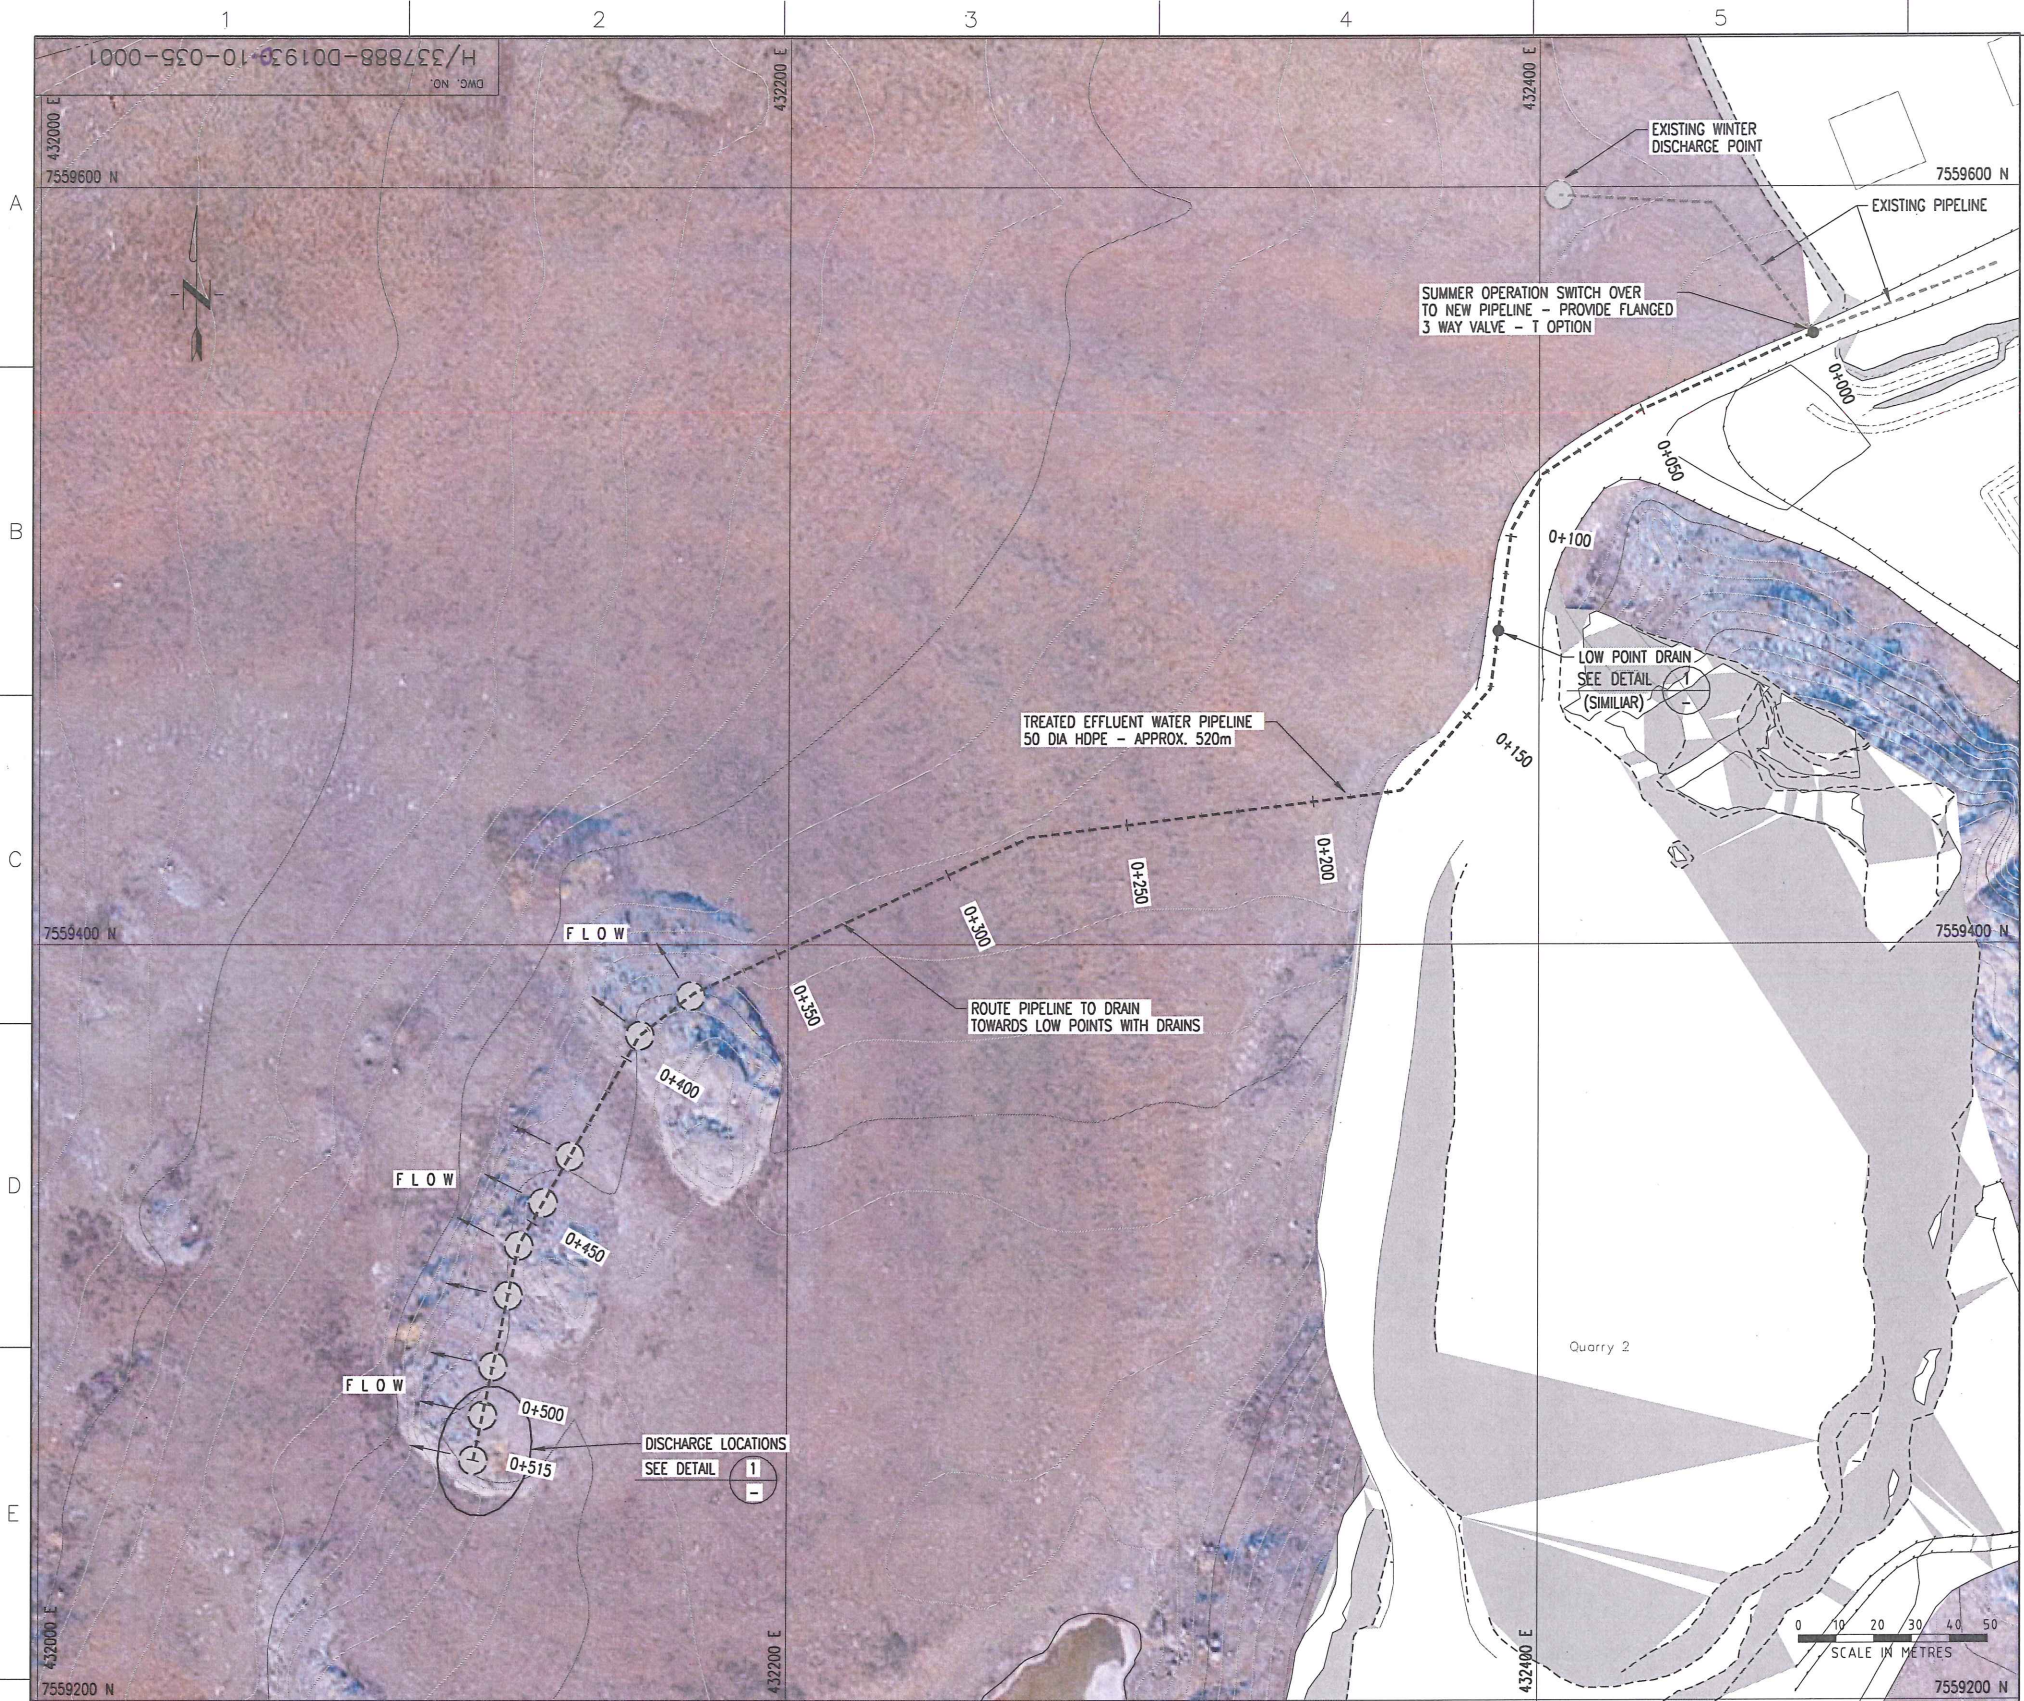

ITEM	DESCRIPTION	QUANTITY
1	50 DIA SDR17 HDPE PIPE	520m
2	GROOVE TO FLANGE TRANSITION CPLG (VICTAULIC OR EQUIV.)	20
3	50x50x19 GROOVED TEE (VICTAULIC OR EQUIV.)	10
4	19 DIA THREADED CPLG	10
5	150 LONG THREADED NIPPLE	10
6	19DIA THREADED BALL VALVE	10
7	300 LONG THREADED NIPPLE	9
8	50 DIA HDPE CAP	1
9	50 DIA FLANGE ADAPTER - STUB END WITH FLANGE	3
10	50 DIA 3 WAY FLANGED VALVE - FULL PORT - T OPTION	1

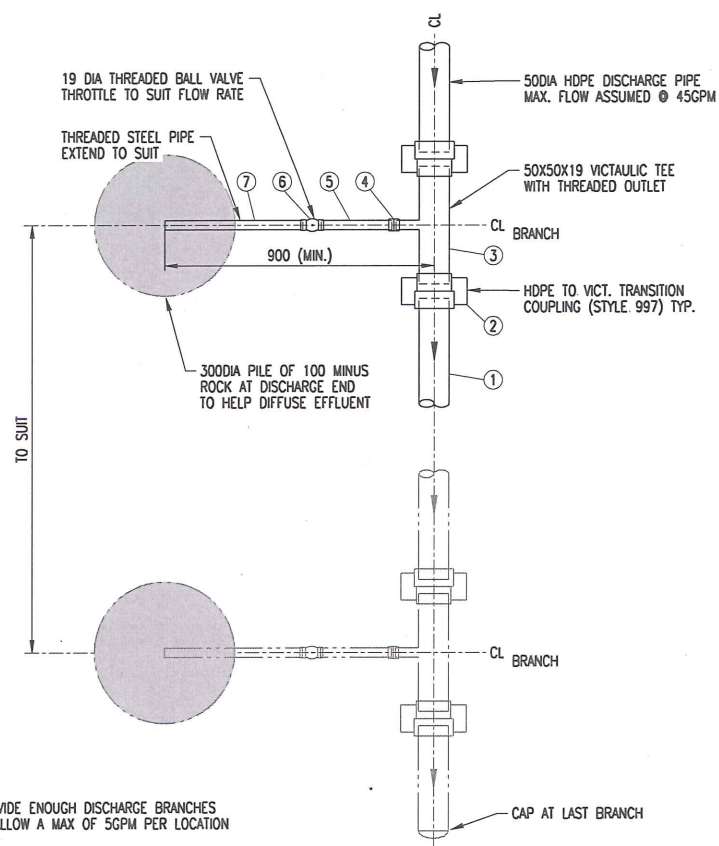

NOTE:
- PROVIDE ENOUGH DISCHARGE BRANCHES TO ALLOW A MAX OF 5GPM PER LOCATION
- VERIFY MAX FLOW FROM S.T.P. AND ADJUST NUMBER OF EFFLUENT DISCHARGE POINT TO SUIT

SUMMER DISCHARGE ARRANGEMENT

DETAIL 1
N.T.S.

HBP01-DA-A-DWG-1925-00001

DRAWING NO.	DRAWING TITLE
REFERENCE DRAWINGS	

INTERNAL/CLIENT
REVIEW
APRIL 05/2011

A	ORIGINAL DRAWING	DATE
NO.	DESCRIPTION	BY CHK'D APP'D DATE
		05/04/2011

A	INTERNAL/CLIENT REVIEW	DATE
REV.	ISSUE FOR	DATE
	ISSUE AUTHORIZATION	DATE

DESIGNED BY	DRAWN BY
DATE	DATE
CHECKED BY	DISCIP. ENGR.
DATE	DATE
PROJ. DES. COORD.	PROJ. ENGR.
DATE	DATE
PROJ. MGR.	CLIENT
DATE	DATE

HATCH™		NEWMONT™ The Gold Company	
HOPE BAY MINING LTD.		SEWAGE DISPOSAL DIFFUSER SUMMER DISCHARGE LAYOUT PLAN AND DETAIL	
SCALE 1:1000 OR AS NOTED	DWG. NO. H/337888-D01930-10-035-0001	REV. A	

\\01\eng\proj\1925\CAD\CAD\1930-10-035-0005.dgn
2011/04/05 2:04:59 AM