
Appendix B As built drawing

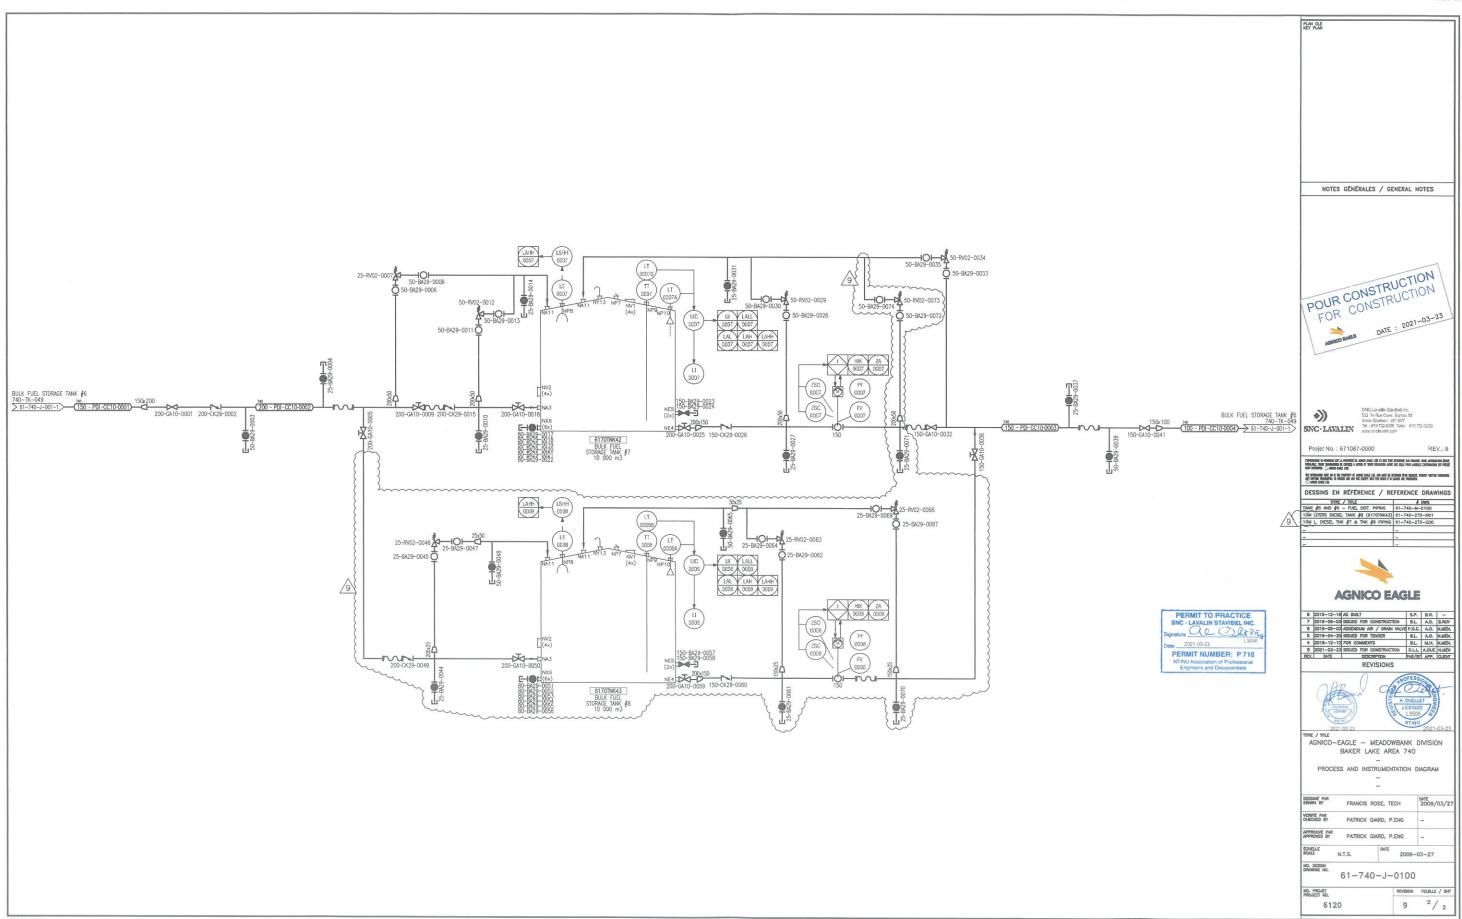

Panel Ident.: 6174-DP-06

Power source: 120 208 Volts 6174-TX-04 Feeder:

Mount: Surface BAKER LAKE SEA CAN Localisation:

Schneider QO Series Type:

Encl. Type: NEMA 1 Main breaker: N/A Nb. of circuit: 42 Bars (Amps): 225A Cap. rupt. (kA) 10

Local and		PE	SL		DISJ.				DIS			ΤY	PE	Local and	
description	REF	Qty	WATT	TYPE	AMP	T #		CT #	AMP	TYPE	WATT	Qty	REF	description	
6174-PLC-02 Power	D				15	1	Α	2	15				Ε	Sea Can Lighting	
6174-XV-01 - Elect. Actuator valve					15	3	В	4	15				Р	Sea Can Receptacle	
6174-XV-02 - Elect. actuator valve	М				15	5	С	6	15					Spare breaker	
6174-XV-03 - Elect. actuator valve	М				15	7	Α	8	15					Spare breaker	
6174-XV-04 - Elect. actuator valve	М				15	9	В	10	15					Spare breaker	
6174-XV-05 - Elect. actuator valve	М				15	11	С	12	15					Spare breaker	
6174-XV-06 - Elect. actuator valve	М				15	13	Α	14	15					Spare breaker	
6174-IOP-003 power	D				15	15	В	16	15				П	Spare breaker	
Spare breaker					15	17	С	18	30				П	Co and harden	
Spare breaker					15	19	Α	20	30					Spare breaker	
6174-XV-07	М				15	21	В	22	15	GFI			С	6174-HEA-07	
Res. #7 Valve Actuator	- IVI		~	_	13	23	С	24	\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	Gri	~~	-		Res. #7 Valve Heating	
6174-XV-08	М				15	25	Α	26	15	GFI			С	6174-HEA-08	
Res. #8 Valve Actuator	IVI				. 15	127	В	28	15	GFI				Res. #8 Valve Heating	
Space			00			29	С	30						Space	
Space						31	A	32						Space	
Space						33	В	34						Space	
Space						35	С	36						Space	
Space						37	Α	38						Space	
Space						39	В	40					П	Space	
Space						41	С	42						Space	

TYPE (REF)	(W) total	Qty
(E) Lighting	0	0
(P) Parking plug	0	0
(C) Heating	0	0
(M) Motor	0	0
(W) Water heater	0	0
(D)Other	0	0
	0	0

TYPE (REF)	Qty (ref)
(L) Spare	0
(S) Space	0

	Watts	Amp
Phase A	0	0,00
Phase B	0	0,00
Phase C	0	0,00
Total R	0	0,00

POUR CONSTRUCTION
FOR CONSTRUCTION
DATE: 2021-03-10

PERMIT TO PRACTICE SNC - LAVALIN STAVIBEL INC. 2021-03-17

PERMIT NUMBER: P 718 NT/NU Association of Professional Engineers and Geoscientists



_	_	4	ISSUED FOR CONSTRUCTION	2021-03-10	J.BOU
	_	3	AS BUILT	2020-01-24	S.MAR
_	_	2	ISSUED FOR CONSTRUCTION	2019-06-03	P.LEM
	_	1	ISSUED FOR TENDER	2019-05-03 JUNE/16	P.LEM.
- ·	-	0	ORIGINAL DRAWING WAS 6174-E-002		M.B.
TITRE / TITLE	# DWG	REV	DESCRIPTION	DATE	PAR
DESSINS EN REFERENCE / RE	FERENCE DRAWINGS		REVISIONS		



Project #: 660534-0000 REV:1 SNC·LAVALIN

150, rue Gamble Ouest Rouyn-Noranda (Québec) J9X 2R7 Tel.: 819 764-5181 Fax: 819 797-0158 www.snclavalin.com


DESSINÉ PAR DRAWN BY	MV	DATE MAY/16
VÉRIFIÉ PAR CHECKED BY	ST ·	JUNE/16
APPROVÉ PAR APPROVED BY	ST	JUNE/16
No. PROJET PROJECT NO.	6120	
DATE	JUNE/16	

ÁGNICO EAGLE - MEADOWBANK DIVISION BAKER LAKE AREA 740 285 - SERVICE ELECTRICAL - LIGHT AND DISTRIBUTION 6174-DP-06 PANEL SCHEDULE


BAKER LAKE SEA CAN - DISTRIBUTION PANEL 120/208VAC


ÉCHELLE/ SCALE N/A FILE 61-740-285-200_R4.dwg No. DESSIN/ DRAWING NO. 61-740-285-200 FEUILLE/SHT 1 / 1 4


NO. DESIGN 61-740-275-201

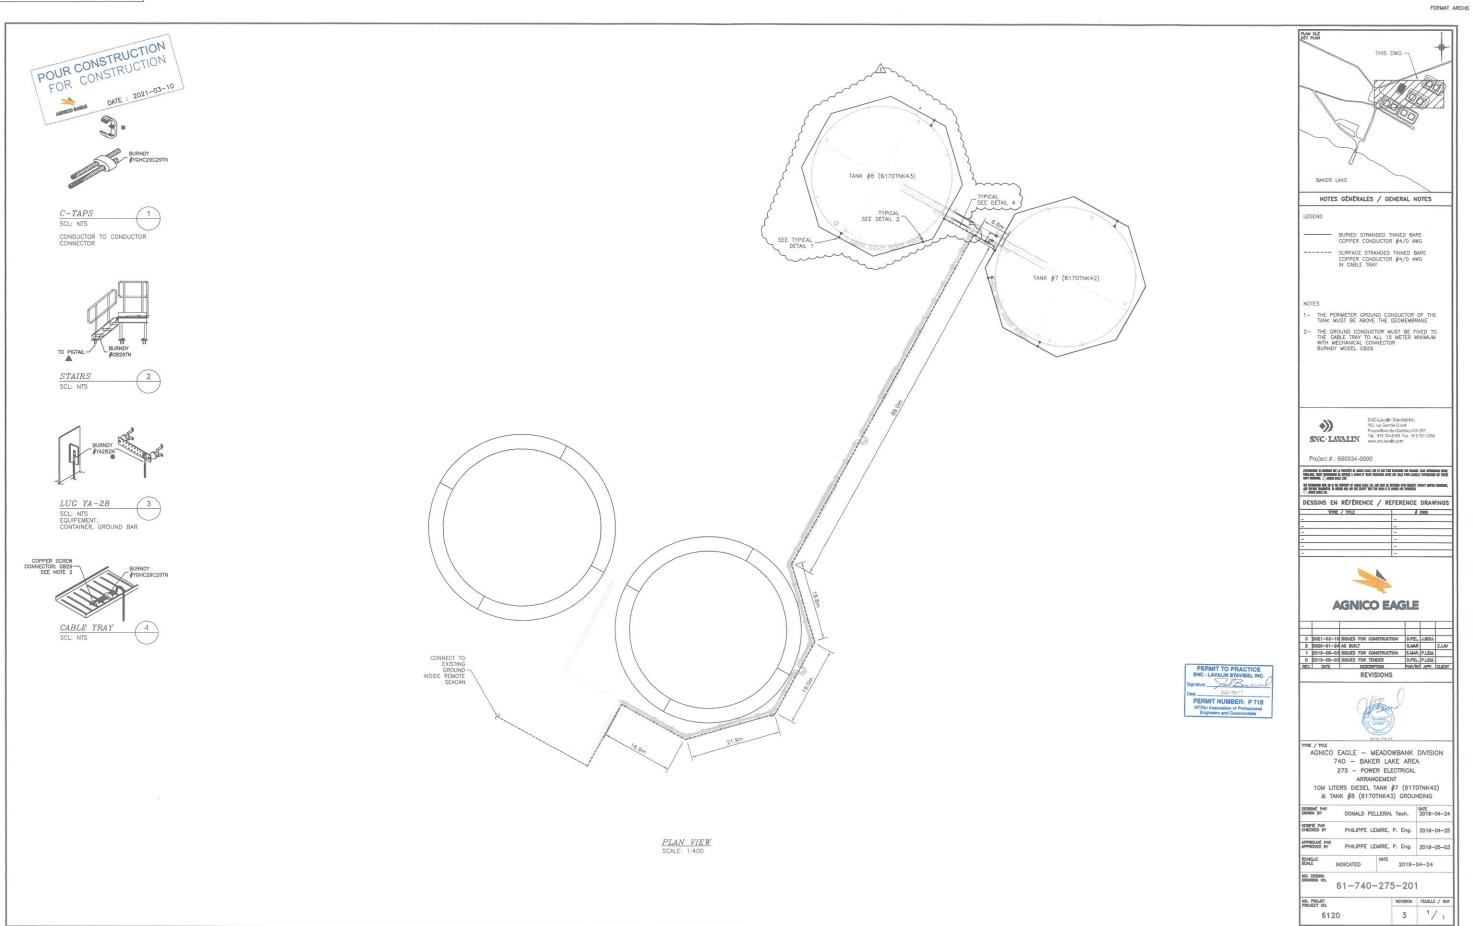


P\300-RM\871087\0000C\4-ingeniarie\D-Deseits mailtres\48-IC\\$1-740-275-201_R3.darg-2013-02-19 14:03:29

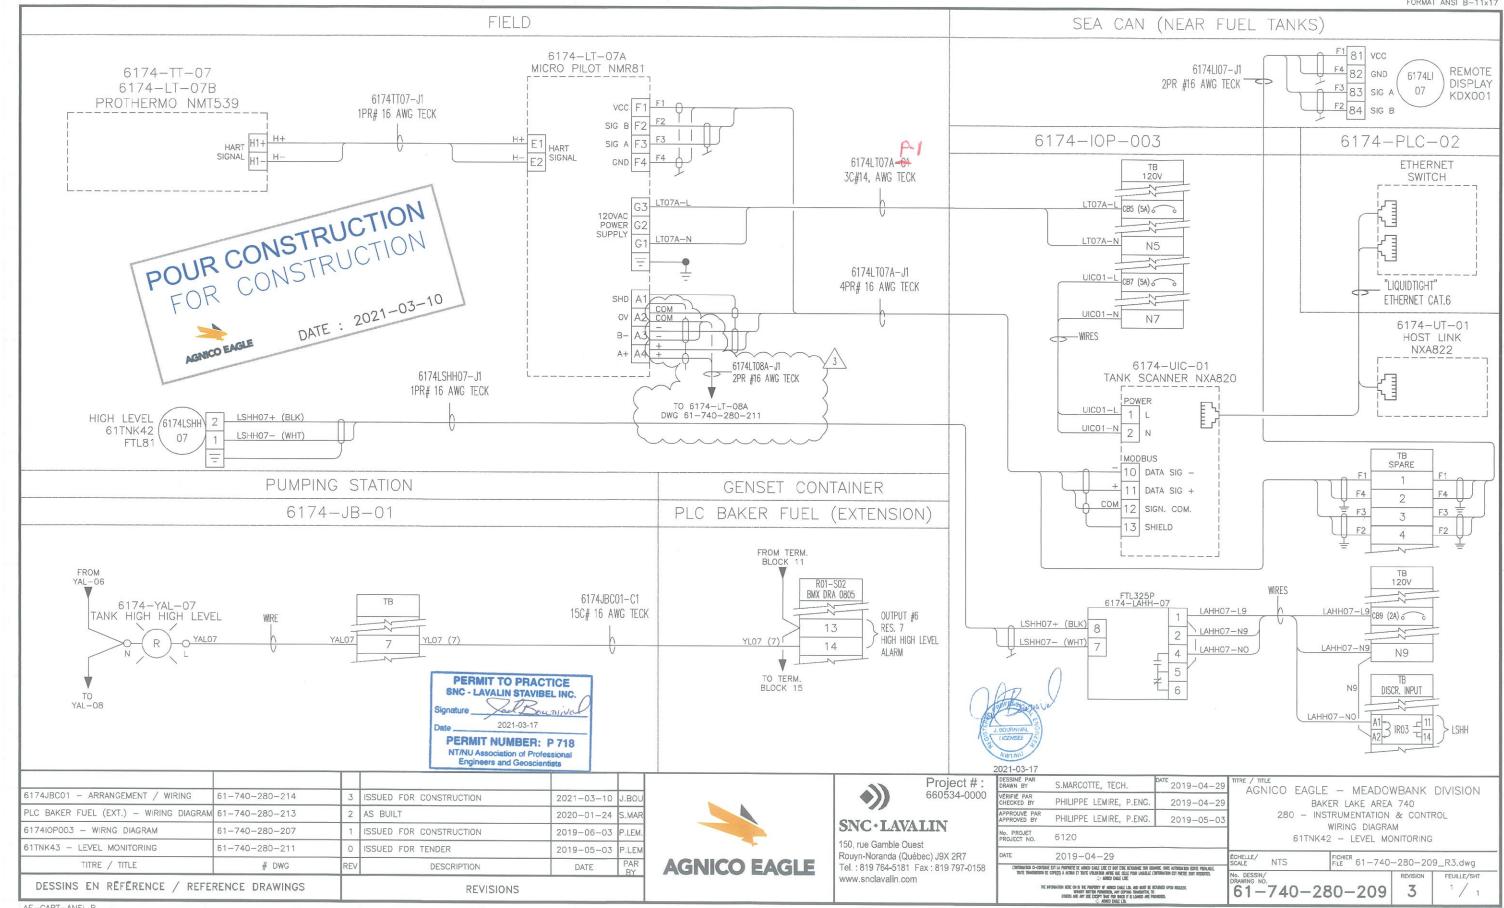

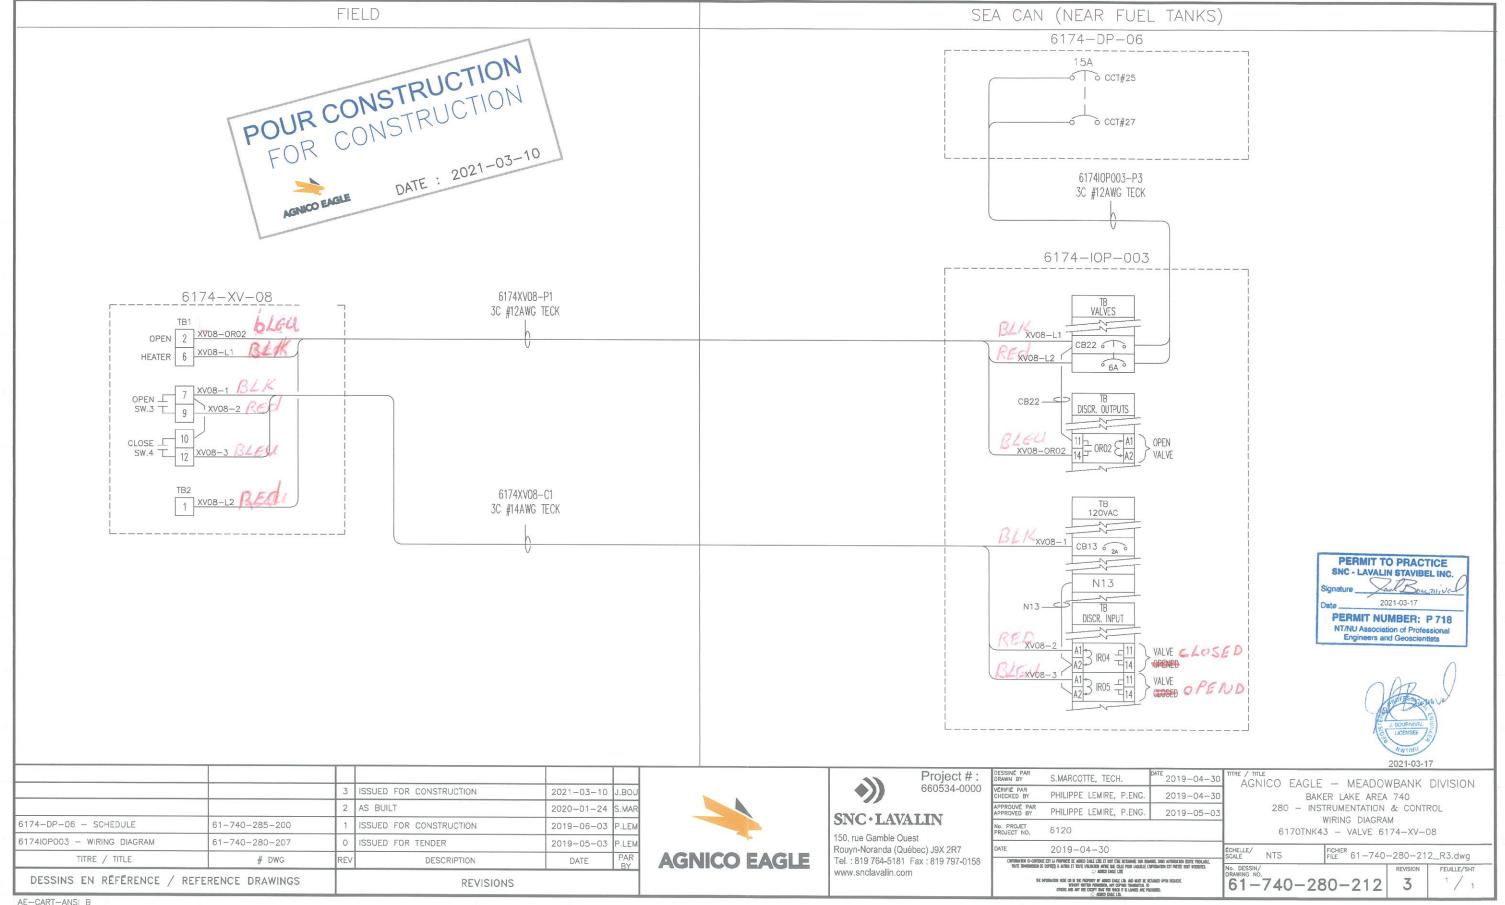

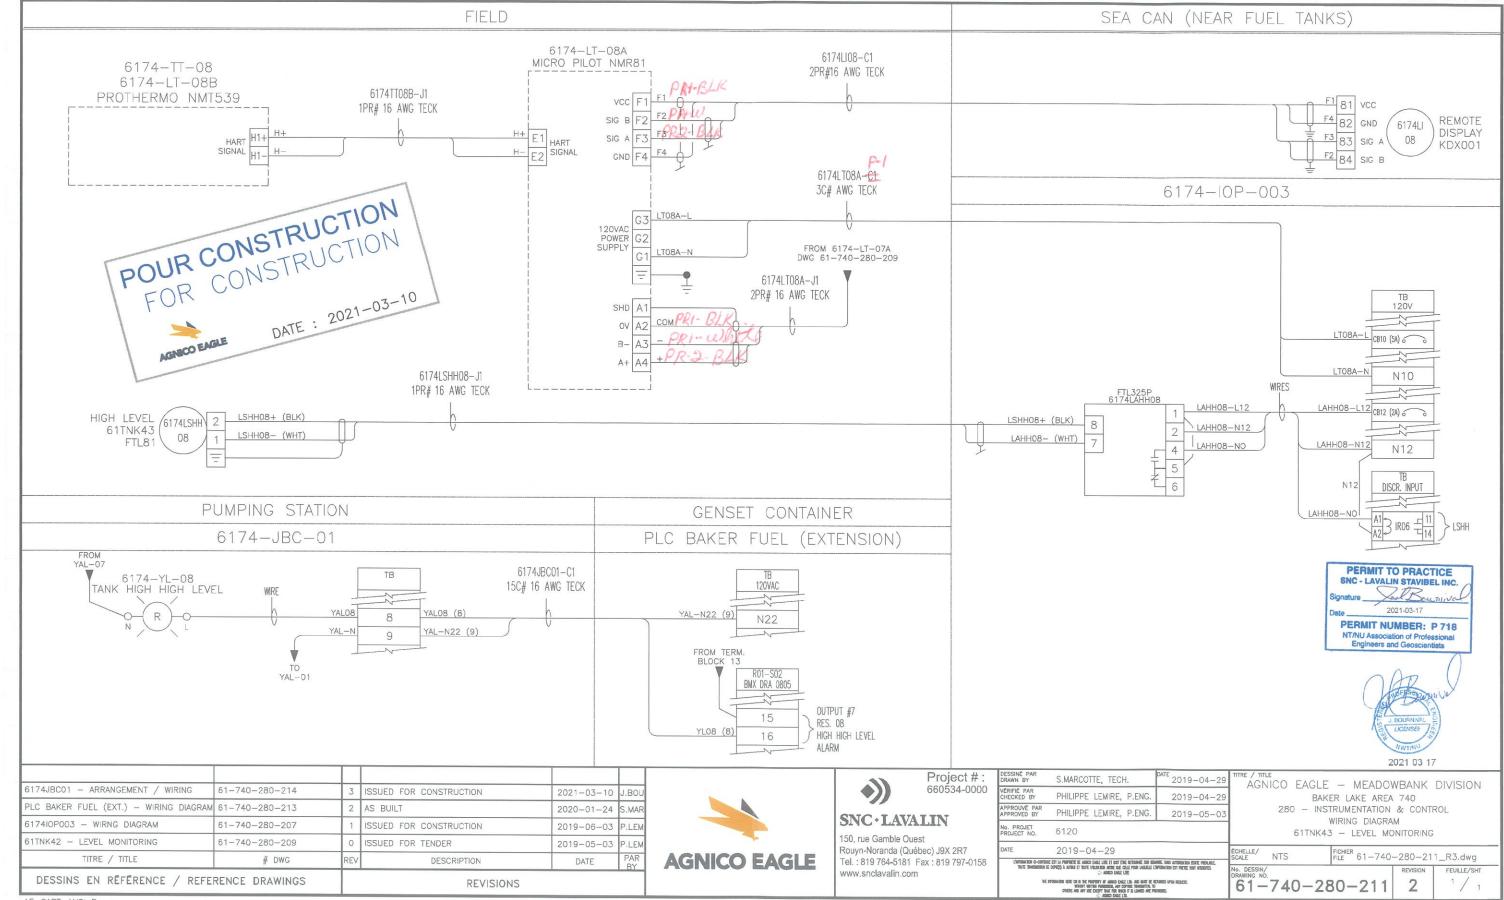

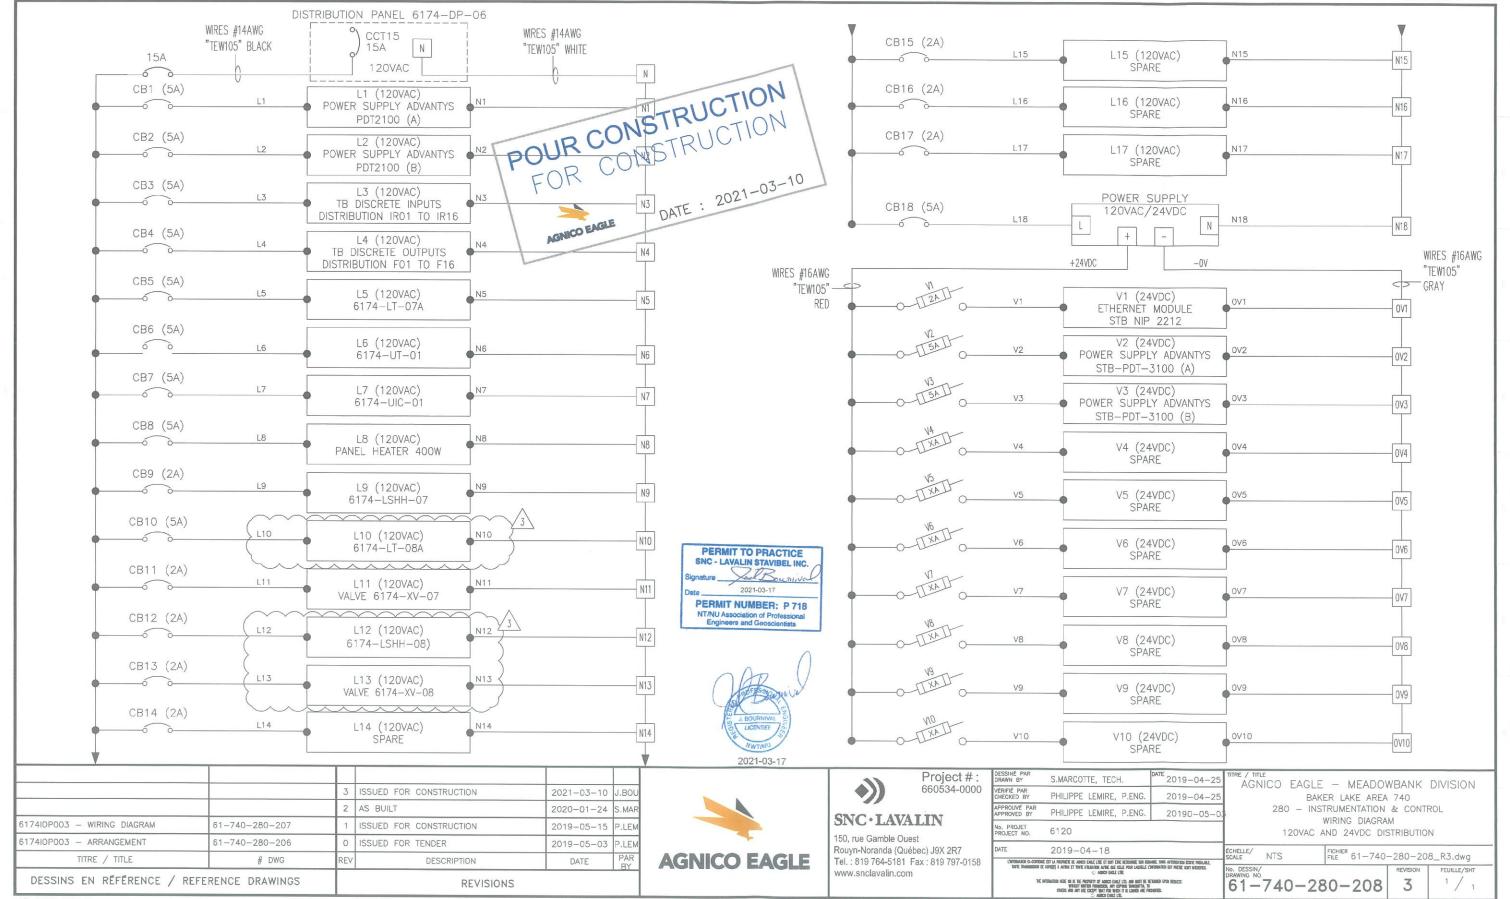

	OWNER		Agnico Eagle Mines BY: Nathan Bisson										
411	PROJECT NA		Baker Lake Fuel Farm	APPROVED:	Roxanne Lavoie, P.Eng. (OIQ) / I.Gaç	gnon P.Eng.							
•))	PROJECT NO	:	6129-S-265-020	REV:	0 - For Tender								
SNC·LAVALIN	DOC NO:		6129-S-265-020-MTO-002	REV DATE:	2021-06-30					-			
			MTO Piping - Baker Lake Fuel Farm Drawing number: 61-740-270-003			MATERIAL TAK Descriptio			AGNICO EAGLE				
Rev. Date	Qty ¹	Unit	Description	ND	STANDARD	SCH./PN	PACKAGE #	MTO#	MATERIAL	MANUFACTURER	MODEL	REMARKS	
	PIPING AND FITTING TABLE												
2021-06-30	260	m	STEEL PIPING	Ø150mm	ASTM A333 GR.6	SCH. STD			CARBON STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	20	UNIT	WIELDING NECK FLANGE	Ø150mm	A350 GR. LF2	CL150			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	2	UNIT	BLIND FLANGE	Ø150mm	ASTM A420 GR.WPL6	CL150			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	19	UNIT	45° ELBOW BUTT WELD	Ø150mm	ASTM A420 GR.WPL6, BW	SCH. STD			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	4	UNIT	90° LONG RADIUS ELBOW BUTT WELD	Ø150mm	ASTM A420 GR.WPL6, BW	SCH. STD			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	5	UNIT	STRAIGHT TEE BUTT WELD	Ø150mm	ASTM A420 GR.WPL6, BW	SCH. STD			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	2	UNIT	WELDED 45° LATERAL BUTT WELD	Ø150mm	ASTM A420 GR.WPL6, BW	SCH. STD			FORGED STEEL	14		SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
		UNIT	FLEXIBLE HOSE, 350 mm Lg.	Ø150mm	FLANGED	CL150			STAINLESS STEEL	SENIOR FLEXTRONICS	SA-BSFS SERIES		
2021-06-30	1	UNIT	FLEXIBLE HOSE, 450 mm Lg.	Ø150mm	FLANGED	CL150			STAINLESS STEEL	SENIOR FLEXTRONICS	SA-BSFS SERIES		
2021-06-30	6	UNIT	ECCENTRIC REDUCER BUTT WELD	Ø150x100mm	ASTM A420 GR.WPL6, BW	SCH. STD			CARBON STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	6	UNIT	BLIND FLANGE	Ø100mm	ASTM A420 GR.WPL6	CL150			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	10	UNIT	WIELDING NECK FLANGE	Ø100mm	A350 GR. LF2	CL150			FORGED STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	3	UNIT	THREADOLET FOR Ø150mm PIPE	Ø25mm	ASTM A350 GR.LF2	CL3000			FORGED STEEL				
2021-06-30	2	m	PIPING	Ø25mm	ASTM A333 GR.6	SCH. 80			CARBON STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. YELLOW	
2021-06-30	3	UNIT	SCREW CAP	Ø25mm	FORGED STEEL	CL3000			FORGED STEEL				
2021-06-30	22	UNIT	FLEXIBLE BRAID	-		-				NVENT	MBJ 35-250-25		
					P	PIPING AND SUPPO	RT TABLE						
2021-06-30	12	UNIT	TYPE 1 PREFAB PIPING SUPPORT ON DRAWING 61-740-270-XXX	-	HSS G40 350 W OR ASTM A500	-			STRUCTURAL STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. GREY	
2021-06-30	43	UNIT	TYPE 2 PREFAB PIPING SUPPORT ON DRAWING 61-740-270-XXX	-	HSS G40 350 W OR ASTM A500	-			STRUCTURAL STEEL			SHOP PAINTED AS PER 60-000-245-GGD-001. GREY	
2021-06-30	4	UNIT	TYPE 3 PREFAB PIPING SUPPORT ON DRAWING 61-740-270-XXX	-	HSS G40 350 W OR ASTM A500	-			STRUCTURAL STEEL	,		SHOP PAINTED AS PER 60-000-245-GGD-001. GREY	
2021-06-30	15	UNIT	EXTRA GREY PAINT GALLONS	-	15.	-			-			FOR PAINT TOUCH-UP ON SITE	
2021-06-30	10	UNIT	EXTRA YELLOW PAINT GALLON	-	5 - 2	-			-			FOR PAINT TOUCH-UP ON SITE	
						VALVE TAB	LE						
											Company of the Compan		
2021-06-30	7	UNIT	GATE VALVE	Ø150mm	ASTM A-352, FLANGED	CL150			LCC	BERIC	API 600, LCC BODY		
2021-06-30	3	UNIT	BALL VALVE API 607	Ø25mm	SOCKET WELD				LCC	APOLLO	83L-240-24 SERIES		

¹ No contingency was planned on material take off list and no material was planned for field adjustment.

Roxere Lawie 13940 2011-06-30

