



AGNICO EAGLE

MEADOWBANK COMPLEX

Monitoring Program Summary Report

May 2026

Type A Water License 2AM-MEA1530

Table of Contents

- SECTION 1 • BACKGROUND 3**
- SECTION 2 • WATER MANAGEMENT..... 4**
 - 2.1 WATER USAGE4
 - 2.2 WASTE ROCK STORAGE FACILITY SEEPAGE4
 - 2.3 CENTRAL DIKE SEEPAGE.....4
 - 2.4 ASSAY ROAD SEEPAGE.....4
 - 2.5 SEEPAGE AND RUNOFF FROM THE LANDFILL4
 - 2.6 SEWAGE TREATMENT PLANT4
 - 2.7 VAULT ATTENUATION POND EFFLUENT.....6
 - 2.8 PHASER ATTENUATION POND6
 - 2.9 EAST DIKE SEEPAGE EFFLUENT6
 - 2.10 NON-CONTACT WATER.....6
 - 2.11 IN-PIT DISPOSAL6
- SECTION 3 • SPILL MANAGEMENT 7**
 - 3.1 KM 87 SPILL FOLLOW UP8

SECTION 1 • BACKGROUND

On June 13, 2020, Agnico Eagle received the minister's approval for the Water License 2AM-MEA1530 Amendment No.4. This amendment was required to authorize changes to the previously approved uses of water and deposit of wastes needed to reflect the expansion of the Whale Tail Mine.

As required under Part I, Item 21 of Type A Water License 2AM-MEA1530 (Amendment No.4), this report documents the water management and monitoring activities at the mine site for the month. This includes water usage, Vault Attenuation Pond and Phaser Attenuation Pond discharge, East Dike Seepage discharge water quality, RSF Seepage, Central Dike Seepage, Assay Road Seepage, sewage treatment plant discharge water quality (which is directed to the onsite stormwater management pond), an update to the In-Pit disposal and follow up to the AWAR spill at KM 87.

In addition, a summary of spills/actions for the month is reported.

SECTION 2 • WATER MANAGEMENT

2.1 WATER USAGE

Freshwater usage for the month is summarized in Table 2.1 below.

Table 2.1: Freshwater Usage (m³)

Water Location	Source Lake	Jan	Feb	Mar	Apr	May	Total
Camp	Third Portage Lake	2,737	2,572	2,734	2,695	2,801	13,539
Mill (freshwater tank)	Third Portage Lake	50,779	45,698	46,833	27,401	34,260	204,971
Emulsion plant	Unnamed Lake	0	0	0	0	0	0
Total Freshwater Usage (m³)		53,516	48,270	49,567	30,096	37,061	218,510
Ore Water (m³)	Ore	4,660	3,613	3,611	2,957	3,551	18,393
Reclaim Water Usage (m³)	Tailings Pond	217,843	198,127	213,719	179,584	192,690	1,001,963

2.2 WASTE ROCK STORAGE FACILITY SEEPAGE

In May, water from WEP-1 and WEP-2 sumps was transferred to the ST-16 Sump. A total of 19,452 m³ was pumped back to Portage Pit from the ST-16 sump.

Agnico Eagle completed inspections at the Portage and Vault RSFs, no non-conformities were found during the month.

2.3 CENTRAL DIKE SEEPAGE

In May, 9,684 m³ of water was pumped from ST-S-5 sump to Portage Pit.

Sampling was conducted on a monthly basis at ST-S-5 as per the requirements of the NWB Water License.

Visual inspections are completed monthly, by the Environment Department, as well as daily monitoring of piezometric values.

2.4 ASSAY ROAD SEEPAGE

In May, 8,250 m³ of water was pumped from the mill trench back to the mill. Routine monitoring and inspections occurred during the month.

2.5 SEEPAGE AND RUNOFF FROM THE LANDFILL

The landfill was inspected weekly, and no seepage or runoff was observed.

2.6 SEWAGE TREATMENT PLANT

One (1) effluent wastewater sample was collected at the onsite sewage treatment plant (STP) in May. The Seprotech STP results are shown in Table 2.6.1 below; the LJ-Mix STP results are

shown in Table 2.6.2. The effluent from the STP is discharged to the Stormwater Management Pond.

In May, 13,113 m³ of water was pumped from the Stormwater Management Pond to Portage Pits.

Table 2.6.1: Seprotech Effluent Results

Parameters	Units	5/4/2026
Unionized Ammonia (NH ₃)	mg N/L	0.32
Ammonia-Nitrogen (NH ₃ -NH ₄)	mg N/L	48
Total Kjeldahl Nitrogen	mg N/L	46
BOD-5	mg/L	9
COD	mg/L	54
Total Suspended Solids	mg/L	8
Nitrate	mg N/L	2.83
Nitrite	mg N/L	2.13
pH*	Units	7.10
Fecal Coliform	UFC/100 mL	20
Total Coliform	UFC/100 mL	270

*Parameter measured by STP operators

Table 2.6.2: LJ-Mix Effluent Results

Parameters	Units	5/4/2026
Unionized Ammonia (NH ₃)	mg N/L	0.063
Ammonia-Nitrogen (NH ₃ -NH ₄)	mg N/L	41
Total Kjeldahl Nitrogen	mg N/L	53
BOD-5	mg/L	44
COD	mg/L	120
Total Suspended Solids	mg/L	11
Nitrate	mg N/L	2.35
Nitrite	mg N/L	16.1
pH*	Units	6.50
Fecal Coliform	UFC/100 mL	10,000
Total Coliform	UFC/100 mL	18,000

*Parameter measured by STP operators

2.7 VAULT ATTENUATION POND EFFLUENT

No discharge has occurred from the Vault Attenuation Pond to Wally Lake during the month.

2.8 PHASER ATTENUATION POND

No water was pumped from the Phaser Attenuation Pond during the month.

No water was transferred from BB Phaser Pit sumps to the Phaser Attenuation Pond during the month.

2.9 EAST DIKE SEEPAGE EFFLUENT

No water was discharged from the East Dike seepage to Second Portage Lake during the month. In May, water from the East Dike seepage was discharged into Portage Pits.

2.10 NON-CONTACT WATER

Portage Area East diversion ditch (ST-5) and West diversion ditch (ST-6) were not sampled in May due to the diversion ditches due to frozen conditions. Sampling is conducted during open water conditions.

2.11 IN-PIT DISPOSAL

Tailings were disposed of in Portage Pits and reclaim water was taken from Portage Pits for the month.

SECTION 3 • SPILL MANAGEMENT

Figure 3.1 shows reported and non-reported spills for 2026 broken down per month, and Table 3.1 summarizes Agnico Eagle spill reports for May.

Six (6) spills occurred on site during the month with one (1) reported to regulators. Spills were contained and cleaned, contaminated material was disposed of in the appropriate area, and the clean-up actions were monitored closely by the Environment Department. There were no off-site impacts to any watercourses.

Figure 3.1 2026 Reported and Non-Reported Spills

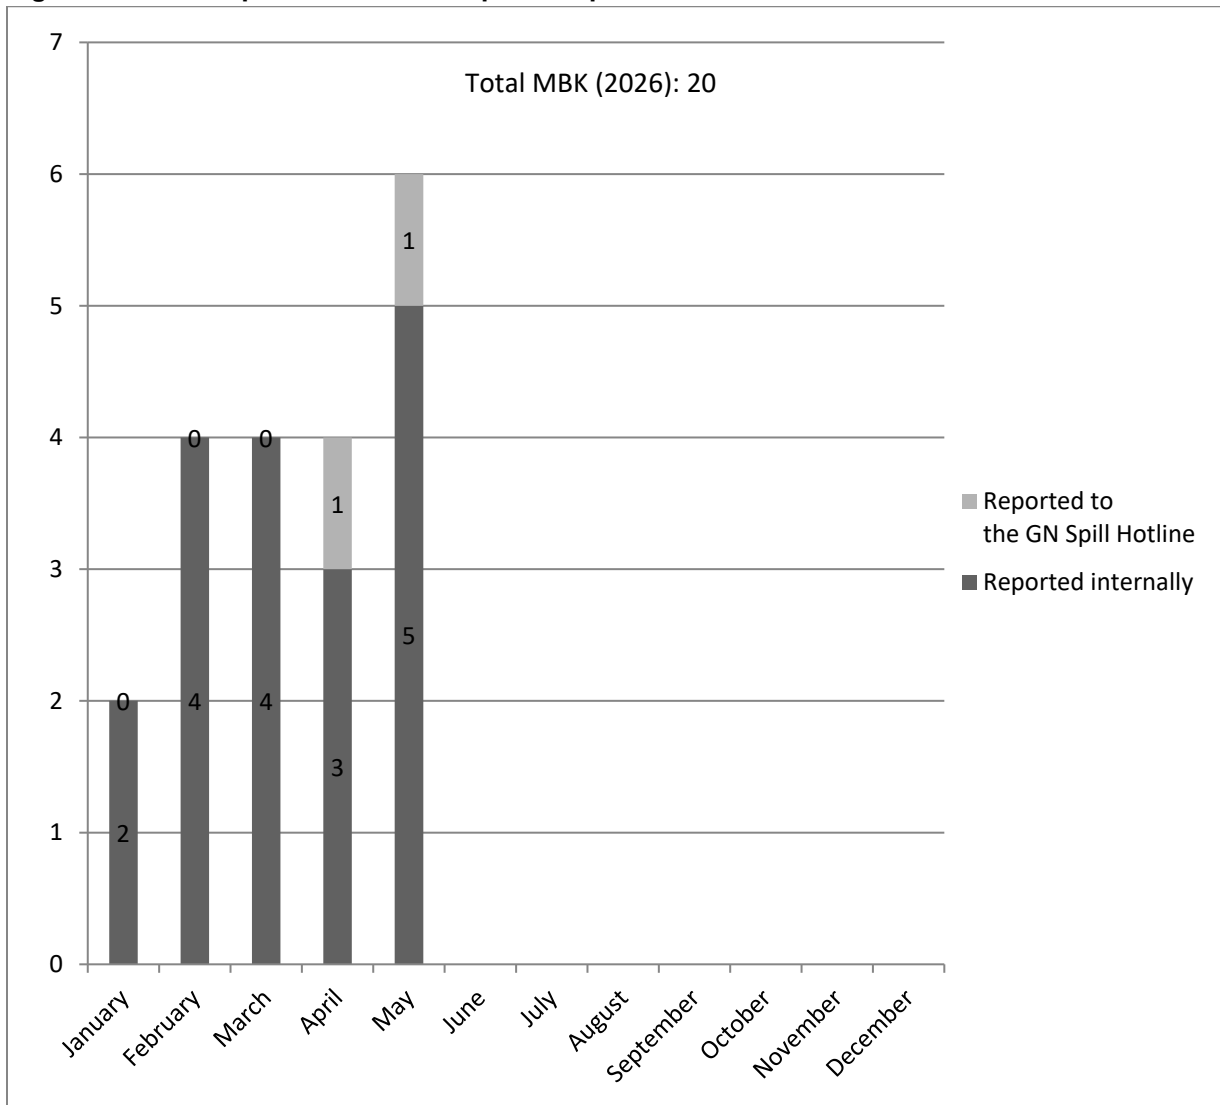


Table 3.1: Summary of Agnico Eagle Internal and Reported Spill Reports, May 2026

Date of Spill	Hazardous Material	Quantity	Units	Location	Cause of spill	Clean-up action taken
5/10/2026	Diesel Fuel	5	L	Fuel Farm	Equipment malfunction	Contaminated water was collected and disposed of adequately.
5/10/2026	Diesel Fuel	5	L	Fuel Farm	Equipment malfunction	Contaminated water was collected and disposed of adequately.
5/10/2026	Hydraulic Oil	30	L	Winter Parking	Equipment failure	Contaminated soil was collected and disposed of at the Meadowbank Landfarm.
5/14/2026	Engine Oil	10	L	Winter Parking	Equipment malfunction	Contaminated soil was collected and disposed of at the Meadowbank Landfarm. Used spill pads were disposed of at the HazMat storage.
5/15/2026	Diesel Fuel	1	L	Mill	Equipment malfunction	Contaminated soil was collected and disposed of in the yellow bin. Used spill pads were disposed of at the HazMat storage.
5/18/2026	Diesel Fuel	100	L	Fuel Farm	Human error	~2m ³ of contaminated soil material was collected and sent to the landfarm for treatment. Absorbent material was brought to the Hazmat for segregation.

3.1 KM 87 SPILL FOLLOW UP

In May, Agnico Eagle completed inspections at KM87 spill areas. No samples were collected during the month due to frozen conditions.