


E337697-PM401-50-042-0015_SUB04

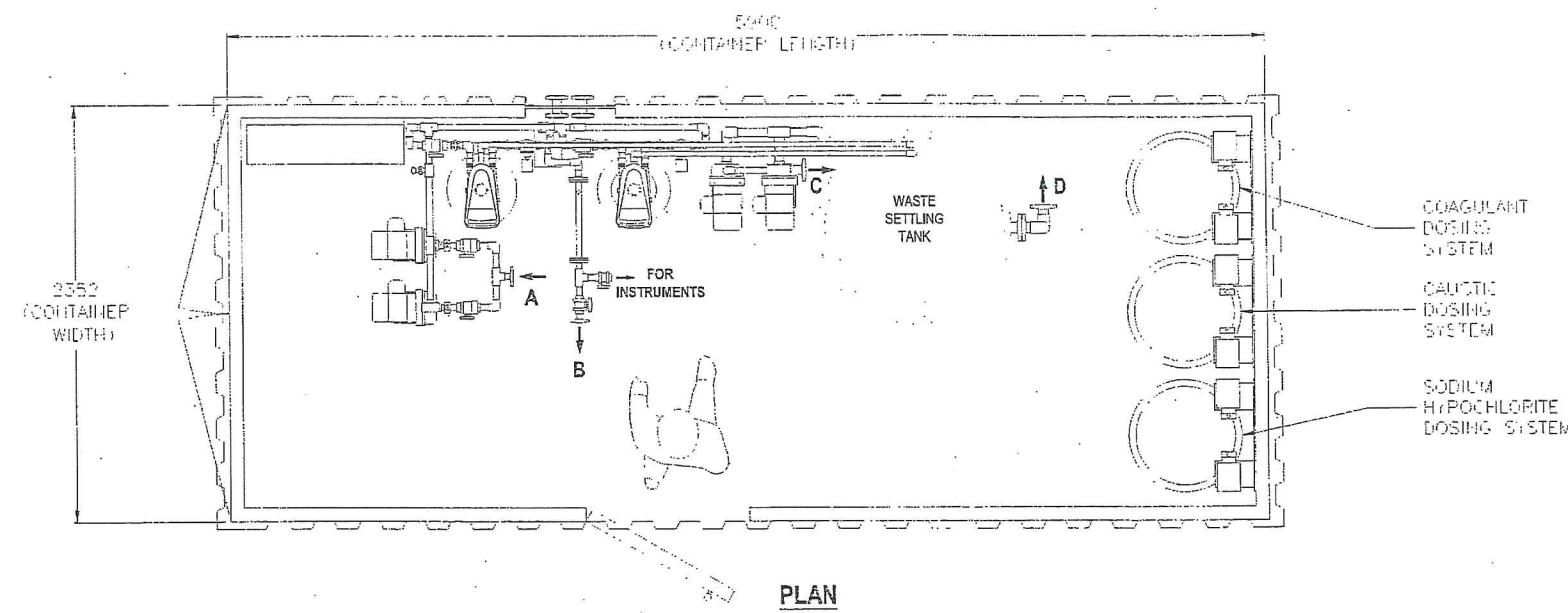


NOTES:

1. ALL DIMENSIONS ARE IN MM IF NOT OTHERWISE SPECIFIED.
2. MEDIA FILTER VESSELS ARE MADE OF FRP.
3. CHEMICAL TANKS AND WASTE SETTLING TANKS ARE MADE OF POLYETHYLENE.
3. ALL CONNECTING PIPING AND FITTINGS ARE SCH.80 PVC.
4. ALL COMPONENTS ARE PRE-ASSEMBLED INTO 20 FT CONTAINER.
5. SOME INSTRUMENTS AND PIPING SUPPORTING ARE NOT SHOWN FOR CLARITY.

DENOTATION:

- A: RAW WATER INLET (1" 150# FLANGE)
B: TREATED WATER OUTLET (1" 150# FLANGE)
C: SUPERNATANT TO RAW WATER STRAGE (1.5" 150# FLANGE)
D: WASTE WATER TO DRAIN (2" 150# FLANGE)

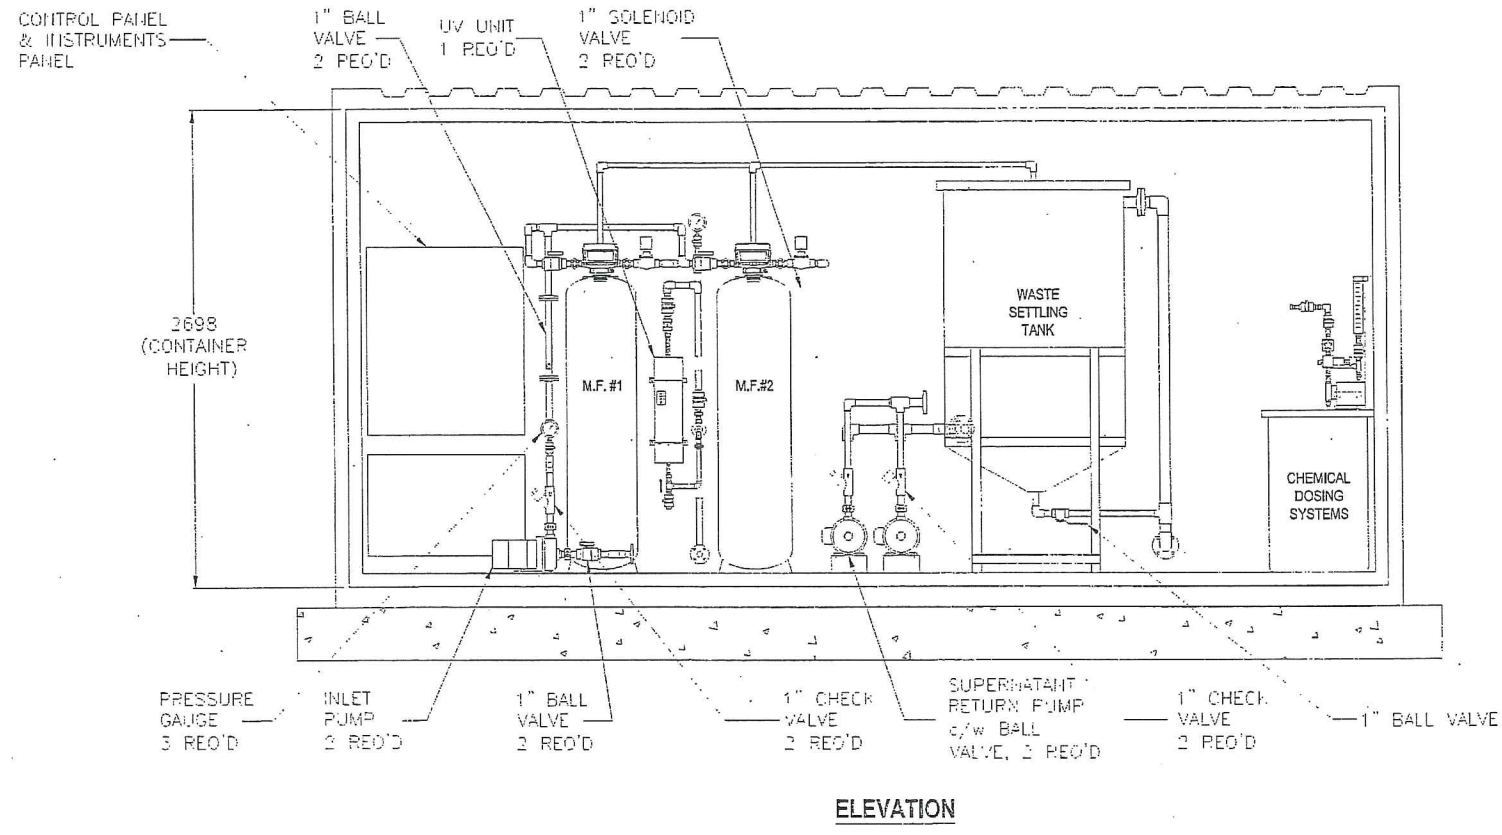

00 ISSUED FOR APPROVAL		12/09/2011	W.D.	Y.L.	P.L.
REV	DESCRIPTION	DD / MM / YYYY	DESIG	CHEC	APPR
REVISION HISTORY					
Since 1950 RI NAPIER-REID TORONTO CANADA			COCKBURN LAKE TUNNEL DESIGN FLOW RATE 34 M3/DAY MEDIA-FILTRATION SYSTEM GENERAL ARRANGEMENT		
CUSTOMER ARCELOR MITTAL	PROJECT MARY RIVER WTP, BAFF- INLAND, H337697-PM401	SCALE 1:17.5 OR AS NOTED	FILE NO.: 11-2930	SHEET 1 OF 1	
CONTRACTOR	CONSULTING ENGINEER HTACH LIMITED	DWG. NO.: 11-2930-PVWTP7-01S	DESIGN DATE: Sep. 12, 2011	VERSION	
THIRD ANGLE			PLOT DATE: Sep. 12, 2011	R 00	

THIS DOCUMENT EMBODIES DESIGNS AND INFORMATION PROPRIETARY TO NAPIER-REID LTD. IT IS TO BE USED ONLY FOR THE PURPOSE AND BY THE ENTITY FOR WHICH IT WAS ORIGINALLY SUPPLIED. THE DOCUMENT MAY NOT BE DUPLICATED, DISCLOSED TO ANY OTHER PERSON OR ENTITY, OR USED FOR MANUFACTURE OF THE ITEM IN PART OR IN WHOLE WITHOUT THE PRIOR WRITTEN PERMISSION OF NAPIER-REID LTD.

Napier Reid

Sep 13 2011 14:52

P007/008