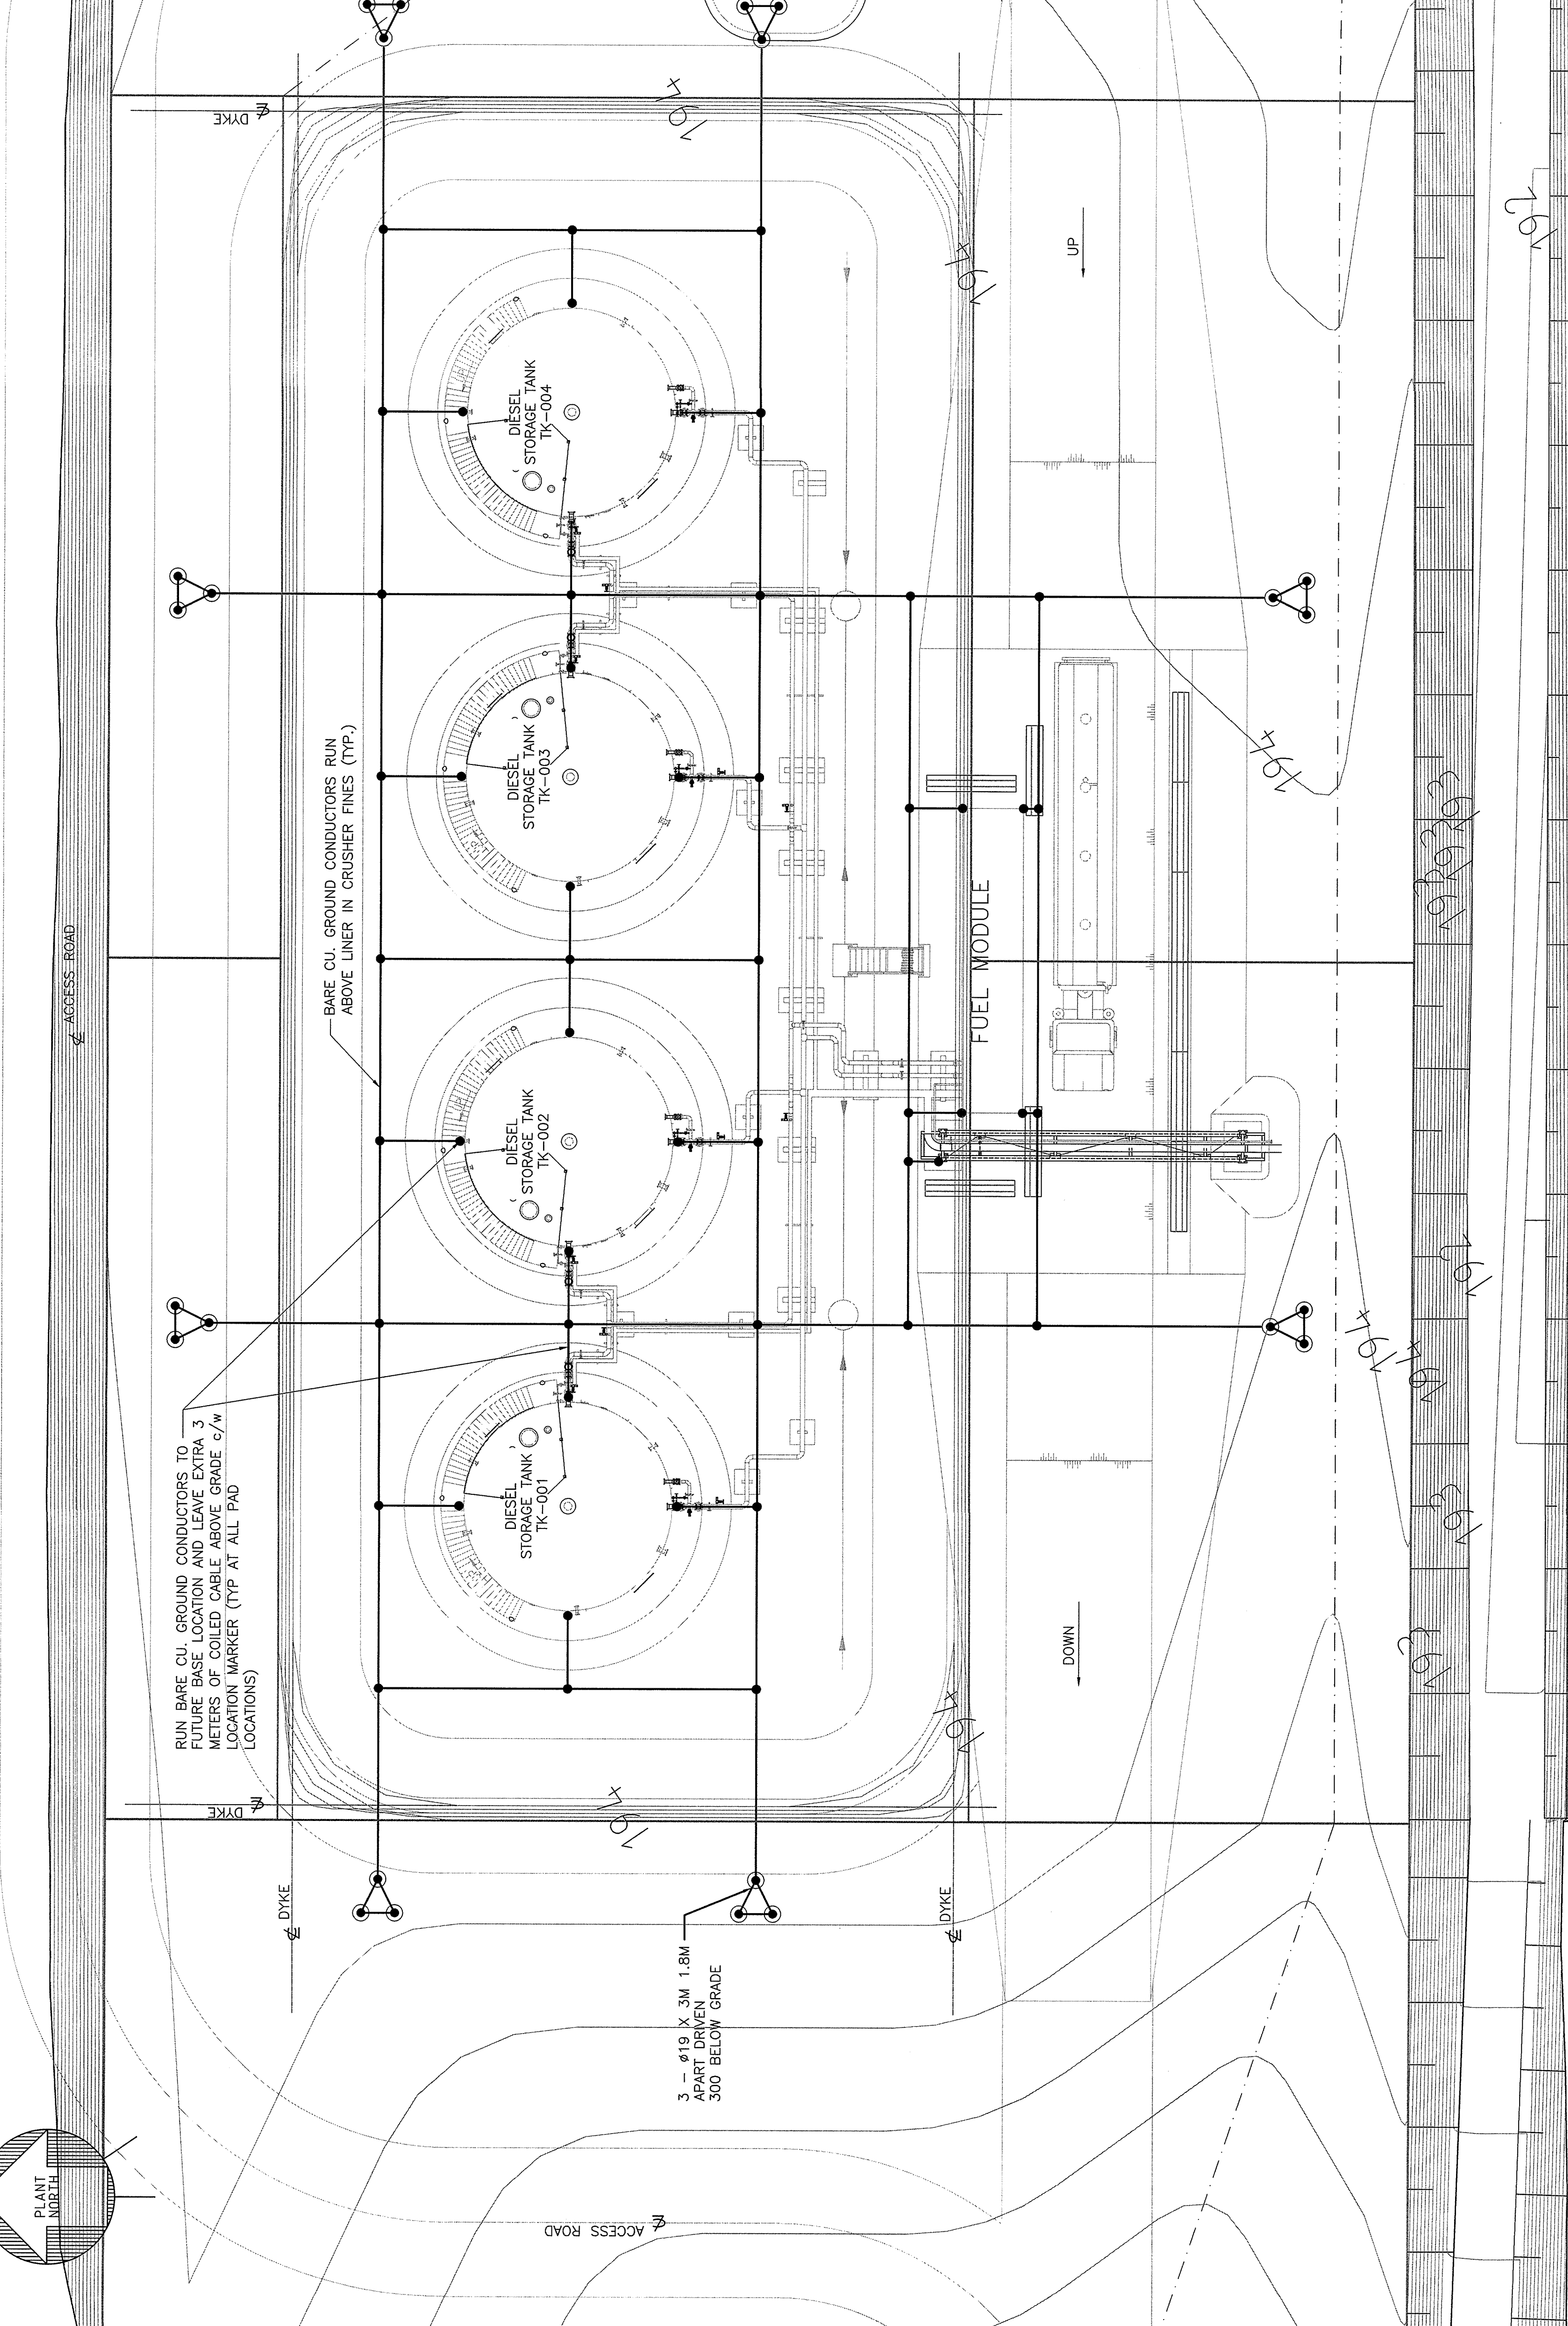
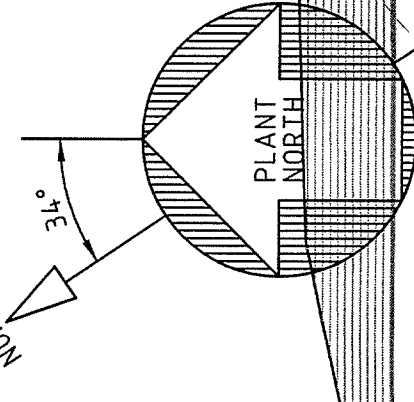


NOTES:

1. TIE CABLE TRAY GROUND TO BURIED GROUNDING CONDUCTOR AT EVERY THIRD SUPPORT.

- () — COPPER CLAD GROUND ROD 19 ϕ X 3M DRIVEN 300 BELOW GRADE
- — BOLTED COMPRESSION OR MECHANICAL CONNECTION
- — BURIED GROUND CONDUCTOR 2/0 AWG BARE CU.

[illegible]