

# PRICE CENTRIFUGAL PUMP CAUTIONS & WARNINGS

- CAUTION: Price Pump centrifugal pumps must be operated above minimum flow rate to avoid damage.
- CAUTION: All Price Pump centrifugal pumps require the suction to be flooded.
- CAUTION: It is recommended that all piping connections to the pump be flexible.
- WARNNING: Verify chemical compatibility of the pump materials of construction with the fluid being pumped.
- WARNNING: Price centrifugal pumps are not designed for use in sanitary or food applications.
- CAUTION: Use only Price Pump original equipment factory replacement parts.
- WARNNING: Price pump fluid temperature limits must be observed. Maximum operating temperature is 300°F.
- CAUTION: The pump should be thoroughly flushed and drained before disassembly.
- CAUTION: For larger pump motor units, weight may exceed 65 1bs. (30 kg).

# CAUTION: Maximum working pressure for seals:

0	Type 6 Seal	75 PSI (5.2 bar)
0	Type 6A Seal	75 PSI (5.2 bar)
0	Type 8 Seal	<b>325 PSI</b> (22.4 bar)
0	Type 9 Seal	350 PSI (24.1 bar)
0	Type 21 Seal	150 PSI (10.3 bar)
0	Type 2106 Seal	150 PSI (10.3 bar)

# CAUTION: Maximum solid size by pump

0	HP75 / MS50	<b>0.030</b> " (0.76 m m)
0	SP150	<b>0.060</b> " (1.50 m m)
0	LT25	<b>0.120</b> " (3.05 m m)
0	F 50/75/95	<b>0.150</b> " (3.81 m m)
0	OH75	<b>0.150</b> " (3.81 m m)
0	CD 100/150	<b>0.150</b> " (3.81 m m)
0	CL150	<b>0.150</b> " (3.81 m m)
0	RC200/300	<b>0.380</b> " (9.60 m m)
0	X J-J B 1 0 0	<b>0.120</b> " (3.05 m m)
0	X J-J B 1 5 0	<b>0.250</b> " (6.40 m m)
0	X J-J B 2 0 0	<b>0.440</b> " (11.2 m m)
0	XL-XT100	<b>0.120</b> " (3.05 m m)
0	XL-XT150	<b>0.250</b> " (6.40 m m)
0	XL-XT200	<b>0.440</b> " (11.2 m m)

0	HP75 / MS50	<b>0.5 GPM</b> (1.9 LPM)
0	SP150	10 GPM (38 LPM)
0	LT25	<b>0.5 GPM</b> (1.9 LPM)
0	F 5 0/7 5/95	<b>5.0 GPM</b> (19 LPM)
0	OH 75	7.0 GPM (26 LPM)
0	C D 1 00	12 GPM (45 LPM)
0	C D 1 50	25 GPM (94 LPM)
0	C L 1 5 0	<b>40 GPM</b> (150 LPM)
0	R C 2 0 0	10 GPM (38 LPM)
0	R C 3 0 0	<b>50 GPM</b> (189 LPM)
0	XJ-JB150	<b>20 GPM</b> (75 LPM)
0	XJ-JB150	<b>40 GPM</b> (150 LPM)
0	XJ-JB200	<b>90 GPM</b> (340 LPM)
0	X L-X T 100	10 GPM (38 LPM)
0	X L-X T 150	<b>35 GPM</b> (132 LPM)
0	X L-X T 200	<b>50 GPM</b> (189 LPM)



# GENERAL TERMS OF SALE FOR PRODUCTS

#### 1. GENERAL

A. Seller's price is based on these sales terms and conditions. The agreement and inclusion of other or amended terms in this contract will result in a change (including increase) in Seller's pric This contract be contained in any price books or quotations) to reflect such other or amended terms shall represent the final, complete and exclusive statement of the agreement between the parties and may not be modified, supplemented, explained or waived by parole evidence, any Terms and Conditions contained in Buyer's purchase order or request for quotation, any course of dealings between the parties, Seller's performance or delivery, or in any other way. The Terms and Conditions of this contract may only be modified or waived in a written document signed by an Officer of Seller. These terms are intended to cover all activity of Seller and Buyer hereunder, including sales and use of products, parts and work and all related matters (references to products include parts and references to work include construction, installation and start -up). Any reference by Seller to Buyer's specifications and similar requirements are only to describe the products and work covered hereby and no warranties or oth er terms therein shall have any force of effect. Any information provided by Seller including, but not limited to, suggestions as to specific equipment does not imply any guarantee of specific suitability and/or material compatibility in a particular appl since many factors outside the control of Seller may affect the suitability of products in a particular application. Catalogs, circulars, similar pamphlets and information contained on websites of the Seller are issued for general information pur poses only and shall not be deemed to modify the

B. The agreement formed hereby and the language herein shall be construed and enforced under the Uniform Commercial Code as in effect in the State of California on the date hereof.

Any sales, use or other similar type taxes imposed on this sale or on this transaction import or export duties or fees as may be assessed or imposed on or as a result of deliveries under this transaction are not included in the price . Such taxes shall be billed separately to the Buyer Seller will accept a valid exemption certificate from the Buyer if applicable; however, if an exemption certificate previously accepted is not recognized by the governmental taxing authority involved the Seller is required to pay the tax covered by such exemption certificate. Buyer agrees to promptly reimburse Seller for the taxes paid.

#### 3. PERFORMANCE, INSPECTION AND ACCEPTANCE

A. Unless Seller specifically assumes installation, construction or start-up responsibility, all products shall be finally inspected and accepted within thirty (30) days after arrival at point of delivery. Where seller has responsibility for installation, construction or start -up all work shall be finally inspected and accepted with thirty (30) days after completion of the applicable work by Seller. All claims whatsoever by Buyer, (including claims for shortages) except only those provided for under the WARRANTY AND LIMITATION OF LIABILITY and PATENTS Clauses, hereof, must be asserted in writing by Buyer within said thirty (30) day period or they are waived. If this contract involves partial performance, all such claims must be asserted within said thirty - (30) day period for each partial performance. There shall be no revocation of acceptance. Rejection may be only for defects substantially impairing the value of products or work and Buyer's remedy for lesser defects shall be those provided for under the WARRANTY AND LIMITATION OF LIABILITY Clause.

B. Seller shall not be responsible for non -performance or for delays in performance occasioned by any causes beyond Seller's reasonable control, including, by way of example and not limitation, to labor difficulties, delays of vendors or carriers, fires, governmental act ions, or shortages of material, components, labor, or manufacturing facilities. Any delays so occasioned shall affect a corresponding extension of Seller's performance dates, which are, in any event, understood to be approximate. IN NO EVENT SHALL BUYER BE ENTITLED TO INCIDENTAL OR CONSEQUENTIAL DAMAGES FOR LATE PERFORMANCE OR FOR A FAILURE TO PERFORM. Seller reserves the right to make partial shipments and to ship products, parts or work which may be completed prior to the scheduled performance date.

C. In the event that Seller has agreed to mount motors, turbines, gears, or other products which are not manufactured by Seller and which are not an integral part of Seller's manufactured product, and a delay in the delivery of such products to Seller occ urs that will cause a delay in Seller's performance date, Seller reserves the right to ship its product upon completion of manufacture and to refund an equitable portion of the amount originally included in the purchase price for mounting without incurring liability for non -performance.

D. Seller reserves to itself the right to change its specifications, drawings and standards if such changes will not impair the performance of its products, and parts, and further those products, and parts, will meet any of Buyer's specifications and other specific product requirements which are a part of this agreement. Seller is a global supplier of products and utilizes parts and products obtained worldwide, and Seller's products supplied under this contract shall be s ubject to Seller's sole determination as to all manufacturing, sourcing, assembly and supply unless otherwise specifically

E. The manufacture and inspection of products and parts shall be to Seller's Engineering and Quality Assurance st andards, plus such other inspections or tests of documentation as are specifically agreed to by Seller. Requirements for any additional inspection, tests, documentation, or Buyer witness of manufacture, test, and/or inspection shall be subject to addition

#### 4. TITLE AND RISK OF LOSS

Title and risk of loss shall pass to buyer upon delivery of products at the designated "Ex Works" as defined by Incoterms, unless other wise agreed by the parties.

## 5. EROSION AND CORROSION

It is specifically under stood that products and parts sold hereunder are not warranted for operation with erosive or corrosive fluids or for operation with any fluid or under any operating condition in variance with the specifications of this contract. No product or part shall be deemed to be defective by reason of failure to resist erosive or corrosive action of any fluid and Buyer shall have no claim whatsoever against Seller therefore. No product shall be deemed defective by reason of any effect on Seller's products of the action or results (such as vibration) of any goods or system (such as piping) not supplied by Seller.

#### 6. BUYER'S RESPONSIBILITY

The design specifications of the equipment require the operation of the equipment within certain parameters and m ay call for the use of speed controls, safety devices, set points or other control devices to insure that the operation remains within design parameters. Buyer agrees and understands that the equipment must be operated and maintained within design specific ations and operated within the specifications of the contract, irrespective of whether controls or devices are otherwise required. 7. WARRANTY AND LIMITATION OF LIABILITY.

A. Seller warrants only that its product and parts, when shipped, will be free fr om defects in materials and workmanship. All claims for defective products or parts under this warranty must be made in writing immediately upon discovery and, in any event, within two (2) years of shipment by seller and all claims for defective work must be made in writing immediately upon discovery. Defective items must be held for Seller's inspection and returned to the sellers' point of original shipment upon request.

ANY UNAUTHORIZED DISSASSEMBLY, ALTERATION OF OR TAMPERING WITH ANY PRODUCT OR COMPONENT MAY "VOID" THE WARRANTY, IN THAT SUCH ACTION WILL RESULT IN SELLER BEING RELEASED AND RELIEVED FROM ITS OBLIGATIONS UNDER THIS WARRANTY AND FOR ANY FURTHER COSTS OR ACTIONS UNDER CLAUSE 7.C, FOLLOWING, AND THE BUYER ASSUMING SOLE RESPONSIBILITY FOR THE COSTS AND RESULTS OF SUCH ACTION. THE FOREGOING IS EXPRESSLY IN LIEU OF ALL OTHER WARRANTIES WHATSOEVER, EXPRESS, IMPLIED AND STATUTORY, INCLUDING WITHOUT LIMITATION, THE IMPLIED, WARRANTIES OF MERCHANTABILITY AND FITNESS.

B. ANY PRODUCT (S) SOLD HEREU NDER WHICH ARE NOT MANUFACTURED BY SELLER ARE NOT WARRANTED BY SELLER and shall be covered only by the express warranty, if any, of the manufacturer thereof. With respect to products and parts not manufactured by Seller, Seller's only obligation shall be to assign to Buyer, to the extent possible, whatever warranty Seller obtains from the manufacturer

C. Upon Buyer's submission of a claim as provided above and its substantiation, Seller shall at its option either (i) repair or replace its product, part o r work at the original place of shipment, or (ii) refund an equitable portion of the purchase price

D. THE FOREGOING IS SELLER'S ONLY OBLIGATION AND BUYER'S EXCLUSIVE REMEDY FOR BREACH OF WARRANTY AND, EXCEPT FOR THE REMEDIES PERMITTED UNDER THE PERFORMANCE, INSPECTION AND ACCEPTANCE AND THE PATENTS CLAUSES HEREOF, THE FOREGOING IS BUYER EXCLUSIVE REMEDY AGAINST SELLER FOR ALL CLAIMS ARISING HEREUNDER OR RELATING HERETO WHETHER SUCH CLAIMS ARE BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE OR S TRICT LIABILITY), INDEMNITY OR OTHER THEORIES. BUYER'S FAILURE TO SUBMIT A CLAIM AS PROVIDED ABOVE SHALL SPECIFICALLY WAIVE ALL CLAIMS FOR DAMAGES OR OTHER RELIEF, INCLUDING BUT NOT LIMITED TO CLAIMS BASED ON LATENT DEFECTS. IN NO EVENT SHALL BUYER BE EN TITLED TO INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES, NOR FOR DAMAGES FOR LOSS OF USE, LOST PROFITS OR REVENUE, INTEREST, LOST GOODWILL, WORK OR PRODUCTION STOPPAGE, IMPAIRMENT OF OTHER GOODS, INCREASED EXPENSES OF OPERATION, OR THE COST OF PURCHASING REPLACEMENT POWER OR OTHER SERVICES BECAUSE OF SERVICE INTERRUPTIONS. FURTHERMORE, IN NO EVENT SHALL SELLER'S TOTAL LIABILITY FOR DAMAGES OF BUYER EXCEED THE PURCHASE PRICE OF THE PRODUCTS OR PARTS MANUFACTURED BY SELLER AND UPON WHICH SUCH LIABIL ITY IS BASED. ANY ACTION ARISING HEREUNDER RELATED HERETO, WHETHER BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE) OR OTHER THEORIES, MUST BE COMMENCED WITHIN ONE (1) YEAR AFTER THE CAUSE OF ACTION ACCRUES OR IT SHALL BE BARRED.

#### 8. PURCHASER'S R EPRESENTATIONS & WARRANTIES

Purchaser represents and warranties that the products(s) covered by this contract shall not be used in or in connection with a nuclear facility or application. The parties agree that this representation and warranty is material and is being relied on by seller. This provision may be modified in a separate writing signed by an officer of Price Pump Co.

Seller agrees to assume the defense of any suit for infringement of any patents brought against Buyer to the extent of such suit charges infringement of an apparatus or product claim by Seller's product in and of itself, provided (i) said product is built entirely to Seller's design, (ii) Buyer notifies Seller in writing of the filing of such suit within ten (10) days a fler the service of process thereof, and (iii) Seller is given complete control of the defense of such suit, including the right to defend, settle and make changes in the product for the purpose of avoiding infringement of any process or method claims. Pr ovided however, Seller will not defend any suit for infringement of a claimed patent where such alleged infringement is the result of following specific instruction furnished by Seller.

10. EXTENT OF SUPPLY

Only products as listed in Seller's proposal are included in this agreement. It must not be assumed that Seller has included anything beyond same.

#### 11. MANUFACTURING SOURCES

To maintain delivery schedules, Seller reserves the right to have all or any part of the Buyer's order manufactured at an y of Sellers', sellers' licensees or sub contractors' plants, globally.

#### 12. TERMS OF PAYMENT

Net 30 days from date of invoice


#### 13. ARBITRATION

In the event a dispute arises between the parties relating to or arising out of this agreement, the parties agree to attempt to have their senior management amicably settle the matter. In the event that the matter cannot be settled, the parties shall submit all disputes relating to this Agreement (whether contract, tort, products liability or otherwise) to bind ing Arbitration before a panel of arbitrators under the Commercial Dispute Resolution Procedures of the American Arbitration Association. Each party shall appoint an arbitrator and the third shall be selected in accordance with the rules of the American A Association. Judgment upon the award may be entered in any court having jurisdiction. The parties shall cooperate in providing reasonable disclosure of relevant documents. Each party shall bear its own expenses, and the costs and fees of the ar bitration shall be borne as allocated by the Arbitrator.

Price® Pump Company, 21775 Eighth St. East, Sonoma, CA 95476 USA Effective June 2007



# Operating instructions Solenoid Metering Pump Beta® b BT4b and BT5b

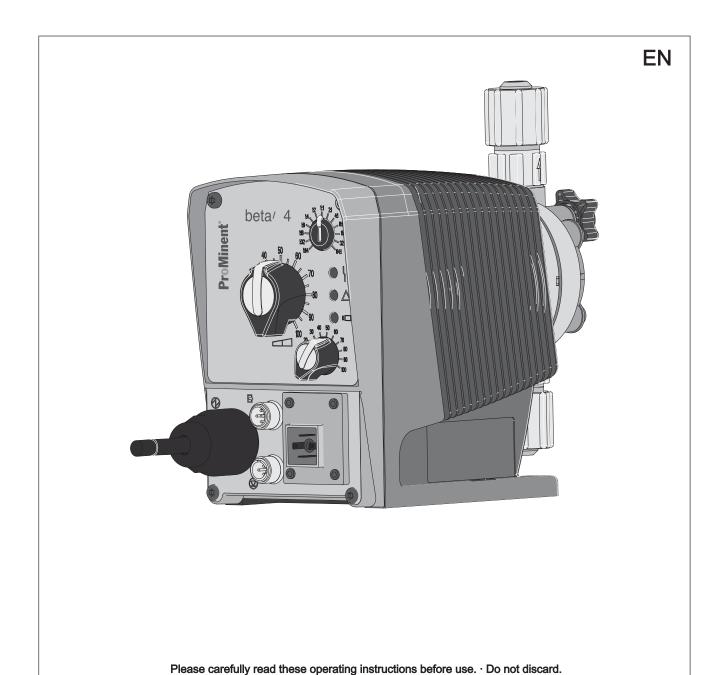

Original Operating Instructions (2006/42/EC)

The operator shall be liable for any damage caused by installation or operating errors.

The latest version of the operating instructions are available on our homepage.

#### Supplementary information



Fig. 1: Please read!

Read the following supplementary information in its entirety! You will benefit more from using the operating instructions should you already know this information.

The following are highlighted separately in the document:

Enumerated lists



Instructions

- ⇒ Outcome of the instructions
- § 'State the identity code and serial number' on page 2: Links to points in this chapter
- refer to ... : References to points in this document or another document

[Keys]

#### Information



This provides important information relating to the correct operation of the unit or is intended to make your work easier.

#### Safety Information

Safety information is identified by pictograms - see Safety Chapter.

Validity

These operating instructions conform to current EU regulations applicable at the time of publication.

State the identity code and serial number

Please state identity code and serial number, which you can find on the nameplate when you contact us or order spare parts. This enables us to clearly identify the unit type and material versions.



# Table of contents

1	Identity code	(
2	About this pump	7
3	Safety Chapter	8
4	Storage, Transport and Unpacking	13
5	Overview of Equipment and Control Elements	14
	5.1 Overview of Equipment	14
	5.2 Control Elements	15
	5.2.1 Pulse control switch	
	5.2.2 Stroke Length Adjustment Button	
	5.2.3 Multifunctional Switch	
	5.2.4 Functional and Fault Indicators	
	5.2.5 "External control" terminal	
	5.2.6 "Level switch" terminal	
6	Functional description	
	6.1 Liquid End	
	6.2 Drive Unit	
	6.3 Capacity	
	6.4 Self-Bleeding	
	6.5 Operating modes	
	6.6 Functions	
	6.7 Relay	18
	6.8 Hierarchy of Operating Modes, Functions and Fault Statuses	18
7	Assembly	
8	Installation, hydraulic	
0	8.1 Installing hose lines	
	8.1.1 Installation of Metering Pumps Without Bleed Valve	
	8.1.2 Installation of Metering Pumps With Bleed Valve	
	8.1.3 Installation of Metering Pumps With Self-bleeding (SEK	۷.
	Type)	24
	8.1.4 Basic installation notes	2
9	Electrical Installation	27
	9.1 Supply voltage connector	28
	9.1.1 Mains voltage	28
	9.2 Supply voltage connector - low voltage	
	9.3 Description of the Terminals	
	9.3.1 "External control" terminal	
	9.3.2 "Level switch" terminal	
	9.4 Relay	
	9.4.1 Relay functions	
	9.4.2 "Fault indicating relay" output (identity code 1 + 3)	32
	9.4.3 "Fault indicating relay" + "Pacing relay" output (identity code 4 + 5)	33
10	Start up	
11	Operation	
• •	11.1 Manual	
	11.1.1 Capacity	
	11.1.2 Functions	
	11.1.3 External contact	
	11.1.4 External analog	
	11.2 Remote operation	
12	Maintenance	40

# Table of contents

13	Repairs	42
	13.1 Cleaning valves	43
	13.2 Replacing the diaphragm	44
14	Troubleshooting	47
	14.1 Faults without a fault message	47
	14.2 Fault messages	48
	14.3 Warning messages	48
	14.4 All Other Faults	48
15	Decommissioning	49
16	Technical data	5
	16.1 Performance data	5
	16.2 Accuracy	53
	16.2.1 Standard Liquid End	53
	16.2.2 Self-Bleeding Liquid End	53
	16.3 Viscosity	53
	16.4 Material Data	54
	16.5 Electrical data	54
	16.6 Temperatures	56
	16.7 Climate	
	16.8 Degree of Protection and Safety Requirements	5
	16.9 Compatibility	5
	16.10 Sound pressure level	57
	16.11 Shipping weight	57
17	Dimensional drawings	58
18	Diagrams for setting the metering capacity	64
19	Exploded Views of Liquid Ends	70
20	Further order information	. 107
21	EC Declaration of Conformity for Machinery	. 109
22	EC Declaration of Conformity for Machinery	. 110
00	In day.	44.



# 1 Identity code

Produc	ct range	Beta	b									
BT4b	Туре	Capacity										
		bar	l/h									
	1000	10	0.74	4								
	1601	16	1.10									
	1602	16	2.20									
	1604	16	3.60									
	0708	7	7.10									
	0413	4	12.30	0								
	0220	2	19.00	0								
BT5b												
	2504	25	2.90									
	1008	10	6.80									
	0713	7	11.00	0								
	0420	4	17.10	0								
	0232	2	32.00	0								
		Mate	erial of	dosi	ng head/valves							
		PP	Poly	propy	vlene/PVDF. With the self-bleeding version (SEK): polypropylene/polypropylene							
		NP	Clea	r acry	ylic/PVDF. With the self-bleeding version (SEK): Clear acrylic/PVC							
		PV	PVD	F/PV	F/PVDF							
		TT	PTF	E/PT	TFE							
		SS			s steel 1.4404/1.4404							
					of seals/diaphragm							
			Т		E/PTFE coated							
			Е	EPD	M/PTFE coated, only for PP and NP self-bleeding (SEK)							
			В		M-B/PTFE coated, only for PP and NP self-bleeding (SEK)							
			W	Diap	phragm additionally with FPM coating for media containing silicate							
				Dosi	ing head design							
				0	without bleed valve, without valve spring only for NP, TT, SS and type 0232							
				1	without bleed valve, with valve spring only for NP, TT, SS and type 0232							
				2	with bleed valve, without valve spring only for PP, PV, NP not for type 0232							
				3	with bleed valve, with valve spring only for PP, PV, NP not for type 0232							
				4	version for higher-viscous media only for PVT, type 1604, 2504, 0708, 1008, 0413, 0713, 0220, 0420							
				7	self-bleeding (SER) only for PV/NP, not for types 1000, 1601 and 0232							
				9	self-bleeding (SEK) only for PP/NP, not for types 1000 and 0232							
					Hydraulic connector							
					O Standard connection in line with technical data							
					5 Connector for 12/6 tube, discharge side only							
					9 Connector for 10/4 tube, discharge side only							

E-951

5

Product range Beta b									
	Desi	ign	ı						
	0	Star	Standard						
		Log	Logo						
		0	with	ProN	linent	logo			
			Elec	trical	conne	ections	;		
			U	100	230 V ± 10%, 50/60 Hz*				
				Cab	le and	plug			
				Α	2 m E	Europe	ean		
				В	2 m Swiss				
				С	2 m A	Austra	lian		
				D	2 m l	JSA			
				1	2 m c	open e	end		
					Relay	Relay			
					0	No re	elay		
					1				
					3				lay (NO) (change-over relay)
					4				ay, (ONE each)
					5				ay, (ONE each)
							ssorie		
						0			essories
						1			nd injection valve, 2 m PVC suction E metering line
								rol typ	
							0	no lo	ck
							1		ock: manual operation locked when nal cable plugged in
							Н	Exter	rnal without PCS stop
								Cont	rol version
								0	Standard
								Α	External analogue 020 mA / 420 mA
									Options
									00 no options

# 2 About this pump

Properties of the device

This solenoid metering pump Beta b is equipped with all adjustment and activation functions for modern water treatment and the dosing of chemicals. It has pulse step-up and pulse step-down compared with the preceding model. This enables it to adapt more precisely to external signal generators. The result is the simpler and more precise adjustment of chemical consumption to the actual need. It also has a 10 percent increase in efficiency and energy efficiency over the preceding model. The Beta b can be simply adjusted during operation.

# 3 Safety Chapter

## Identification of safety notes

The following signal words are used in these operating instructions to denote different severities of danger:

Signal word	Meaning
WARNING	Denotes a possibly dangerous sit- uation. If this is disregarded, you are in a life-threatening situation and this can result in serious inju- ries.
CAUTION	Denotes a possibly dangerous sit- uation. If this is disregarded, it could result in slight or minor inju- ries or material damage.

# Warning signs denoting different types of danger

The following warning signs are used in these operating instructions to denote different types of danger:

Warning signs	Type of danger
	Warning – automatic start-up.
A	Warning – high-voltage.
	Warning – danger zone.

#### Intended Use

- Only use the pump to meter liquid feed chemicals.
- Only use the pump after it has been correctly installed and started up in accordance with the technical data and specifications contained in the operating instructions.
- Observe the general limitations with regard to viscosity limits, chemical resistance and density see also ProMinent resistance list in the Product Catalogue or at www.prominent.com!
- All other uses or modifications are prohibited.
- The pump is not intended for the metering of gaseous media and solids.
- The pump is not intended for the metering of flammable media without implementing suitable protective measures.
- The pump is not intended for the metering of explosive media.
- The pump is not intended for operation in areas at risk from explosion.
- The pump is not intended for exterior applications without the implementation of suitable protective measures.
- The pump should only be operated by trained and authorised personnel, see the following "Qualifications" table.
- You are obliged to observe the information contained in the operating instructions at the different phases of the unit's service life.



#### Safety Information



#### WARNING!

#### Warning about personal and material damage

The pump can start to pump, as soon as it is connected to the mains voltage.

 Install an emergency cut-off switch in the pump power supply line or integrate the pump in the emergency cutoff management of the system.



#### WARNING!

#### Danger of electric shock

A mains voltage may exist inside the pump housing.

 If the pump housing has been damaged, you must disconnect it from the mains immediately. It may only be returned to service after an authorised repair.



#### WARNING!

#### Warning of dangerous or unknown feed chemical

Should a dangerous or unknown feed chemical be used: It may escape from the hydraulic components when working on the pump.

- Take appropriate protective measures before working on the pump (e.g. safety glasses, safety gloves, ...).
   Observe the safety data sheet for the feed chemical.
- Drain and flush the liquid end before working on the pump.



#### **WARNING!**

## Fire danger

When pumping inflammable media the operator must take suitable safety precautions.



#### WARNING!

## Danger from hazardous substances!

Possible consequence: Fatal or very serious injuries.

Please ensure when handling hazardous substances that you have read the latest safety data sheets provided by the manufacture of the hazardous substance. The actions required are described in the safety data sheet. Check the safety data sheet regularly and replace, if necessary, as the hazard potential of a substance can be re-evaluated at any time based on new findings.

The system operator is responsible for ensuring that these safety data sheets are available and that they are kept up to date, as well as for producing an associated hazard assessment for the workstations affected.



#### **CAUTION!**

# Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.



#### **CAUTION!**

# Warning of feed chemical spraying around

The metering pump can generate a multiple of its rated pressure. Hydraulic parts can rupture if a discharge line is blocked.

 Correctly install a relief valve in the discharge line downstream of the metering pump.



#### **CAUTION!**

#### Warning of feed chemical spraying around

An unsuitable feed chemical can damage the wetted parts of the pump.

 Take into account the resistance of the wetted materials when selecting the feed chemical - see the ProMinent Product Catalogue or visit our homepage.



# **CAUTION!**

#### Danger of injury to personnel and material damage

The use of untested third party components can result in injury to personnel and material damage.

 Only fit parts to metering pumps that have been tested and recommended by ProMinent.



#### **CAUTION!**

# Danger from incorrectly operated or inadequately maintained pumps

Danger can arise from a poorly accessible pump due to incorrect operation and poor maintenance.

- Ensure that the pump is accessible at all times.
- Adhere to the maintenance intervals.



# **CAUTION!**

# Danger from incorrect metering

Should a different liquid end size be fitted, this will change the metering behaviour of the pump.

- Have the pump reprogrammed in the works.



#### **CAUTION!**

#### Warning against illegal operation

Observe the regulations that apply where the device is installed

# Fixed separating protective equipment

- Dosing head
- Housing
- Hood (houses the control elements)

The dosing head may only be removed by the customer in accordance with the "Repair" chapter.

The housing and the hood may only be removed by ProMinent customer service department.

## Information in the event of an emergency

In an emergency, either pull out the mains plug, turn the multifunctional switch to "Stop" or press the Emergency Stop switch installed on the customer's side or disconnect the pump from the mains power supply in line with the emergency shut-down management guidelines for your system!

If feed chemical escapes, additionally ensure that the hydraulic system around the pump is at atmospheric pressure. Adhere to the safety data sheet for the feed chemical.

#### Qualification of personnel

Task	Qualification
Storage, transport, unpacking	Instructed person
Assembly	Technical personnel, service
Planning the hydraulic installation	Qualified personnel who have a thorough knowledge of metering pumps
Hydraulic installation	Technical personnel, service
Installation, electrical	Electrical technician
Operation	Instructed person
Maintenance, repair	Technical personnel, service
Decommissioning, disposal	Technical personnel, service
Troubleshooting	Technical personnel, electrical technician, instructed person, service

#### Explanation of the table:

# Qualified personnel

A qualified employee is deemed to be a person who is able to assess the tasks assigned to him and recognise possible dangers based on his/her technical training, knowledge and experience, as well as knowledge of pertinent regulations.

#### Note:

A qualification of equal validity to a technical qualification can also be gained by several years of employment in the relevant field of work.

# Electrical technician

An electrical technician is able to complete work on electrical systems and recognise and avoid possible dangers independently based on his/her technical training and experience, as well as knowledge of pertinent standards and regulations.

# Safety Chapter

The electrical technician should be specifically trained for the working environment in which he is employed and know the relevant standards and regulations.

An electrical technician must comply with the provisions of the applicable statutory directives on accident prevention.

# Instructed person

An instructed person is deemed to be a person who has been instructed and, if required, trained in the tasks assigned to him/her and possible dangers that could result from improper behaviour, as well as having been instructed in the required protective equipment and protective measures.

## Service

The Service department refers to service technicians, who have received proven training and have been authorised by ProMinent to work on the system.

# Sound pressure level

Sound pressure level LpA < 70 dB according to EN ISO 20361

at maximum stroke length, maximum stroke rate, maximum back pressure (water)



# 4 Storage, Transport and Unpacking

# Safety Information



#### WARNING!

The transporting of pumps which have been used with radioactive feed chemicals is forbidden!

They will also not be accepted by ProMinent!



#### **WARNING!**

Only return metering pumps for repair in a cleaned state and with a flushed liquid end - refer to "Decommissioning!

Only return metering pumps with a completed Decontamination Declaration form. The Decontamination Declaration constitutes an integral part of an inspection / repair order. A unit can only be inspected or repaired when a Declaration of Decontamination Form is submitted that has been completed correctly and in full by an authorised and qualified person on behalf of the pump operator.

The "Decontamination Declaration Form" can be found on our homepage.



#### **CAUTION!**

#### Danger of material damage

The device can be damaged by incorrect or improper storage or transportation!

- The unit should only be stored or transported in a well packaged state - preferably in its original packaging.
- The packaged unit should also only be stored or transported in accordance with the stipulated storage conditions
- The packaged unit should be protected from moisture and the ingress of chemicals.

## **Ambient conditions**

Data	Value	Unit
Minimum storage and transport temperature	-20	°C
Maximum storage and transport temperature	+60	°C
Maximum air humidity *	95	% rel. humidity

<sup>\*</sup> non-condensing

# Scope of delivery

Compare the delivery note with the scope of delivery:

- Metering pump with mains cable
- Connector kit for hose/pipe connection (optional)
- Product-specific operating instructions with EC Declaration of Conformity
- Optional accessories

ProMinent® E-959

# Overview of Equipment and Control Elements 5

# **Overview of Equipment**

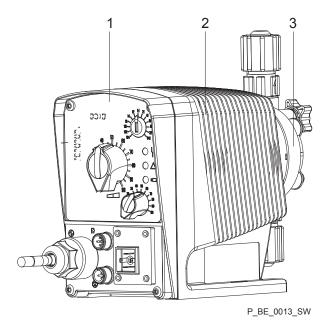


Fig. 2: Complete overview

- Control unit
- Drive unit Liquid end

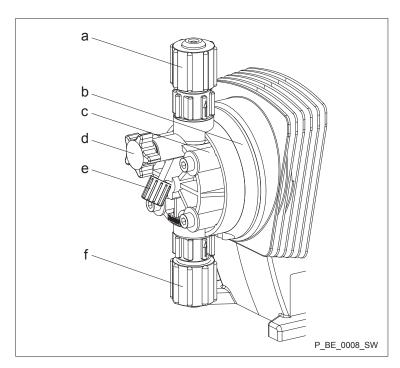


Fig. 3: Overview of liquid end (PV)

- Discharge valve Backplate а
- b
- Dosing head Bleed valve С
- d
- Bypass hose sleeve Suction valve

ProMinent®

# 5.2 Control Elements

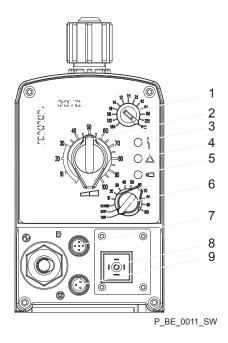


Fig. 4

- 1 Pulse control switch
- 2 Stroke Length Adjustment Button
- 3 Fault indicator (red)
- 4 Warning indicator (yellow)
- 5 Operating indicator (green)
- 6 Multifunctional Switch
- 7 "External control" terminal
- 8 Relay connection (optional)
- 9 "Level switch" terminal

# 5.2.1 Pulse control switch

In **"External Contact"** operating mode, the pulse control switch either triggers a series of strokes or steps down an incoming series of contacts by a single contact (at the "external control" terminal).

In **"External Analogue" operating mode**, the stroke rate can be controlled by an mA signal via the pulse control switch. To do so, the multifunctional switch has to be turned to "Extern".

# 5.2.2 Stroke Length Adjustment Button

The stroke length adjustment button can be used to adjust the stroke length.

# 5.2.3 Multifunctional Switch

The multifunctional switch can be used to set the following functions, operating modes and stroke rate.

The operating modes that can be set are:

- Test (priming function)
- Stop (optionally missing)
- Extern (Contact)
- External (analogue, optional)
- Manual (setting stroke rate in 10% increments)

E-961

# 5.2.4 Functional and Fault Indicators

Fault indicator (red)

The fault indicator lights up if the fluid level in the dosing tank falls below the second switching point of the level switch (20 mm residual filling level in the dosing tank).

The fault indicator lights up if the current falls below 3.8 mA (only with 4...20 mA) or exceeds 23 mA in "External Analogue" operating mode.

This LED flashes in the event of an undefined operating status.

Warning indicator (yellow)

The warning indicator lights up if the fluid level in the dosing tank falls below the first switching point of the level switch.

Operating indicator (green)

The operating indicator lights up if the pump is ready for operation and there are no fault or warning alerts. It goes out quickly as soon as the pump has performed a stroke.

# 5.2.5 "External control" terminal

The "external control" terminal is a five-pole panel terminal.

It enables the following functions and operating modes to be used:

- Pause
- External contact
- External Analogue (optional)
- Auxiliary frequency (external frequency changer)



The two- and four-pole cables used to date can continue to be used. The "Auxiliary frequency" function can, however, only be used with a five-pole cable.

# 5.2.6 "Level switch" terminal

A 2-stage level switch with pre-warning and end switch-off can be connected.



# 6 Functional description

# 6.1 Liquid End

The dosing process is performed as follows: The diaphragm is pressed into the dosing head; the pressure in the dosing head closes the suction valve and the feed chemical flows through the discharge valve out of the dosing head. The diaphragm is now drawn out of the dosing head; the discharge valve closes due to the negative pressure in the dosing head and fresh feed chemical flows through the suction valve into the dosing head. One cycle is completed.

# 6.2 Drive Unit

The diaphragm is driven by an electromagnet, which is controlled by an electronic controller.

# 6.3 Capacity

The capacity is determined by the stroke length and the stroke rate.

The stroke length is adjusted by the stroke length adjustment knob within a range of 0 ... 100 %. A stroke length of between 30 ... 100 % (SEK type: 50 ... 100 %) is recommended to achieve the specified reproducibility!

Data	Value	Unit
Recommended stroke length, standard type	30 100	%
Recommended stroke length, SEK type	50 100	%

The stroke rate can be set within a range of 10  $\dots$  100 % using the multifunctional switch.

# 6.4 Self-Bleeding

Self-bleeding liquid ends (SEK types) are capable of independent priming when a discharge line is connected and diverting existent air pockets via a bypass. During operation they are also capable of conveying away gases which are produced, independently of the operating pressure in the system. It is also possible to dose precisely in a depressurised state due to the integral back pressure valve.

# 6.5 Operating modes

The operating modes are selected by means of the multifunctional switch.

"Manual" operating mode

As soon as the stroke rate has been set by the multifunctional switch, the pump finds itself in "Manual" operating mode. 100% corresponds to 180 strokes/min.

"External contact" operating mode

The "External Contact" operating mode is described below in the "Operation" and "Installation, Electrical" chapters.

"External Analogue" operating mode

The "External Analogue" operating mode is described below in the "Operation" and "Installation, Electrical" chapters.

ProMinent® E-963

# 6.6 Functions

The functions are described below in the "Operation" chapter.

# 6.7 Relay

The pump has two connecting options.

Fault indicating relay option

The relay can switch a connected power circuit (e.g. for an alarm horn) in the event of warnings or fault messages (e.g. warning levels).

The relay can be retrofitted with the retrofit kit via a knock-out opening in the pump foot - refer to "Retrofitting relays".

Fault indicating and pacing relay option

This combined relay can generate a contact with each stroke via its pacing relay in addition to its function as a fault indicating relay.

The relay can be retrofitted with the retrofit kit via a knock-out opening in the pump foot - refer to "Retrofitting relays".

# 6.8 Hierarchy of Operating Modes, Functions and Fault Statuses

The different operating modes, functions and fault statuses have a different effect on if and how the pump reacts.

The following list shows the order:

- 1. Test (priming)
- 2. Fault, Stop, Pause
- 3. Auxiliary frequency (external frequency changeover)
- 4. Manual, Extern Contact

#### Comments:

- re 1 "Priming" can take place in any mode of the pump (providing it is functioning).
- re 2 "Fault", "Stop" und "Pause" stop everything apart from "Priming".
- re 3 The stroke rate of "Auxiliary frequency" always has priority over the stroke rate specified by an operating mode in 4.



# 7 Assembly



 Compare the dimensions on the dimension sheet with those of the pump.



#### **WARNING!**

#### Danger of electric shock

If water or other electrically conducting liquids penetrate into the drive housing, in any other manner than via the pump's suction connection, an electric shock may occur.

Position the pump so that it cannot be flooded.



#### **CAUTION!**

Danger from incorrectly operated or inadequately maintained pumps

Danger can arise from a poorly accessible pump due to incorrect operation and poor maintenance.

- Ensure that the pump is accessible at all times.
- Adhere to the maintenance intervals.



# Capacity too low

The liquid end valves can be disturbed by vibrations.

Secure the metering pump so that no vibrations can occur.



# Capacity too low

If the valves of the liquid end are not vertical, they cannot close correctly.

- Suction and discharge valves must stand vertically upwards (for self-bleeding liquid end, the bleed valve).
- Mount the metering pump with the pump foot on a horizontal, level and load-bearing supporting surface.

ProMinent® E-965

# 8 Installation, hydraulic

Safety Information



#### **CAUTION!**

# Warning of feed chemical spraying around

An unsuitable feed chemical can damage the wetted parts of the pump.

 Take into account the resistance of the wetted materials when selecting the feed chemical - see the ProMinent Product Catalogue or visit our homepage.



#### **CAUTION!**

# Warning of feed chemical spraying around

Pumps which are not fully installed hydraulically can pump feed chemical from the outlet opening of the discharge valve as soon as they are connected to the mains power supply.

- First install the pump hydraulically, then electrically.
- In the event that you have failed to do so, turn the multifunctional switch to [Stop] (if fitted) or press an On / Off switch or Emergency Stop switch on site.



#### **CAUTION!**

#### Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.



#### **CAUTION!**

## Danger from rupturing hydraulic components

Peak loads during the dosing stroke can cause the maximum permissible operating pressure of the system and pump to be exceeded.

- The discharge lines are to be properly designed.



# **CAUTION!**

# Danger of personnel injury and material damage

The use of untested third party parts can result in personnel injuries and material damage.

 Only fit parts to metering pumps, which have been tested and recommended by ProMinent.



# 8.1 Installing hose lines

# 8.1.1 Installation of Metering Pumps Without Bleed Valve

Safety Information



#### **CAUTION!**

#### Warning of feed chemical spraying around

The pipes can loosen or rupture if they are not installed correctly.

- Route all hose lines so they are free from mechanical stresses and kinks.
- Only use original hoses with the specified hose dimensions and wall thicknesses.
- Only use clamp rings and hose nozzles that are intended for the hose diameter in question to ensure the long service life of the connections.



#### **CAUTION!**

# Danger from rupturing hydraulic components

Hydraulic components can rupture if the maximum permissible operating pressure is exceeded.

- Always adhere to the maximum permissible operating pressure of all hydraulic components - please refer to the product-specific operating instructions and system documentation.
- Never allow the metering pump to run against a closed shut-off device.
- Install a relief valve.



# **CAUTION!**

# Hazardous feed chemicals can escape

Hazardous or extremely aggressive feed chemicals can leak out when using conventional bleeding procedures with metering pumps.

- Install a bleed line with return line into the storage tank.



# **CAUTION!**

#### Hazardous feed chemicals can escape

Hazardous or extremely aggressive feed chemicals can leak out in the event that the metering pump is removed from the installation.

 Install a shut-off valve on the metering pump's pressure and discharge sides.



#### **CAUTION!**

# Uncontrolled flow of feed chemical

Feed chemical can press through a stopped metering pump if there is back pressure.

- Use an injection valve or a vacuum breaker.

ProMinent® E-967



#### **CAUTION!**

# Uncontrolled flow of feed chemical

Feed chemicals can leak through the metering pump in an uncontrolled manner in the event of excessive priming pressure.

Do not exceed the maximum permissible priming pressure for the metering pump.



Align the pipes so that the metering pump and the liquid end can be removed from the side if necessary.

# Installing hose lines - PP, NP, PV, TT designs

- 1. Cut off the ends of the hoses at right angles.
- **2.** Pull the union nut (2) and clamp ring (3) over the hose (1) see figure Fig. 5.
- **3.** Push the hose end (1) up to the stop over the nozzle (4) and widen, if necessary.



Ensure that the O-ring and flat seal (5) is properly fitted to the valve (6).



Never re-use used PTFE seals. An installation sealed in this way is not watertight.

This type of seal is permanently distorted when subjected to pressure.



In order to enable it to be distinguished from the EPDM flat seal, the FPM flat seal PV design has a dot.

- 4. Place the hose (1) with the nozzle (4) onto the valve (6).
- **5.** Clamp the hose connector: Tighten the union nut (2) while simultaneously pressing on the hose (1).
- **6.** Re-tighten the hose connector: Pull on the hose (1) briefly, which is fastened to the dosing head and then tighten the union nut (2) once more






Fig. 5: PP, NP, PV and TT designs

- 1 Hose
- 2 Union nut
- 3 Clamp ring
- 4 Nozzle
- 5 O-ring or flat seal
- 6 Valve

Installing stainless steel pipe - SS design

- 1. ▶ Pull the union nut (2) and clamp rings (3, 4) over the pipe (1) with approx. 10 mm overhang see ∜ 'Installing stainless steel pipe SS design' on page 23.
- 2. Insert the pipe (1) up to the stop in the valve (5).
- 3. Tighten the union nut (2).
- 1 2 3 4 5

P\_MAZ\_0022\_SW

Fig. 6: SS design

Installing hose lines - SS design

- 1 pipe
- 2 Union nut
- 3 Rear clamp ring
- 4 Front clamp ring
- 5 Valve



# **CAUTION!**

# Warning of feed chemical spraying around

Connections can come loose in the event that hose lines are installed incorrectly on stainless steel valves.

- Only use PE or PTFE hose lines.
- In addition, insert a stainless steel support insert into the hose line.

# 8.1.2 Installation of Metering Pumps With Bleed Valve

Safety Information



#### CAUTION!

 All the installation and safety notes for metering pumps without bleed valves also apply.

Installation of the return line

A return line is also connected in addition to the suction and discharge line.

ProMinent® E-969 23

- 1. Attach the hose line to the return hose nozzle or to the liquid end bleed valve. PVC hose, soft, 6x4 mm is recommended.
- **2.** Feed the free end of the return line back to the storage tank.
- 3. Shorten the return line so that it is not immersed in the feed chemical in the storage tank.

# 8.1.3 Installation of Metering Pumps With Self-bleeding (SEK Type)

# Safety Information



# **CAUTION!**

- All of the installation and safety notes for metering pumps without self-bleeding also apply.
- Do not exceed the maximum values for priming lift, priming pressure and viscosity of the feed chemical.
- Do not allow the suction side line cross-section to exceed the line cross-section on the suction valve.

# Information about priming pressure

- Make sure that the priming pressure on the suction end is at least equal to the return line pressure.
- Priming pressure in the return line restricts the bleeding function.
- However, operation with priming pressure in the return line and the suction end at atmospheric pressure is possible

# Installation of the return line

A return line is also connected in addition to the suction and discharge line.



- The return line is connected to the vertical valve on the upper side of the liquid end. It is factory-labelled with a red sleeve see ∜ 'Installation of the return line' on page 24.
- The discharge line is connected to the horizontal valve.
- 1. Attach the hose line to the return hose nozzle or to the liquid end bleed valve. PVC hose, soft, 6x4 mm is recommended.
- 2. Feed the free end of the return line back to the storage tank.
- 3. SEK only: Insert the return line into the anti-kink device on the bleed valve and screw it in place until the anti-kink device engages.



The anti-kink device prevents the return line from kinking, avoiding the risk of self-bleeding failure.

**4.** Shorten the return line so that it is not immersed in the feed chemical in the storage tank.



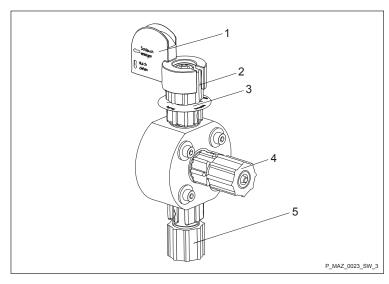


Fig. 7: SEK liquid end

- 1 Anti-kink device
- 2 Bleed valve for the return line into the storage tank, 6/4 mm
- 3 Red sleeve
- 4 Discharge valve for discharge line to the injection point, 6/4 12/9 mm
- 5 Suction valve for suction line in the storage tank, 6/4 12/9 mm

# 8.1.4 Basic installation notes Safety notes



#### **CAUTION!**

# Danger resulting from rupturing hydraulic components

Hydraulic components can rupture if the maximum permissible operating pressure is exceeded.

- Never allow the metering pump to run against a closed shut-off device.
- With metering pumps without integral relief valve: Install a relief valve in the discharge line.



#### **CAUTION!**

# Hazardous feed chemicals can escape

With hazardous feed chemicals: Hazardous feed chemical can leak out when using conventional bleeding procedures with metering pumps.

- Install a bleed line with a return into the storage tank.
- Shorten the return line so that it does not dip into the feed chemical in the storage tank.

ProMinent® E-971 25




Fig. 8: Standard installation

- Main line Storage tank

# Legend for hydraulic diagram

Symbol	Explanation	Symbol	Explanation
	Metering pump		Foot valve with filter meshes
W Company	Injection valve	$\nabla$	Level switch
<b>₩</b> ₩	Multifunctional valve	$\bigcirc$	Manometer

# 9 Electrical Installation



#### WARNING!

## Danger of electric shock

A mains voltage may exist inside the device.

 Before any work, disconnect the device's mains cable from the mains.



#### **WARNING!**

#### Risk of electric shock

This pump is supplied with a grounding conductor and a grounding-type attachment plug.

To reduce the risk of electric shock, ensure that it is connected only to a proper grounding-type receptacle.



# **WARNING!**

# Risk of electric shock

In the event of an electrical accident, the pump must be quickly disconnected from the mains.

- Install an emergency cut-off switch in the pump power supply line or
- Integrate the pump in the emergency cut-off management of the system and inform personnel of the isolating option.



# **WARNING!**

# Danger of electric shock

A mains voltage may exist inside the pump housing.

 If the pump housing has been damaged, you must disconnect it from the mains immediately. It may only be returned to service after an authorised repair.



## **CAUTION!**

# Material damage possible due to power surges

Should the pump be connected to the mains power supply in parallel to inductive consumers (such as solenoid valves, motors), inductive power surges can damage the controller when it is switched off.

 Provide the pump with its own contacts and supply with voltage via a contactor relay or relay.

Personnel:

■ Electrician

Install the pump in line with best working practice and in accordance with the operating instructions and applicable regulations.

ProMinent® E-973 27

# 9.1 Supply voltage connector



#### **WARNING!**

# Unexpected startup is possible

As soon as the pump is connected to the mains, the pump may start pumping and consequently feed chemical may escape.

- Prevent dangerous feed chemicals from escaping.
- If you have not successfully prevented this, immediately press the [STOP/START] key or disconnect the pump from mains, e.g. via an emergency cu-off switch.



#### **CAUTION!**

If the pump is integrated into a system: Design the system so that potential hazardous situations are avoided by pumps starting up automatically subsequent to unintended power interruptions.



# **CAUTION!**

Provide an option to disconnect the pump without Emergency Stop switch from the mains power supply.

# 9.1.1 Mains voltage

Parallel connection to inductive consumers

Should the pump be connected to the mains in parallel to inductive consumers (e.g. solenoid valves, motor), the pump must be electrically isolated when these consumers are switched off.

- Supply the pumps with voltage via a contactor relay or relay using separate contacts for the pump.
- If this is not possible then connect a varistor (part no. 710912) or an RC member, 0.22  $\mu F$  / 220  $\Omega$  in parallel.

Interference suppression aids

Product	Part no.
Varistor:	710912
RC Gate, 0.22 $\mu\text{F}$ / 220 $\Omega$ :	710802

# 9.2 Supply voltage connector - low voltage



#### WARNING!

#### Danger of electric shock

 For safety reasons, the low voltage pumps must be operated using only protective low voltage (SELV in accordance with EN 60335-1).



# **CAUTION!**

Supply voltages that are too high destroy the pump.

Do not connect the low voltage pump to voltages > 30 V.



- The pump will generate a fault ("switch-off threshold for supply") in the event that the supply voltage to the pump is insufficient to ensure reliable function. The pump will recommence operation as soon as the supply voltage is restored.
- The fault indicator flashes additionally if the supply voltage is interrupted during a stroke, ("threshold for stroke abort"). Aborted strokes are not counted by the stroke counter. In doing so, the pump's electronic controller periodically checks the supply voltage ("wait time after stroke abort": 10 min). The pump will recommence operation if the supply voltage is sufficient.
- The pump's electrical system will shut down completely in the event that the supply voltage undershoots another threshold. The pump will come out of standby mode and recommence operation as soon as sufficient supply voltage is restored.
- The programmed thresholds apply to standard lead-acid batteries. ProMinent can match these to customer requirements.
- Use short large-diameter power leads in order to minimise faults. Use batteries with low internal resistance.
- If the pump is connected with incorrect polarity, it will not run because the polarity protection does not allow any current to flow.

# 9.3 Description of the Terminals

# 9.3.1 "External control" terminal

The "external control" socket is a five-pin panel socket. It is compatible with two- and four-pole cables.

The "Auxiliary rate" function can only be used with a five conductor cable.




Fig. 9: Pump assignment

Electrical interface for pin 1 "Pause" - pin 2 "External contact" - pin 5 "Auxiliary frequency"

Data	Value	Unit
Voltage with open contacts	5	V
Input resistance	10	$k\Omega$
Max. pulse frequency	25	pulse/s
Min. pulse duration	20	ms
Min. pause between pulses	3	ms

#### Control via:

- potential-free contact (load: 0.5 mA at 5 V) or
- Semiconductor switch (residual voltage < 0.7 V)</li>

Electrical interface for pin 3 "mA input" (with identity code characteristic "Control version": A - "External Analogue")

Data	Value	Unit
Input apparent ohmic resistance, approx.	120	Ω

# Behaviour of the pump

At approx. 0.1 mA (4.1 mA) the metering pump makes its first metering stroke

At approx. 19.9 mA the pump moves to continuous operation at 180 strokes /  $\min$  .

With current signals **above 23 mA**, the red fault indicator lights up, the pump stops and any fault indicating relay fitted switches (a **fault** is pending).

Only with 4...20 mA: With current signals **below 3.8 mA**, the red fault indicator lights up, the pump stops and any fault indicating relay fitted switches (**Fault** for example with a cable break).




Fig. 10: Cable assignment

Pin	Function	5-wire cable	2-wire cable
1	Pause	brown	bridged at pin 4
2	External contact	white	brown
3	mA input*	blue	-
4	Earth GND	black	white
5	Auxiliary frequency	grey	-

<sup>\*</sup> with identity code characteristic "Control version": A - "External Analogue"



Refer to the functional description for the hierarchy of functions and operating modes.

## "Pause" function

The pump does not work if:

the cable is connected and pin 1 and pin 4 are open.

#### The pump works if:

- the cable is connected and pin 1 and pin 4 are connected.
- no cable is connected.

# "External contact" operating mode

The pump performs one or more strokes if:

- Pin 2 and pin 4 are connected to each other for at least 20 ms. At the same time, pin 1 and pin 4 must also be connected to each other.
- "External Analogue" operating mode
- The metering pump makes its first metering stroke at approx. 0.1 mA (4.1 mA) and enters into continuous operation at approx. 19.9 mA.

#### "Auxiliary frequency" operating mode


The pump works at a pre-set stroke rate if:

Pin 5 and pin 4 are connected to each other. At the same time, pin 1 and pin 4 must also be connected to each other. The auxiliary frequency is factory-preset to the maximum stroke rate.

# 9.3.2 "Level switch" terminal

There is a connecting option for a 2-stage level switch with pre-warning and limit stop.

#### Electrical interface



DataValueUnitVoltage with open contacts5VInput resistance10 $k\Omega$ 

## Control via:

- potential-free contact (load: 0.5 mA at 5 V) or
- Semiconductor switch (residual voltage < 0.7 V)

Fig. 11: Pump assignment




Fig. 12: Cable assignment

Pin	Function	3-wire cable
1	Earth GND	black
2	Minimum pre-warning	blue
3	Minimum limit stop	brown

# 9.4 Relay

# 9.4.1 Relay functions

# Beta b BT4b/BT5b

Identity code	Description	Туре	Maximum voltage	Maximum cur- rent	Behaviour of relay type when retrofit- ting, as standard
0	no relay	-	-	-	-
1	Fault indicating relay	NC changeover contact	230 V	8 A	Χ
3	Fault indicating relay	NO changeover contact	230 V	8 A	-
4	Fault indicating relay	N/O	24 V	100 mA	X
	Pacing relay	N/O	24 V	100 mA	-
5	Fault indicating relay	N/O	24 V	100 mA	-
	Pacing relay	N/O	24 V	100 mA	-

# Relay type switches in the event of...

Relay type	level Warning	level low	Calibrated stroke length	Processor Error
Fault indicating relay:	X	X	X	X

# 9.4.2 "Fault indicating relay" output (identity code 1 + 3)

A fault indicating relay can optionally be ordered. It is used to emit a signal when there is a fault with the pump and for the "Liquid level low, 1st stage" warning message and "Liquid level low 2nd stage" fault message.

A cut-off relay works when there are fault alerts from the pump and in the event of the "Liquid level low 2nd stage" alert.

The fault indicating relay can be retrofitted and is operational once attached to the relay board - refer to the "Operating Instructions for Retrofitting Relays for Beta b and delta".




Fig. 13: Pump assignment

# **Electrical interface**

Data	Value	Unit
Maximum contact load at 230 V and 50/60 Hz:	8	Α
Minimum mechanical lifespan:	200,000	switching operations



# Identity code 1 + 3




Fig. 14: Cable assignment

# Pin assignment

To pin	VDE cable	Contact	CSA cable
1	white	NO (normally open)	white
2	green	NC (normally closed)	red
4	brown	C (common)	black

# 9.4.3 "Fault indicating relay" + "Pacing relay" output (identity code 4 + 5)

A fault indicating / pacing relay can optionally be ordered. The pacing output is electrically-isolated by means of an optocoupler with a semiconductor switch. The second switch is a relay.

The fault indicating /pacing relay can be retrofitted and is operational once attached to the relay board - refer to the "Operating Instructions for Retrofitting Relays for Beta b and delta".




Fig. 15: Pump assignment

# **Electrical interface**

for fault indicating relays:

Data	Value	Unit
Maximum contact load at 24 V and 50/60 Hz:	8	Α
Minimum mechanical lifespan:	200,000	switching operations

for semiconductor switch pacing relay:

Data	Value	Unit
Residual voltage max. at I <sub>c</sub> = 1 mA	0.4	V
Maximum current	100	mA
Maximum voltage	24	VDC
Pacing pulse duration, approx.	100	ms

# Identity code 4 + 5




Fig. 16: Cable assignment

# Pin assignment

To pin	VDE cable	Contact	Relay
1	yellow	NO (normally open)	Fault indi- cating relay
4	green	C (common)	Fault indi- cating relay
3	white	NO (normally open)	Pacing relay
2	brown	C (common)	Pacing relay

### 10 Start up



#### WARNING!

Dangerous reactions are possible due to contact of feed chemical with water

The feed chemical can mix and react in the liquid end with water remaining after testing in the factory.

- Read the safety data sheet on the feed chemical.
- Blast the liquid end with compressed air.
- Flush the liquid end with a suitable medium through the suction connector.



#### **WARNING!**

### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



### **CAUTION!**

### Danger with dangerous feed chemicals

Contact with the feed chemical is possible provided the following handling instructions are adhered to.

- If the feed chemical is dangerous, take appropriate safety precautions when carrying out the following handling instructions.
- Adhere to the feed chemical safety data sheet.



### **CAUTION!**

### Warning of feed chemical spraying around

An unsuitable feed chemical can damage the parts of the pump that come into contact with the chemical.

 Take into account the resistance of the materials that will come into contact with the medium when selecting the feed chemical - refer to the ProMinent® Resistance List in the Product Catalogue or at www.prominent.com.



- Reliable metering cannot be guaranteed after the metering pump has been idle for some time, as the feed chemical can crystallise in the valves and on the diaphragm. Regularly check the valves and diaphragm.
- Only adjust the stroke length when the pump is running.
- The metering pump should prime at 100% stroke length, as the priming lift depends on the stroke volume when the liquid end is empty. If the metering pump has to prime at a smaller stroke length and is not priming, reduce the priming lift (i.e. briefly lift up the storage tank with the feed chemical).
- SEK-type only: The suction lift corresponds to the priming lift, as some gas always remains in the liquid end with gaseous media.



### Starting up the metering pump

- 1. Fill the liquid end & 'Filling the liquid end' on page 35.
- 2. Check the pump connectors and connections for leak-tightness.
- 3. Check the suction valve and discharge valve for leak-tightness and tighten if necessary.
- 4. Check the liquid end for leak-tightness and tighten the screws on the dosing head if necessary see below for starting torque.
- 5. Only with bleed valve: Check whether the bleed valve is closed.
- **6.** Start up the relief valve in the system in line with its operating instructions.
- 7. Start up the system.
- **8.** After 24 hours of operation: Tighten the screws on the dosing headsee below for tightening torque.

### Tightening torque

Data	Value	Unit
Tightening torque for screws:	4.5 5.0	Nm

### Draining the liquid end

### With feed chemicals that should not come into contact with water.

- 1. Turn the pump so that the pressure connector is facing downwards.
- 2. Allow water to flow out of the liquid end.
- **3.** Flush the suction connector from above with a suitable medium or blast with compressed air.

### Filling the liquid end

### With liquid ends without bleed valve:

- 1. Connect the suction line to the liquid end but not yet to the discharge line.
- 2. If fitted: Close the shut-off valve on the discharge side.
- 3. Connect a short, transparent section of hose to the discharge valve.
- Switch on the metering pump and allow to work at maximum stroke length and stroke rate until some feed chemical becomes visible in the short section of hose.
  - ⇒ The liquid end has been filled completely without bubbles.
- 5. Switch off the metering pump.
- 6. Connect the discharge line to the liquid end.
  - ⇒ The metering pump is ready for operation.

#### With liquid ends with bleed valves (not SEK):

- 1. Connect the suction and discharge line to the liquid end.
- 2. Connect the return line.
- Open the bleed valve by turning the star-shaped handle in a counter-clockwise direction.
  - $\Rightarrow$  You can now use the return line to bleed the pump.
- **4.** Switch on the metering pump and allow to work at maximum stroke length and stroke rate until some feed chemical becomes visible in the return or discharge line.
  - ⇒ The liquid end has been filled completely without bubbles.
- 5. Switch off the metering pump.
- 6. Close the bleed valve.
  - ⇒ The metering pump is ready for operation.

E-981

### With self-bleeding metering pumps (SEK type):



- The return line is connected to the vertical valve on the top of the liquid end. It is labelled with a red sleeve exworks.
- The discharge line is connected to the horizontal valve.
- 1. Switch on the metering pump and allow to work at maximum stroke length and stroke rate until some feed chemical becomes visible in the return or discharge line.
  - $\Rightarrow$  The liquid end has been filled completely without bubbles.
- 2. Switch off the metering pump.
  - $\Rightarrow$  The metering pump is ready for operation.

### Setting the precise dosage



### Stroke length and stroke rate

- Select as large a stroke length as possible with gaseous feed chemicals.
- Select as high a stroke rate as possible for good mixing.
- Do not set the stroke length to less than 30 % for precise metering using quantity-proportional metering.



### 11 Operation



#### WARNING!

### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



#### **WARNING!**

### Danger of electric shock

Incompletely installed electrical options can allow moisture into the inside of the housing.

 Knock-out openings in the pump housing must be equipped with matching modules or be sealed in a leaktight manner.



### **WARNING!**

### Danger of electric shock

A mains voltage may exist inside the pump housing.

 If the pump housing has been damaged, you must disconnect it from the mains immediately. It may only be returned to service after an authorised repair.

### 11.1 Manual

Personnel:

Instructed personnel

### 11.1.1 Capacity

The capacity is determined by the stroke length and the stroke rate.

The stroke length is adjusted by the stroke length adjustment knob within a range of 0 ... 100 %. A stroke length of between 30 ... 100 % (SEK type: 50 ... 100 %) is recommended to achieve the specified reproducibility!

Data	Value	Unit
Recommended stroke length, standard type	30 100	%
Recommended stroke length, SEK type	50 100	%

The stroke rate can be set within a range of 10  $\dots$  100 % using the multifunctional switch.

### 11.1.2 Functions

The pump has the following functions:

"Pause" function

The pump can be remotely stopped via the "External Control" terminal. The "Pause" function only works via the "External Control" terminal.

ProMinent® E-983 37

### Operation

"Stop" function (optional)

The pumps can be stopped by turning the multifunctional switch to "Stop" without disconnecting it from the mains power supply.

"Priming" function

Priming (transient conveyance at maximum frequency) can be provided by turning the multifunctional switch to "Test".

"Level switch" function

Information about the liquid/powder level in the feed chemical container is reported to the pump. To do so, a two-stage level switch must be fitted; it is connected to the "Level switch" terminal.

"Auxiliary rate" function

Enables switching of a stroke rate via the "External control" jack. This auxiliary rate has priority over the operating mode stroke rate settings. In the standard version, the "Auxiliary frequency" function is programmed to 100 % stroke rate.

### 11.1.3 External contact

"Extern" operating mode:

In the Extern Contact operating mode, either a series of strokes can be triggered or an inbound series of contacts can be stepped down via the pulse control switch by a single contact on the "External control" terminal. To do so, the multifunctional switch has to be turned to "Extern".

### Explanation of the stepped-down values:

Settable values	Incoming contacts	Strokes performed
1:1	1	1
1:2	2	1
1:4	4	1
1:8	8	1
1:16	16	1
1:32	32	1
1:64	64	1

### Explanation of stepped-up values:

Settable values	Incoming contacts	Strokes performed
1:1	1	1
2:1	1	2
4:1	1	4
8:1	1	8
16:1	1	16
32:1	1	32
64:1	1	64



### 11.1.4 External analog

"External Analogue" operating mode

In "External Analogue" operating mode, the stroke rate can be controlled by an mA signal via the pulse control switch. To do so, the multifunctional switch has to be turned to "Extern".

In the same way, a single contact via the pulse control switch at the "external control" terminal can either be used to trigger a series of strokes or to step down an incoming series of contacts. To do so, the multifunctional switch has to be turned to "Extern".

### Explanation of the stepped-down values:

Settable values	Incoming contacts	Strokes performed
such as "External Analogue"	such as "External Analogue"	such as "External Analogue"
01:16	16	1
01:32	32	1
0-20 mA	-	corresponding to the mA signal

### Explanation of stepped-up values:

Settable values	Incoming contacts	Strokes performed
such as "External Analogue"	such as "External Analogue"	such as "External Analogue"
16:1	1	16
32:1	1	32
4-20 mA	-	corresponding to the mA signal

### 11.2 Remote operation

There is an option to control the pump remotely via a signal cable - refer to your system documentation and to "Electrical Installation".

### 12 Maintenance



#### WARNING!

It is mandatory that you read the safety information and specifications in the "Storage, Transport and Unpacking" chapter prior to shipping the pump.



### WARNING!

### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



### **CAUTION!**

### Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.



Third party spare parts for the pumps may lead to problems when pumping.

- Use only original spare parts.
- Use the correct spare parts kits. In the event of doubt, refer to the exploded views and ordering information in the appendix.

### Standard liquid ends:

Interval	Maintenance work	Personnel
Quarterly*	<ul> <li>Check the metering diaphragm for damage** - refer to "Repair".</li> <li>Check that the hydraulic lines are fixed firmly to the liquid end.</li> <li>Check that the suction valve and discharge valve are fitted tightly.</li> <li>Check the tightness of the entire liquid end - particularly around the leakage hole - refer to \$ 'Standard liquid ends:' on page 40!</li> </ul>	Technical personnel
	<ul> <li>Check that the flow is correct: Allow the pump to prime briefly - turn the multifunctional switch briefly to "Test"</li> <li>Check that the electrical connections are intact.</li> <li>Check the integrity of the housing.</li> <li>Check that the dosing head screws are tight.</li> </ul>	

\* Under normal loading (approx. 30 % of continuous operation)

Under heavy loading (e.g. continuous operation): Shorter intervals.

\*\* Check the diaphragm frequently with feed chemicals that put particular pressure on the diaphragm, e.g. those containing abrasive additives.






Fig. 17: Leakage hole

### Liquid ends with bleed valve:

Interval	Maintenance work
Quarterly*	In addition:  Check that the bypass line is fixed firmly to the liquid end Check that the bleed valve is tight. Check the discharge and bypass line for kinks Check that the bleed valve is operating correctly.

\* Under normal loading (approx. 30 % of continuous operation)
Under heavy loading (e.g. continuous operation): Shorter intervals.

### Tightening torque

Data	Value	Unit
Tightening torque for screws:	4.5 5.0	Nm

ProMinent® E-987 41

### 13 Repairs

Safety Information



#### WARNING!

#### Danger of electric shock

Unauthorised repairs inside the pump can result in an electric shock.

For this reason, only allow a ProMinent branch or representative to perform repair inside the pump, in particular the following:

- Replacement of damaged mains connection lines
- Replacement of fuses
- Replacement of electronic control



#### WARNING!

#### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



### **WARNING!**

It is mandatory that you read the safety information and specifications in the "Storage, Transport and Unpacking" chapter prior to shipping the pump.



#### WARNING!

### Contact with the feed chemical

Parts that come into contact with the feed chemical are exposed and touched during repair work.

 Protect yourself against the feed chemical in case it is hazardous. Read the safety data sheet on the feed chemical.



### **CAUTION!**

### Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.

Repairs that may be carried out by qualified technical personnel, in accordance with the operating instructions:

- Cleaning valves
- Replacing the diaphragm

All other repairs: Contact the responsible ProMinent branch!



43

### 13.1 Cleaning valves

### Warning of faulty operation

Refer to the exploded drawings in the appendix when working on the unit.

Cleaning a discharge valve or a suction valve on types (PP, PV, NP) 1000, 1601, 1602, 1604, 2504



#### Warning of faulty operation

- Discharge and suction valves differ from each other!
   Only take them apart one after each other, so that you do not confuse the components!
- Only use new components which fit your valve both in terms of shape and chemical resistance!
- Recalibrate the pump after replacing a valve!
- Using an Allen key or similar, insert it into the smaller hole of the discharge connector and push the valve inserts out of it.

A suction valve is constructed in almost the same way as a discharge valve.

Please note, however, that:

- the two valve inserts are identical here
- There is an additional spacer between the valve inserts.
- There is a shaped seal in the dosing head instead of an O-ring.
- The flow direction of the suction connector is the opposite to that of the discharge connector.

Cleaning a discharge valve or a suction valve on types (PP, PV, NP) 0708, 1008, 0220, 0420, 0413, 0713, 0232



### Warning of faulty operation

- Discharge and suction valves differ from each other!
   Only take them apart one after each other, so that you do not confuse the components!
- Only use new components which fit your valve both in terms of shape and chemical resistance!
- With the PVT material version, the ball seat is integrated in the dosing head and so has to be cleaned separately!
- On the PVT material version, the discharge valve is a double ball valve!
- Using an Allen key or similar, insert it into the smaller hole of the discharge connector and push the valve inserts out of it.

A suction valve is constructed in almost the same way as a discharge valve.

Please note, however, that:

The flow direction of the suction connector is the opposite to that of the discharge connector.

ProMinent® E-989

### 13.2 Replacing the diaphragm

#### WARNING!

A little feed chemical may have accumulated behind the diaphragm in the backplate following a leak - depending on the design!

- Take this feed chemical into consideration when you are planning a repair - especially if it is hazardous!
- If necessary take protective measures.
- Adhere to the material safety data sheet for the feed chemical.
- Ensure that the system is at atmospheric pressure.
- 1. Empty the liquid end (turn the liquid end upside down and allow the feed chemical to run out; flush out with a suitable medium; flush the liquid end thoroughly when using hazardous feed chemicals!)
- 2. Turn the stroke adjustment dial as far as 0% stroke length when the pump is running (the drive axle is then difficult to turn).
- 3. Switch off the pump.
- **4.** Unscrew the hydraulic connectors on the discharge and suction side.
- 5. With PP types with bleed valve: Firstly remove the bleed valve (grip), then lift off the cover of the liquid end with a screw driver.
- 6. Remove the screws (1).
- Coosen the dosing head (2) and the backplate (4) from the pump housing (6) but only loosen!
- 9. Loosen the diaphragm (3) from the drive axle with a gentle backwards turn of the dosing head (2), diaphragm (3) and backplate (4) in an anticlockwise direction.
- **10.** Unscrew the diaphragm (3) completely from the drive axle.
- 11. Remove the backplate (4) from the pump housing (6).
- 12. Check the condition of the safety diaphragm (5) and replace if necessary.
- 13. Push the safety diaphragm (5) onto the drive axle only until it lies flush with the pump housing (6) and no further!
- 14. Tentatively screw the new diaphragm (3) onto the drive axle until it can go no further.
  - ⇒ The diaphragm (3) is now sitting at the stop of the thread.
- **15.** Should this not work, remove dirt or swarf from the threads and screw the diaphragm (3) onto the drive axle correctly this time.



Ensure that the diaphragm is screwed exactly onto the drive axle otherwise the pump will subsequently not meter accurately!

- 16. Unscrew the diaphragm (3) again.
- 17. Place the backplate (4) on the pump housing (6).



# M

#### **CAUTION!**

### Leakage may become apparent at a later stage.

- Make sure that the leakage hole points downwards when the pump is installed later - please refer to !
- Place the backplate (4) immediately into the correct position on the pump housing (6)! Do not twist the backplate on the pump housing to prevent the safety diaphragm (5) becoming warped!
- 18. Place the diaphragm (3) into the backplate (4).



### **CAUTION!**

### Leakage may become apparent at a later stage.

- Do not over-tighten the diaphragm (3) in the following step!
- Ensure that the backplate (4) remains in its position so that the safety diaphragm does not become warped!
- 19. Hold the backplate (4) firmly and screw the diaphragm (3) in a clockwise direction until it is sitting tightly (the twisting resistance of the return spring can be felt).
- 20. Set the stroke length to 100%.
- **21.** Place the dosing head (2) with the screws (1) onto the diaphragm (3) and the backplate (4) ensure that the suction connector points downwards when the pump is in its subsequent fitting position.
- **22.** Gently tighten the screws (1) and then tighten them diagonally. See below for the tightening torque.
- **23.** With PP types with bleed valve: Allow the cover of the liquid end to rest in the dosing head, then press the grip on the bleed valve into the dosing head.



### **CAUTION!**

### Leakage possible

- Check the tightening torque of the screws after 24 hours of operation!
- With PP and PV dosing heads, check the tightening torque again after three months!

Tightening torque

Data	Value	Unit
Tightening torque for screws:	4.5 5.0	Nm

ProMinent® E-991 45

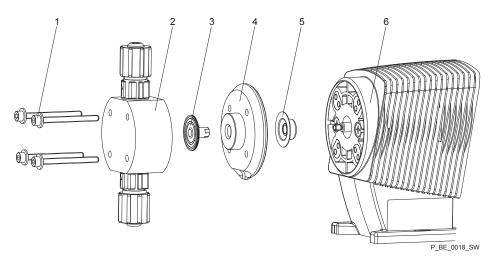


Fig. 18: Partially exploded view of liquid end

### 14 Troubleshooting

Safety Information



#### WARNING!

### Warning of dangerous or unknown feed chemical

Should a dangerous or unknown feed chemical be used: It may escape from the hydraulic components when working on the pump.

- Take appropriate protective measures before working on the pump (e.g. safety glasses, safety gloves, ...).
   Observe the safety data sheet for the feed chemical.
- Drain and flush the liquid end before working on the pump.



### **WARNING!**

#### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



### **CAUTION!**

### Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.

### 14.1 Faults without a fault message

Fault description	Cause	Remedy	Personnel
Pump does not prime in spite of full stroke motion and bleeding.	Minor crystalline deposits on the ball seat due to the valves drying out.	Take the suction hose out of the storage tank and thoroughly flush out the liquid end.	Technical personnel
	Serious crystalline deposits on the ball seat due to the valves drying out.	Dismantle the valves and clean them - refer to "Repair"	Technical personnel
Fluid is escaping from the backplate.	The screws in the dosing head are too loose.	Tighten the screws in the dosing head crosswise - refer to "Repair" for tightening torque.	Instructed personnel
	The diaphragm is not leak-tight.	Replace the diaphragm - refer to "Repair".	Technical personnel
Green LED display (operating indicator) does not light up.	The wrong mains voltage or no mains voltage is connected.	Connect the pump correctly to the specified mains voltage - according to the specification on the nameplate	Electrician

ProMinent® E-993

### 14.2 Fault messages

Fault description	Cause	Remedy	Personnel
Red LED indicator (fault indicator) lights up and the	The fluid level in the storage tank has reached "Liquid level low 2nd stage".	Fill the storage tank.	Instructed personnel
pump stops	The pump is in "External Analogue" operating mode and the control current has risen above 23 mA (fault signal).	Clear the cause of the fault on the pump.	
	The pump is in "External Analogue" operating mode, set to "4-20 mA" and the control current has fallen below 4 mA.	Clear the cause of the low control current (e.g. cable break).	
	The multifunctional switch is not turned to "Extern" but an external cable is connected and the pump has the identity code feature "Control type" - "1" "with lock".	Either turn the multifunc- tional switch to "Extern" or remove the Extern cable from the pump	Technical personnel

### 14.3 Warning messages

Fault description	Cause	Remedy	Personnel
Yellow LED indicator (warning indicator) lights up	The fluid level in the storage tank has reached "Liquid level low 1st stage".	Fill the storage tank.	Instructed personnel

### 14.4 All Other Faults

Please contact the responsible ProMinent branch or representative!



### 15 Decommissioning

### Decommissioning



#### WARNING!

#### Danger from chemical residues

There is normally chemical residue in the liquid end and on the housing after operation. This chemical residue could be hazardous to people.

- It is mandatory that the safety notes in the "Storage, Transport and Unpacking" chapter are read before shipping or transport.
- Thoroughly clean the liquid end and the housing of chemicals and dirt. Adhere to the material safety data sheet for the feed chemical.



#### **WARNING!**

### Warning of dangerous or unknown feed chemical

Should a dangerous or unknown feed chemical be used: It may escape from the hydraulic components when working on the pump.

- Take appropriate protective measures before working on the pump (e.g. safety glasses, safety gloves, ...).
   Observe the safety data sheet for the feed chemical.
- Drain and flush the liquid end before working on the pump.



### WARNING!

#### Fire hazard with flammable media

Only with combustible media: These may start to burn when combined with oxygen.

 During filling and draining of the liquid end, an expert must ensure that feed chemical does not come into contact with oxygen.



#### **CAUTION!**

### Warning of feed chemical spraying around

Feed chemical can spray out of the hydraulic components if they are manipulated or opened due to pressure in the liquid end and adjacent parts of the system.

- Disconnect the pump from the mains power supply and ensure that it cannot be switched on again by unauthorised persons.
- Depressurise the system before commencing any work on hydraulic parts.



### Danger of damage to the device

Take into account the information in the "Storage, Transport and Unpacking" chapter if the system is decommissioned for a temporary period.

- 1. Disconnect the pump from the mains/power supply.
- 2. Drain the liquid end by turning the pump upside down and allowing the feed chemical to run out.

ProMinent® E-995

**3.** Flush the liquid end with a suitable medium; flush the dosing head thoroughly when using hazardous feed chemicals!

### Disposal



### **CAUTION!**

### Environmental hazard due to electronic waste

There are electronic components in the pump, which can have a toxic effect on the environment.

- Separate the electronic components from the remaining parts.
- Note the pertinent regulations currently applicable in your country!



### 16 Technical data

### 16.1 Performance data

Beta b operating at 180 strokes/minute and 100% stroke length

Type	Minimum	numn se-	The Addition of the Addition o							
Туре	Minimum pump capacity at maximum back pressure		Minimum pump capacity at medium back pressure		Connection size outside Ø x inside Ø	Suction lift*	Priming lift**	Max- imum priming pressure on suc- tion side		
	bar	l/h	ml/ stroke	bar	l/h	ml/ stroke	mm	m WS	m WS	bar
Beta b										
1000	10	0.74	0.069	5.0	0.82	0.076	6x4	6.0	1.8	8
0700	7	0.8	0.074	3.5	0.88	0.074	6x4	6.0	1.8	8
0400	4	0.84	0.078	2.0	0.92	0.078	6x4	6.0	1.8	8
2001	20	0.96	0.089	10	1.5	0.13	6x3	6.0	2.0	8
1601	16	1.1	0.10	8.0	1.40	0.13	6x4	6.0	2.0	8
1001	10	1.3	0.12	5.0	1.5	0.14	6x4	6.0	2.0	8
0701	7	1.4	0.13	3.5	1.7	0.14	6x4	6.0	2.0	8
0401	4	1.5	0.14	2.0	2.0	0.18	6x4	6.0	2.0	8
2002	20	1.7	0.16	10	2.8	0.26	6x3	6.0	2.5	5.5
1602	16	2.2	0.20	8.0	2.5	0.24	6x4	6.0	2.5	5.5
1002	10	2.4	0.22	5.0	2.8	0.26	6x4	6.0	2.5	5.5
0702	7	2.6	0.24	3.5	3.1	0.29	6x4	6.0	2.5	5.5
0402	4	2.8	0.26	2.0	3.6	0.36	6x4	6.0	2.5	5.5
1604	16	3.6	0.33	8.0	4.3	0.40	6x4	5.0	3.0	3
1004	10	3.9	0.36	5.0	4.7	0.44	6x4	5.0	3.0	3
0704	7	4.2	0.39	3.5	5.1	0.47	6x4	5.0	3.0	3
0404	4	4.5	0.42	2.0	5.6	0.52	6x4	5.0	3.0	3
0708	7	7.1	0.66	3.5	8.4	0.78	8x5	4.0	2.0	2
0408	4	8.3	0.77	2	10.0	0.93	8x5	4.0	2.0	2
0413	4	12.3	1.14	2.0	14.2	1.31	8x5	3.0	2.5	1.5
0220	2	19.0	1.76	1.0	20.9	1.94	12x9	2.0	2.0	1
2504	25	2.9	0.27	12.5	3.7	0.34	8x4 <sup>1</sup>	4.0	3.0	3
1605	16	4.1	0.38	8.0	4.9	0.45	8x5	4.0	3.0	3
1008	10	6.8	0.63	5.0	8.3	0.76	8x5	3.0	3.0	2
0713	7	11.0	1.02	3.5	13.1	1.21	8x5	3.0	3.0	1.5
0420	4	17.1	1.58	2.0	19.1	1.77	12x9	3.0	3.0	1
0232	2	32.0	2.96	1.0	36.2	3.35	12x9	2.0	2.0	0.8
Beta b M	etering pur	nps with se	lf-bleeding	dosing hea	d SEK***					
1601	16	0.59	0.055	8.0	0.80	0.072	6x4	6.0	2.0	0.5
1001	10	0.72	0.067	5.0	0.60	0.08	6x4	6.0	2.0	0.5
0701	7	0.84	0.078	3.5	1.12	0.10	6x4	6.0	2.0	0.5

ProMinent® E-997 51

Туре	Minimum pump capacity at maximum back pressure		Minimum pump capacity at medium back pressure		•	Connection size outside Ø x inside Ø	Suction lift*	Priming lift**	Max- imum priming pressure on suc- tion side	
	bar	l/h	ml/ stroke	bar	l/h	ml/ stroke	mm	m WS	m WS	bar
0401	4	0.9	0.083	2.0	1.2	0.11	6x4	6.0	2.0	0.5
2002	20	0.78	0.07	10.0	1.8	0.17	6x4	6.0	2.5	0.5
1602	16	1.40	0.13	8.0	1.70	0.16	6x4	6.0	2.5	0.5
1002	10	1.7	0.16	5.0	2.0	0.18	6x4	6.0	2.5	0.5
0702	7	1.8	0.17	3.5	2.2	0.20	6x4	6.0	2.5	0.5
0402	4	2.1	0.19	2.0	2.5	0.23	6x4	6.0	2.5	0.5
1604	16	2.7	0.25	8.0	3.6	0.33	6x4	6.0	3.0	0.5
1004	10	3.3	0.30	5.0	3.9	0.36	6x4	6.0	3.0	0.5
0704	7	3.6	0.33	3.5	4.0	0.37	6x4	6.0	3.0	0.5
0404	4	3.9	0.36	2.0	4.2	0.39	6x4	6.0	3.0	0.5
0708	7	6.60	0.61	3.5	7.50	0.69	8x5	6.0	2.0	0.5
0408	4	7.5	0.64	2.0	8.1	0.77	8x5	6.0	2.0	0.5
0413	4	10.8	1.0	2.0	12.6	1.17	8x5	6.0	2.5	0.5
0220	2	16.2	1.5	1.0	18.0	1.67	12x9	6.0	2.0	0.5
1008	10	6.3	0.58	5.0	7.5	0.69	8x5	6.0	3.0	0.5
0713	7	10.5	0.97	3.5	12.3	1.14	8x5	6.0	2.5	0.5
0420	4	15.6	1.44	2.0	17.4	1.61	12x9	6.0	2.5	0.5
Beta b me	etering pum	ps with sel	f-bleeding o	losing head	SER****					
1002	10	1.40	0.13	8.0	1.70	0.174	6x4	6.0	1.8	0.5
1004	10	2.7	0.25	8.0	3.6	0.33	6x4	6.0	1.8	0.5
0708	7	6.60	0.61	3.5	7.50	0.69	8x5	6.0	1.8	0.5
0413	4	10.8	1.0	2.0	12.6	1.17	8x5	6.0	1.8	0.5
0220	2	16.2	1.5	1.0	18.0	1.67	12x9	6.0	2.0	0.5
1008	10	6.3	0.58	5.0	7.5	0.69	8x5	6.0	1.8	0.5
0713	7	10.5	0.97	3.5	12.3	1.14	8x5	6.0	1.8	0.5
0420	4	15.6	1.44	2.0	17.4	1.61	12x9	6.0	1.8	0.5



- Suction lift with a filled suction line and filled liquid end. With selfbleeding dosing head with air in the suction line.
- \*\* Priming lift with clean and moist valves. Priming lift at 100% stroke length and free outlet or opened bleed valve.
- \*\*\* The given performance data constitutes guaranteed minimum values, calculated using water as the medium at room temperature. The bypass connection with a self-bleeding dosing head SEK is 6x4 mm.
- \*\*\* The given performance data constitutes guaranteed minimum values, calculated using water as the medium at room temperature.
- The connector width is 6 mm on SST material versions.

Beta b Metering pumps with dosing heads for higher-viscosity media (HV) have a 10-20% lower capacity and are not self-priming. Connection G 3/4-DN 10 with hose nozzle d16-DN10.

### 16.2 Accuracy

### 16.2.1 Standard Liquid End

Data	Value	Unit
Capacity range of the series	-5 <b>+10</b>	% *
Reproducibility	±2	% **

- at max. stroke length and max. operating pressure for all material versions
- \*\* at constant conditions and min. 30 % stroke length

### 16.2.2 Self-Bleeding Liquid End

As the self-bleeding liquid end is used with outgassing media and when operating with air bubbles, no dosing accuracy or reproducibility can be provided.

The recommended minimum stroke length with self-bleeding dosing pumps is 50 %.

### 16.3 Viscosity

The liquid ends are suitable for the following viscosity ranges:

Version	Range	Unit
standard	0 200	mPas
With valve springs	200 500	mPas
Self-bleeding (SEK)	0 50	mPas
HV (highly viscous)	500 3000*	mPas

<sup>\*</sup> Only when the installation is correctly adjusted

### 16.4 Material Data

Standard liquid ends

Version	Dosing head	Suction/Dis- charge con- nector	Seals	Valve balls
PPE	Polypropy- lene	Polypropy- lene	EPDM	Ceramic
PPB	Polypropy- lene	Polypropy- lene	FPM	Ceramic
PPT	Polypropy- lene	PVDF	PTFE	Ceramic
NPE	Acrylic glass	PVC	EPDM	Ceramic
NPB	Acrylic glass	PVC	FPM	Ceramic
NPT	Acrylic glass	PVDF	PTFE	Ceramic
PVT	PVDF	PVDF	PTFE	Ceramic
TTT	PTFE with carbon	PTFE with carbon	PTFE	Ceramic
SST	Stainless steel 1.4404	Stainless steel 1.4404	PTFE	Ceramic

Only the self-bleeding version in PPE, PPB, NPE and NPB material models with a valve spring made of hastealloy C and a valve insert made of PVDF. Diaphragm with a PTFE coating.

FPM = fluororubber

Pump

Housing parts: polyphenyl ether (PPE with fibreglass)

### 16.5 Electrical data

Version: 100 - 230 V  $\pm$ 10 %, 50/60 Hz, Beta b BT4b

Data	Value	Unit
Nominal power, approx.	6.4 16.5	W
Current I eff	0.65 0.1	Α
Peak current	4.21.3	Α
Switch on peak current, (within approx. 50 ms falling)	15	A
Fuse*	0.8	AT

Version: 100 - 230 V  $\pm$ 10 %, 50/60 Hz, Beta b BT5b

Data	Value	Unit
Nominal power, approx.	20 25	W
Current I eff	0.9 0.3	Α
Peak current	5.9 2.3	Α
Switch on peak current, (within approx. 50 ms falling)	15	Α
Fuse*	0.8	AT

 $<sup>^{\</sup>star}$  Fuses must have VDE, UL and CSA certification. E.G. type 19195 manufactured by Wickmann in compliance with IEC Publ. 127 - 2/3.



### Power consumption

Туре	Perform- ance	Туре	Perform- ance	Туре	Perform- ance
	W		W		W
1000	7.6	1602	12.2	0408	12.7
0700	6.4	1002	10.6	0413	16.5
0400	5.7	0702	9.3	0220	16.5
2001	10.5	0402	7.9	2504	21.2
1601	10.0	1604	16.5	1008	20.3
1001	8.3	1004	12.7	0713	21.2
0701	7.5	0704	11.1	0420	21.2
0401	6.9	0404	9.5	0232	24.9
2002	13.5	0708	16.5		

## Design: 12 - 24 VDC# -8/+24 %, identity code M

Parameter	Beta b BT4b
Nominal power, approx.	17.4 W.
Nominal current (averaged at 180 H/min)	3.9 1.9 A.
Peak current	15.6 8.7 A.
closed current (no stroke)	32 24 mA.
Fuse*	5 AT

# SELV in accordance with EN 60335-1

<sup>\* 5</sup> AT, 5x20 mm, order no. 712028



The pump only works if the polarity is correct.

Design: 24 VDC# -15/+24 %, identity code N

Parameter	Beta b BT5b
Nominal power, approx.	24.4 W.
Nominal current (averaged at 180 H/min)	2.5 A.
Peak current	11.7 A.
Closed current (no stroke)	24 mA.
Fuse*	5 AT

# SELV in accordance with EN 60335-1

<sup>\* 5</sup> AT, 5x20 mm, order no. 712028



The pump only works if the polarity is correct.

55

ProMinent<sup>®</sup>

### 16.6 Temperatures

### Pump, fully assembled

Data	Value	Unit
Storage and transport temperature:	-10 +50	°C
Ambient temperature in operation (power end/drive and control):	-10 +45	°C

### Liquid end, long-term\*

### Maximum temperature, liquid end

Material version	Value	Unit
PP	50	°C
NP	40	°C
PV	50	°C
TT	50	°C
SS	50	°C

 $<sup>^{\</sup>star}$  long term at max. operating pressure, dependent on the ambient temperature and the feed chemical temperature

### Minimum temperature, liquid end

### Minimum temperature, liquid end

Material version	Value	Unit
All	-10	°C

### Liquid end, short-term\*

### Maximum temperature, liquid end

Material version	Value	Unit
PPT	100	°C
NPT	60	°C
PVT	120	°C
TTT	120	°C
SST	120	°C

<sup>\*</sup> Temp. max., for 15 min at max. 2 bar, dependent on the ambient and feed chemical temperatures

### 16.7 Climate

Data	Value	Unit
Maximum air humidity *:	95	% rel. humidity

<sup>\*</sup> non-condensing

Exposure in a humid and alternating climate:

FW 24 according to DIN 50016



### 16.8 Degree of Protection and Safety Requirements

**Degree of protection** Protection against accidental contact and humidity:

IP 65 according to DIN EN 60529

Safety requirements Degree of protection:

1 - mains power connection with protective earth conductor

### 16.9 Compatibility

Some hydraulic parts of the Beta  $^{\rm @}$  b are identical to those of the Beta  $^{\rm @}$  a, gamma/ L and delta  $^{\rm @}$  .

There is most compatibility with pumps of the Beta®a, gamma/L and delta® series with the following components and accessories:

- Signal cable gamma/Vario 2-, 4- and 5-wire for the "Extern" function
- Level switch 2-stage (gamma / Vario / Beta®)
- Dosing line cross-sections
- Standard gamma connector kit
- Chemical feed container
- Overall height (distance between the suction and discharge connector)
- Same use of accessories, such as back pressure valves, multifunctional valves, dosing monitor and flushing equipment

### 16.10 Sound pressure level

Sound pressure level

Sound pressure level LpA < 70 dB according to EN ISO 20361

at maximum stroke length, maximum stroke rate, maximum back pressure (water)

### 16.11 Shipping weight


Shipping weight of Beta b types - in kg

Material	BT4b					BT5b			
	1000, 0700, 0400	2001, 1601, 1001, 0701, 0401	2002, 1602, 1002, 0702, 0402	1604, 1004, 0704, 0404	0708, 0408, 0413	0220	2504, 1008, 0713	0420	0232
PP, NP, PV, TT	2.5	2.9	2.9	3.1	3.1	3.3	4.5	4.7	5.1
SS	3.0	3.6	3.6	3.9	3.9	4.4	5.3	5.8	6.6

## 17 Dimensional drawings

- Compare the dimensions on the dimensional drawing and pump.
- All dimensions are in mm.

## Dimensional drawing Beta b, material version PP






Fig. 19: Dimension drawing Beta b BT4b/BT5b, material version PP - dimensions in mm

	1000 - 1604	0708 - 0220	1008 - 0420	0232
E	19.5	7	14	1.5
F	179	186.5	191.5	200.5
K	71	77.5	74	77.5
L	105.5	111	107.5	94.5
M	Ø 70	Ø 90	Ø 90	Ø 110

# Dimensional drawing Beta b, material version PP

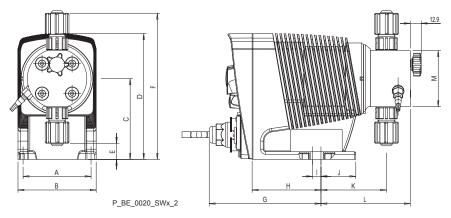


Fig. 20: Dimension drawing Beta b BT4b/BT5b, material version PP - dimensions in mm

	1000 - 1604	0708 - 0220	2504	1008 - 0420	0232
Α	80	80	80	80	80
В	92	92	102	102	102
С	95	95	101	101	101
D	148	148	153	153	153
E	19	7.2	24.6	14	3.2
F	172	182.8	178.4	188	198.8
G	131.5	131.5	148.6	148.6	148.6
Н	81	81	100	100	100
I	10	10	15	15	15
J	41	41	36	36	36
K	77	77.5	77.1	74.1	76
L	105	105.5	105.1	102.1	104.5
M	Ø 70	Ø 90	Ø 70	Ø 90	Ø 110

E-1005

### Dimensional drawings

## Dimensional drawing Beta b, material version PP and NP SEK

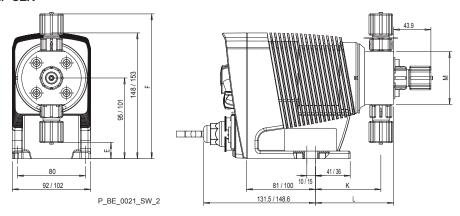


Fig. 21: Dimensional drawing Beta b BT4b/BT5b, material versions PP and NP with self-bleeding dosing head SEK - dimensions in mm

	1604	0708 - 0220	1008 - 0232
E	19	7.5	13.6
F	170.5	182.5	188.4
K	77	74	74
L	92	105.5	89
M	Ø 70	Ø 90	Ø 90

# Dimensional drawing Beta b, material version PV

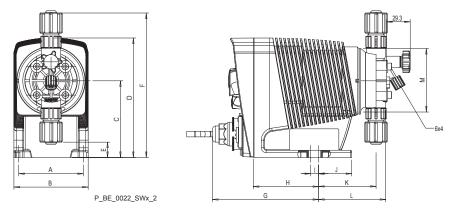


Fig. 22: Dimension drawing Beta b BT4b/BT5b, material version PV - dimensions in mm

	1604	0708 - 0220	1008 - 0420	0232
Α	80	80	80	80
В	92	92	102	102
С	95	95	101	101
D	148	148	153	153
E	19	8.1	14.1	3.2
F	179	185.5	191.5	199
G	131.5	131.5	148.5	148.5
Н	81	81	100	100
I	10	10	15	15
J	41	41	36	36
K	71	73	73	76
L	83	90	90	93
M	Ø 70	Ø 90	Ø 90	Ø 110

E-1007

## Dimensional drawing Beta b, material version PV HV

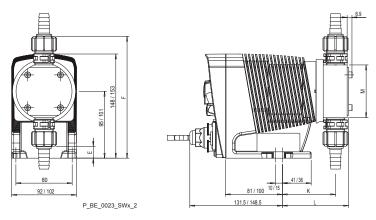


Fig. 23: Dimensional drawing Beta b BT4b/BT5b, material version PV for highly viscous feed chemicals - dimensions in mm

	1604	0708 - 0413	0220	1008 - 0713	0420
E	17	13	13	22.8	19
F	173	177	177	179.2	183
K	75.5	77	77	75.5	78.5
L	94	95	95	94	96.5
M	Ø 70	Ø 80	Ø 85	Ø 85	Ø 85

## Dimensional drawing Beta b, material version TT

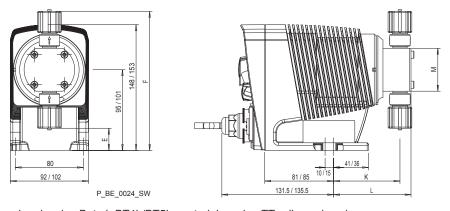


Fig. 24: Dimension drawing Beta b BT4b/BT5b, material version TT - dimensions in mm

	1000 - 1601	1602 - 1604	0708 - 0220	1008 - 0420	0232
E	26.2	21.3	-13.2	-7.2	-14.2
F	163.7	168.8	202.7	208.7	215.7
K	78	72	77	77.1	78
L	91	86	94	94	97
M	Ø 60	Ø 70	Ø 85	Ø 85	Ø 100

## Dimensional drawing Beta b, material version SS

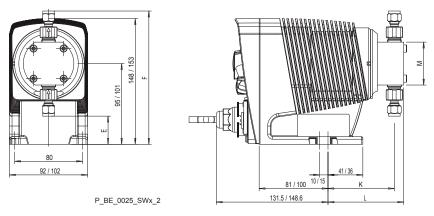


Fig. 25: Dimensional drawing Beta b BT4b/BT5b, material version SS - dimensions in mm

	1000 - 1601	1602 - 1604	0708 - 0220	2504	1008 - 0420	0232
E	33.2	24.4	-7.8	31.7	-1.8	-8
F	156.9	165.6	197.3	170.4	203.3	210
K	78	75	82	72	77	78
L	89	87	97	84	92	95
M	Ø 60	Ø 70	Ø 85	Ø 70	Ø 85	Ø 110

ProMinent® E-1009 63

### 18 Diagrams for setting the metering capacity

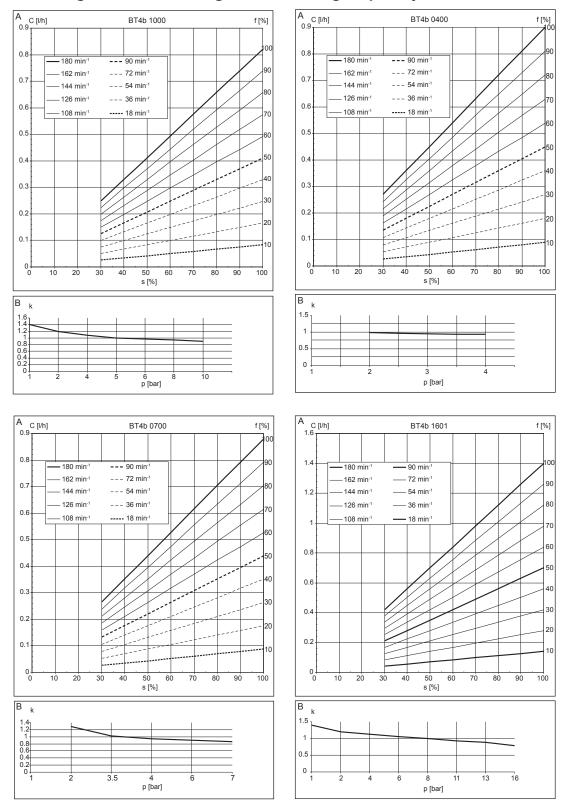


Fig. 26: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

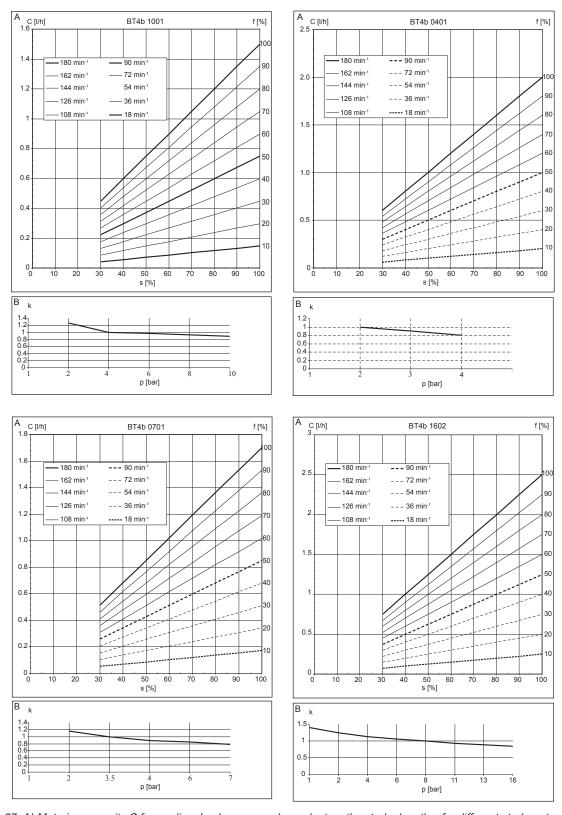


Fig. 27: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

ProMinent® E-1011 65

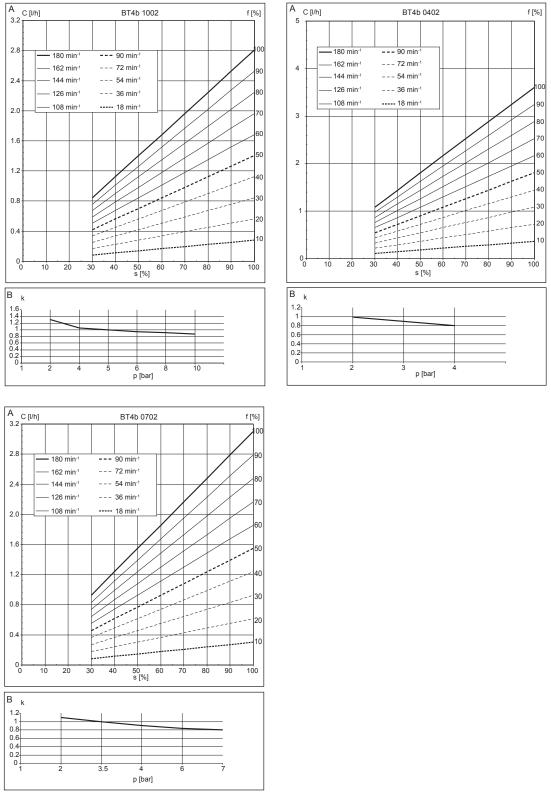


Fig. 28: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

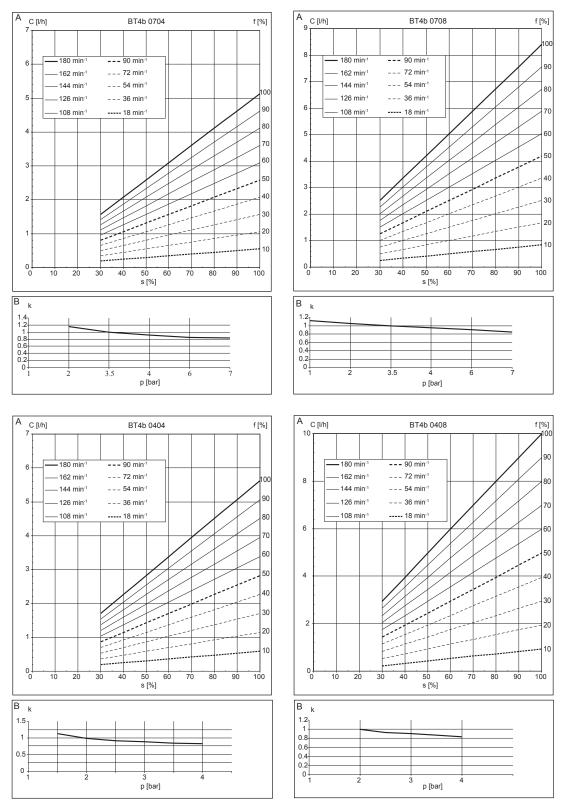


Fig. 29: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

ProMinent® E-1013 67

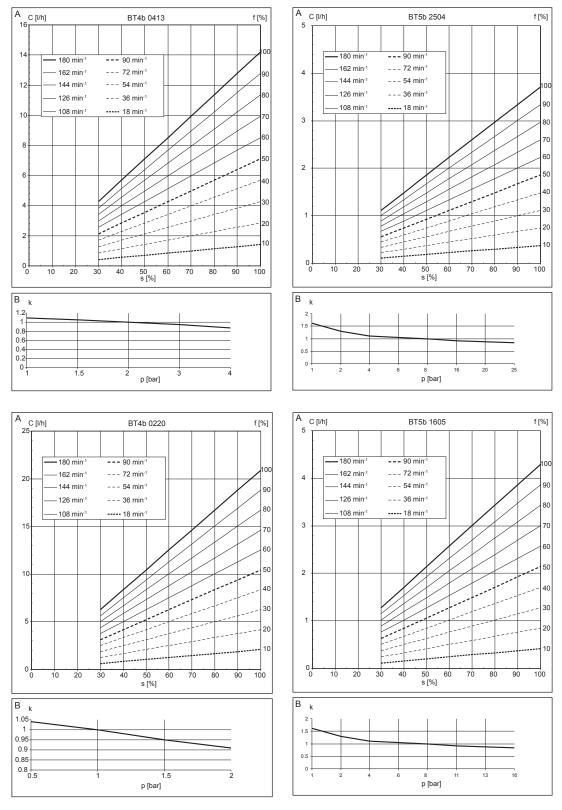


Fig. 30: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

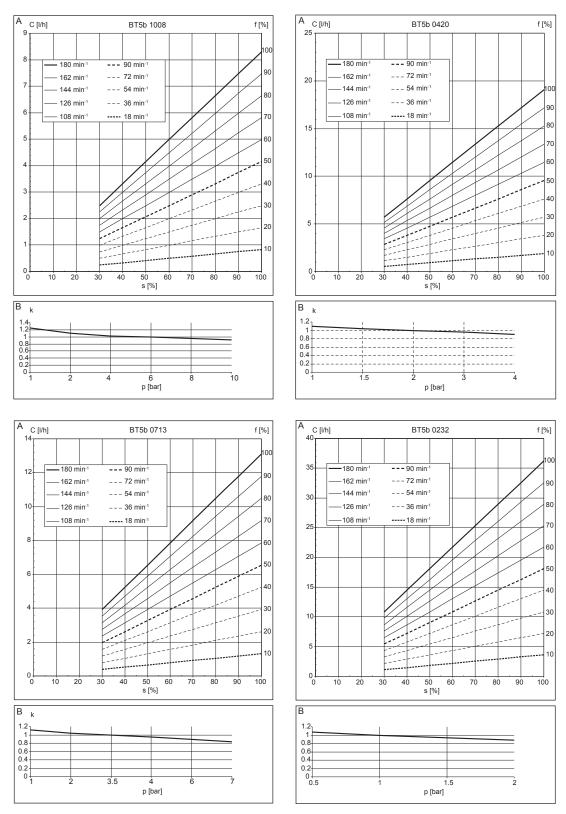


Fig. 31: A) Metering capacity C for medium back pressure dependent on the stroke length s for different stroke rates f. B) Corresponding correction factors k dependent on back pressure p.

ProMinent® E-1015

69

Liquid end Beta® 1000 - 1604 PP with bleed valve

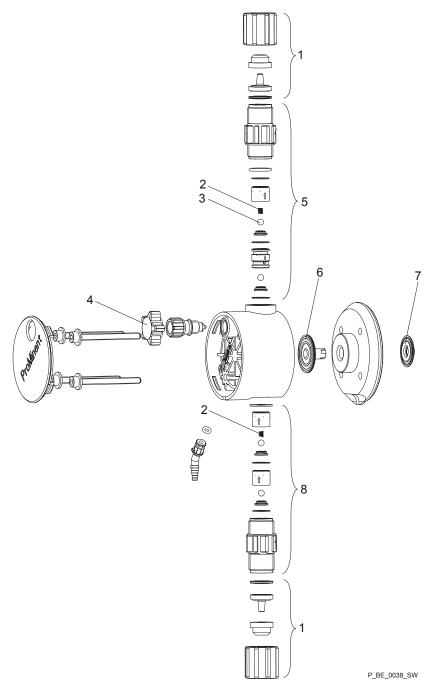


Fig. 32

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
1	Connector kit 6/4 PVT	1023246	1023246	1023246	1023246
3	4 Valve balls	404201	404201	404201	404201
4	Bleed valve	1021662	1021662	1021662	1021662

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
5	Discharge valve, compl. 4.7-2 PVT	1023127	1023127	1023127	1023127
6	Diaphragm	1000244	1000245	1000246	1034612
7	Safety diaphragm	1006061	1006061	1006061	1006061
8	Suction valve, compl. 4.7-2 PVT	1023128	1023128	1023128	1023128

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1017 71

Liquid end Beta® 0708 (1008) - 0220 (0420) PP with bleed valve

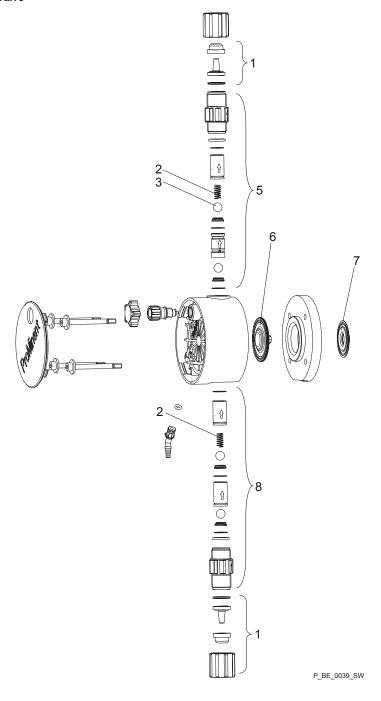


Fig. 33

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
1	Connector kit 8/5 PVT	1023247	1023247	1023247
3	4 Valve balls	404281	404281	404281
4	Bleed valve	1021662	1021662	1021662
5	Discharge valve, compl. 9.2-2 PVT	1023125	1023125	1023125

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
6	Diaphragm	1000248	1000249	1000250
7	Safety diaphragm	1006061	1006061	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126	1023126	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent<sup>®</sup> E-1019 73

# Liquid end Beta® 0232 PP without bleed valve

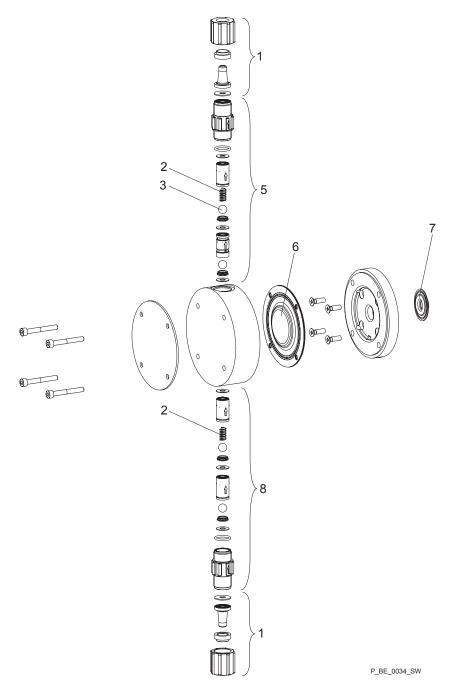


Fig. 34

Item	Description	Type 0232
1	Connector kit 12/9 PVT	1023248
3	4 Valve balls	404281
5	Discharge valve, compl. 9.2-2 PVT	1023125
6	Diaphragm	1000251

Item	Description	Type 0232
7	Safety diaphragm	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent<sup>®</sup> E-1021 75

## Liquid end Beta® 1000 - 1604 NP with and without bleed valve

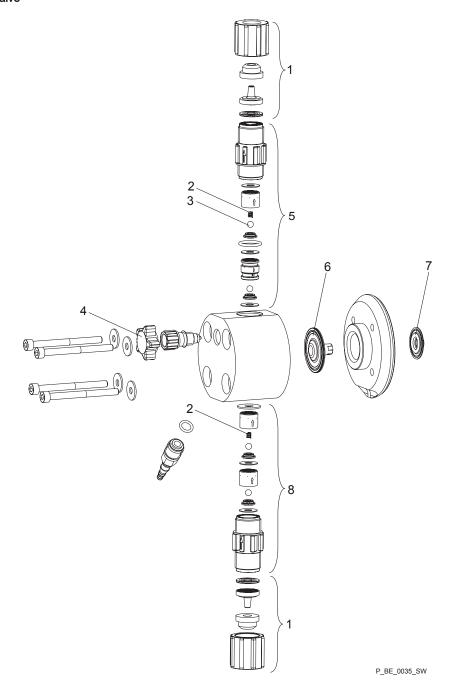


Fig. 35

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
1	Connector kit 6/4 PVT	1023246	1023246	1023246	1023246
3	4 Valve balls	404201	404201	404201	404201
4	Bleed valve	1021662	1021662	1021662	1021662
5	Discharge valve, compl. 4.7-2 PVT	1023127	1023127	1023127	1023127

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
6	Diaphragm	1000244	1000245	1000246	1034612
7	Safety diaphragm	1006061	1006061	1006061	1006061
8	Suction valve, compl. 4.7-2 PVT	1023128	1023128	1023128	1023128

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1023 77

Liquid end Beta® 0708 (1008) - 0220 (0420) NP with and without bleed valve

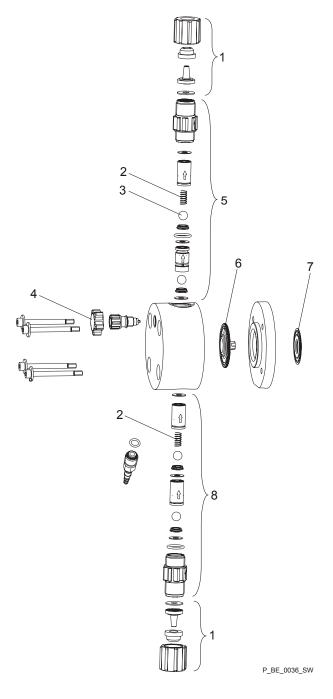


Fig. 36

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
1	Connector kit 8/5 PVT	1023247	1023247	1023247
3	4 Valve balls	404281	404281	404281
4	Bleed valve	1021662	1021662	1021662
5	Discharge valve, compl. 9.2-2 PVT	1023125	1023125	1023125

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
6	Diaphragm	1000248	1000249	1000250
7	Safety diaphragm	1006061	1006061	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126	1023126	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

**ProMinent**° E-1025 79

## Liquid end Beta® 0232 NP with and without bleed valve

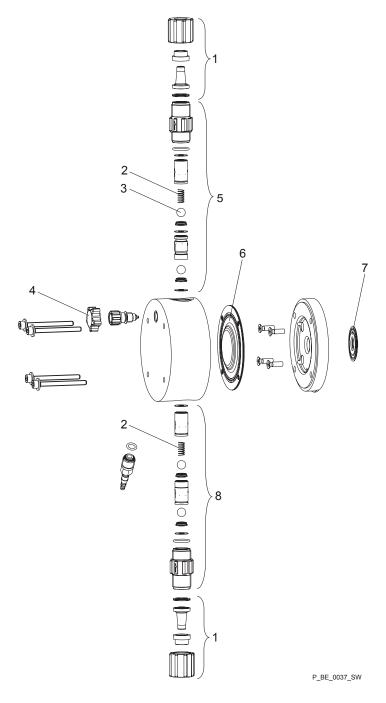


Fig. 37

Item	Description	Type 0232
1	Connector kit 12/9 PVT	1023248
3	4 Valve balls	404281
5	Discharge valve, compl. 9.2-2 PVT	1023125
6	Diaphragm	1000251

Item	Description	Type 0232
7	Safety diaphragm	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1027 81

## Liquid end Beta® 1000 - 1604 PV with bleed valve

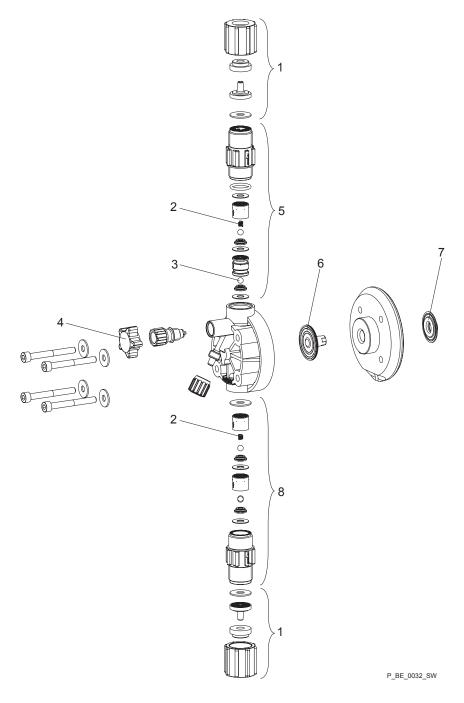


Fig. 38

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
1	Connector kit 6/4 PVT	1035660	1035660	1035660	1035660
3	4 Valve balls	404201	404201	404201	404201
4	Bleed valve	1021662	1021662	1021662	1021662
5	Discharge valve, compl. 4.7-2 PVT	1023127	1023127	1023127	1023127

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
6	Diaphragm	1000244	1000245	1000246	1034612
7	Safety diaphragm	1006061	1006061	1006061	1006061
8	Suction valve, compl. 4.7-2 PVT	1023128	1023128	1023128	1023128

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1029 83

Liquid end Beta® 0708 (1008) - 0220 (0420) PV with bleed valve

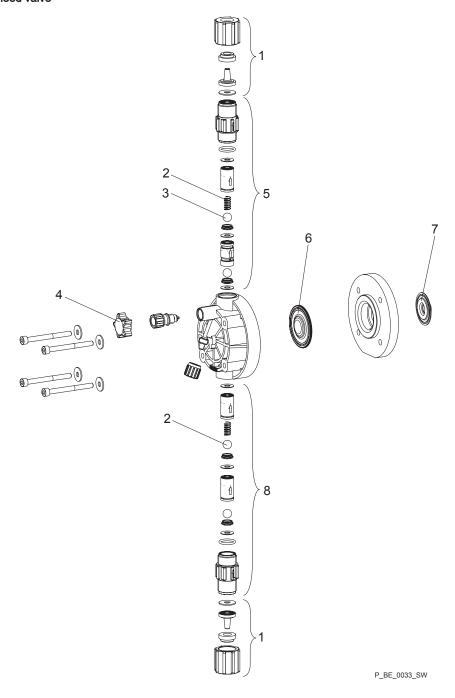


Fig. 39

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
1	Connector kit 8/5 PVT (0220/0420: 12/9)	1035661	1035661	1035659
3	4 Valve balls	404281	404281	404281
4	Bleed valve	1021662	1021662	1021662
5	Discharge valve, compl. 9.2-2 PVT	1023125	1023125	1023125

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
6	Diaphragm	1000248	1000249	1000250
7	Safety diaphragm	1006061	1006061	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126	1023126	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1031 85

# Liquid end Beta® 0232 PV without bleed valve

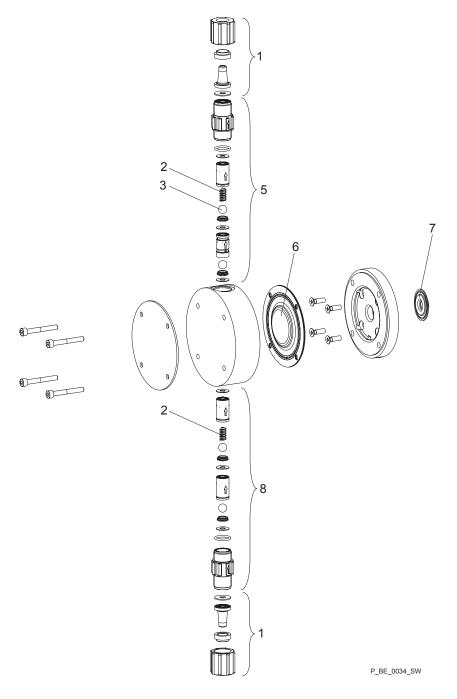


Fig. 40

Item	Description	Type 0232
1	Connector kit 12/9 FVD PVT	1035659
3	4 Valve balls	404281
5	Discharge valve, compl. 9.2-2 PVT	1023125
6	Diaphragm	1000251

Item	Description	Type 0232
7	Safety diaphragm	1006061
8	Suction valve, compl. 9.2-2 PVT	1023126

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

ProMinent® E-1033 87

Liquid end Beta® 1604 - 0220 (0420) PV HV, for highly viscous feed chemicals

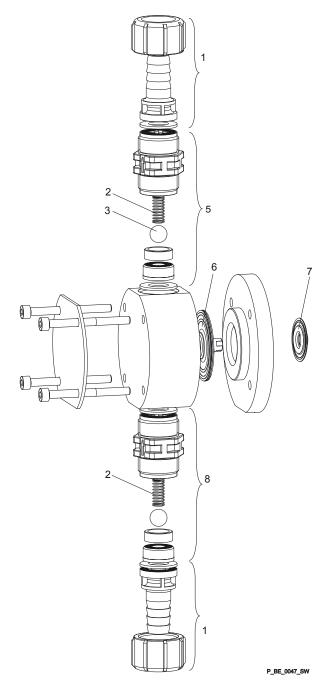


Fig. 41

Item	Description	Type 1604	Type 0708	Type 0413	Type 0220
1	Connector kit DN10 HV with PVT tube nozzle	1017405	1017405	1017405	1017405
3	4 Valve balls	404277	404277	404277	404277
6	Diaphragm	1006061	1006061	1006061	1006061
7	Safety diaphragm	1027414	1027414	1027414	1027414
The positions listed are included in the spare parts kit. Technical changes reserved.					

ProMinent

#### Liquid end Beta® 1000 - 1604 TT

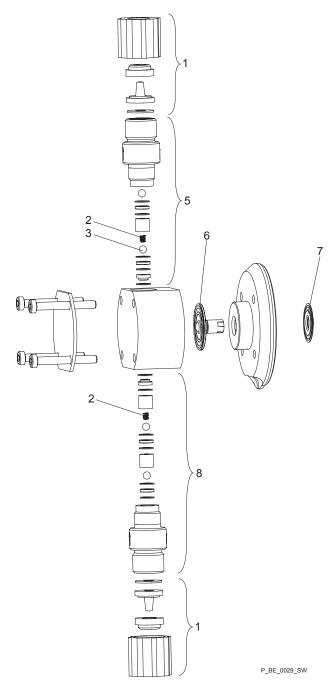


Fig. 42

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
1	Connector kit 6/4 TTT	817201	817201	817201	817201
3	4 Valve balls	404201	404201	404201	404201
5	Discharge valve, compl. 4.7-2 TTT	809406	809406	809406	809406
6	Diaphragm	1000244	1000245	1000246	1034612

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

E-1035

Item	Description	Type 1000	Type 1601	Type 1602	Type 1604
7	Safety diaphragm	1006061	1006061	1006061	1006061
8	Suction valve, compl. 4.7-2 TTT	809407	809407	809407	809407



# Liquid end Beta® 0708 (1008) - 0220 (0420) TT

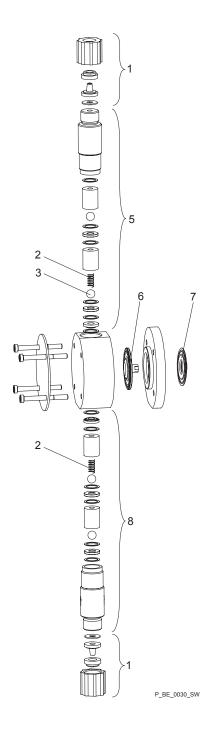


Fig. 43

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
1	Connector kit 8/5 TTT	817204	817204	817204
3	4 Valve balls	404281	404281	404281
5	Discharge valve, compl. 9.2-2 TTT	809444	809444	809444
6	Diaphragm	1000248	1000249	1000250

Spring (item 2) is a special accessory. The positions listed are included in the spare parts kit. Technical changes reserved.

E-1037

Item	Description	Type 0708 (1008)	Type 0413 (0713)	Type 0220 (0420)
7	Safety diaphragm	1006061	1006061	1006061
8	Suction valve, compl. 9.2-2 TTT	809445	809445	809445

