

Water Pumping Adaptive Management Plan

Rankin Inlet, Nunavut

Water Licence No. 3AM-GRA1015

Prepared by:

**Government of Nunavut
Community and Government Services
P.O. Box 490
Rankin Inlet, Nunavut
X0C 0G0**

Updated: February 2016

Document Management

	Description	Prepared by	Date
1	Water Pumping Adaptive Management Plan Update – <i>significant changes to all sections</i>	GN-CGS	February 2016
2	Water Pumping Adaptive Management Plan	GN-CGS	September 2015
3			
4			
5			
6			

Table of Contents

Document Management	1
1. Introduction	4
2. Seasonal Hydrological Monitoring of Char River	4
2.1 Flow and Water Depth of Char River	4
2.2 Volume Pumped from Char River	7
3. Water Chemistry Monitoring	9
3.1 Water Chemistry Data 2014.....	10
3.2 Water Chemistry Data 2015.....	10
3.3 Water Chemistry Data 2016.....	11
3.4 Water Chemistry Assessment	11
4. In-Stream Flow Objectives for Char River	11
5. Details of Char River on-going viability assessment	12
6. Mitigation options and procedures	12
7. Revised Plan	13
8. References	14
Appendixes.....	12
Appendix A – Water Licence No. 3AM-GRA1015 Amendment No. 1	12
Appendix B – Technical Memo: Char River Theoretical Rating Curves, July 20, 2015	20
Appendix C – Char River Water Pumped to Nipissar Lake 2015.....	56
Appendix D – Summary of Water Chemistry Analysis 2014	57
Appendix E – Summary of Hydrocarbon Contamination Analysis 2014	59
Appendix F – Certificate of Analysis June 24, 2014	61
Appendix G– Certificate of Analysis October 7, 2014.....	69
Appendix H – Summary of Water Chemistry Analysis 2015	84
Appendix I – Summary of Hydrocarbon Contamination Analysis 2015	87
Appendix J – Certificate of Analysis June 24, 2015	89
Appendix K – Certificate of Analysis June 30, 2015	106
Appendix L – Guidelines for Canadian Drinking Water Quality, Summary Table, October 2014	111
Appendix M – AANDC Memorandum on Nipissar Lake, Lower Landing Lake and Char River Water Chemistry Data, October 23, 2014.....	137

List of Tables

Table 1: Water Chemistry Monitoring Program Stations	9
--	---

List of Figures

Figure 1: Staff Gauge Installed at Char River	5
Figure 2: Char River Theoretical Rating Curve (from <i>Technical Memorandum: Char River Theoretical Rating Curve Based on Field Data</i> , Golder, February 16, 2016)	6
Figure 3: Side View of Flow Meter at Char River	7
Figure 4: Top View of Flow Meter at Char River	8
Figure 5: Locations of Monitoring Program Stations GRA-1, GRA-6 and GRA-7.....	9

1. Introduction

The Government of Nunavut, Community and Government Services (GN-CGS) operates the water and sewage facilities in the Hamlet of Rankin Inlet. Nipissar Lake is utilized as the potable water source with the authorized quantity of water not to exceed eight hundred and fifty thousand (850,000) cubic metres annually. Water Licence No. 3AM-GRA1015 Amendment No. 1, issued December 23, 2014, authorizes Char River as an additional water source, to a maximum allowable quantity of 3,485 cubic metres per day transferred from Char River to Nipissar Lake. A copy of Amendment No. 1 can be found in Appendix A.

As per Part C, Item 11 of Amendment No. 1, the GN-CGS is submitting to the Nunavut Water Board (NWB) a *Water Pumping Adaptive Management Plan*. This plan includes:

- a) Details of seasonal hydrological monitoring of Char River;
- b) Details of Char River, Lower Landing Lake and Nipissar Lake water chemistry monitoring and assessment of impacts on Nipissar Lake water quality/chemistry due to transfer of water from Char River;
- c) In-stream flow objectives for Char River including a flow based low cut-off limit of 10% of the instantaneous flow and 0.5 m minimum flow depth in the Char River;
- d) Details of Char River on-going viability assessment in meeting pumping objectives and water use requirements; and
- e) Mitigation options and procedures for occurrences when flow is insufficient to meet pumping objectives and consumption requirements.

2. Seasonal Hydrological Monitoring of Char River

2.1 Flow and Water Depth of Char River

Golder Associates (Golder) completed the *Technical Memorandum: Char River Theoretical Ratings Curves* found in Appendix B. The theoretical rating curves give the flow and flow depth for various cross-sections in Char River.

Golder field staff installed a staff gauge and data logger in Char River on July 10, 2015. A picture of the staff gauge in Char River can be found on the following page. Similar staff gauges and data loggers were installed in Nipissar Lake and Lower Landing Lake for additional monitoring.



Figure 1: Staff Gauge Installed at Char River

On July 13, 2015, Golder field staff demonstrated to GN-CGS staff how to remove the data loggers, download the data, and reinstall the loggers. After the data loggers were re-installed on July 13, 2015, it was supposed to remain in place until prior to freeze-up in October 2015. The data collected over the open water season would be downloaded by GN-CGS and used by Golder to calibrate the theoretical rating curves and provide accurate information on flow rates and water depths at various cross-sections in Char River.

On October 8, 2015, GN-CGS removed the data loggers from the water. Once the information was downloaded, it was apparent that the data collection had stopped on July 15, 2015. After the data was sent to Golder, they determined that their field staff had incorrectly programmed the data loggers to record at intervals of 10 seconds which caused the memory to reach capacity on July 15, 2015 rather than have enough storage space to collect information until October.

Because the data logger information could not be retroactively collected, the July 10 to 15, 2015 data and measurements taken by the Golder field staff, was used to calibrate in the final version Char River hydrological assessment. The *Technical Memorandum: Char River Theoretical Rating Curve Based on Field Data* was submitted to the NWB on February 16, 2016 as Appendix B of the *Nipissar Lake and Lower Landing Lake Water Balance Assessment*.

The technical memo states that a water depth of 0.5 m at the location of the intake corresponds to a staff gauge level of slightly below 0.6 m. Refer to the following figure for the theoretical rating curve.

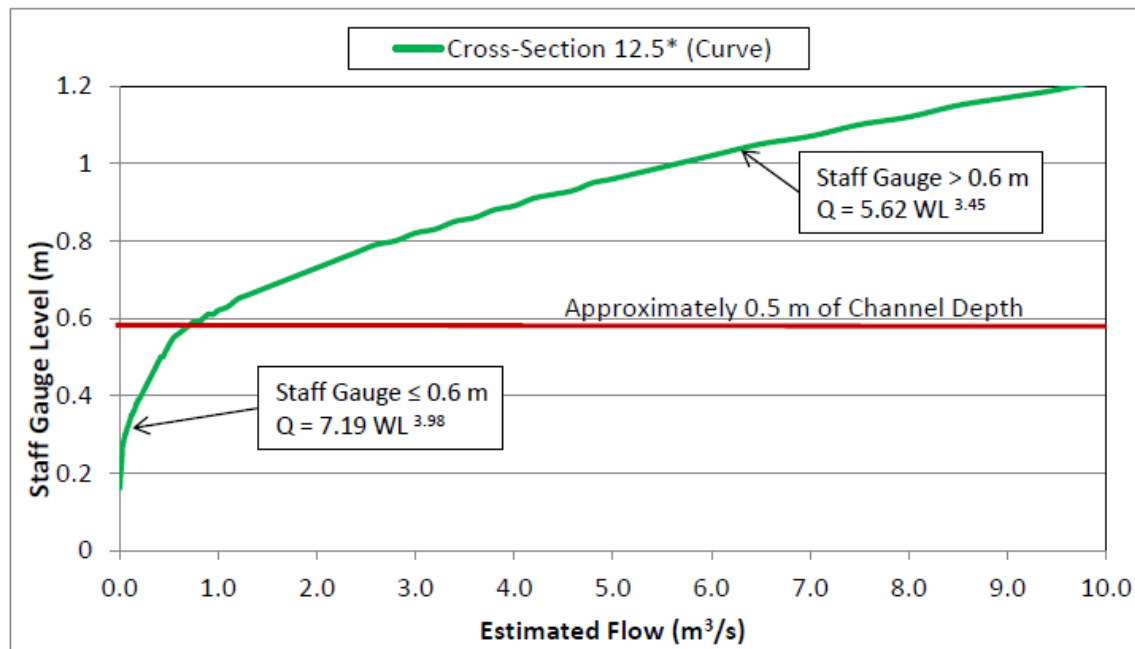


Figure 2: Char River Theoretical Rating Curve (from *Technical Memorandum: Char River Theoretical Rating Curve Based on Field Data*, Golder, February 16, 2016)

Based on the rating curve developed, a water depth of 0.5 m would result in a flow rate of approximately 0.7 m³/s. The 10% DFO flow allowance corresponding to this water depth is approximately 0.07 m³/s, which is greater than the maximum pumping capacity of the pump located at Char River of 0.04 m³/s.

On-going hydrological monitoring of Char River will be done by the annual re-installation of the data logger each spring. The data loggers will be re-programmed to record water level at a larger time interval so that they record information for the entire open water season once re-installed.

2.2 Volume Pumped from Char River

Monitoring of the volume of water pumped from Char River to Nipissar Lake is done using a flow meter installed off the pump at Char River. The flow meter was installed on June 18, 2015 prior to starting the seasonal pumping from Char River. Daily readings were taken from the flow meter and recorded on a logsheet and were provided to the NWB as part of the 2015 Third Quarter Report, and will be included in the Annual Report.

Pictures of the flow meter can be found below.



Figure 3: Side View of Flow Meter at Char River



Figure 4: Top View of Flow Meter at Char River

Pumping from Char River commenced on June 18, 2015 and was stopped on September 11, 2015. The total volume of water pumped during this 86 day period was 243,644 m³, or an average of 2833 m³/day. Large amounts of rain in July and August resulted in higher than normal water levels in Char River, allowing pumping to continue for longer than expected. A copy of the daily flow meter readings of Char River water pumped to Nipissar Lake can be found in Appendix C.

Monitoring of the flow meter will take place when water is transferred from Char River to Nipissar Lake in 2016 and future years. Daily readings will be provided to the NWB as part of the applicable Quarterly and Annual Reports.

3. Water Chemistry Monitoring

As per Part H, Item 1 of Amendment No. 1, the Monitoring Program shall include annual water chemistry sampling at Nipissar Lake, Lower Landing Lake, and Char River. The Monitoring Program Station Numbers and corresponding GPS coordinates can be found in the following table.

Table 1: Water Chemistry Monitoring Program Stations

Monitoring Program Station Number	Description	GPS Coordinates
GRA-1	Raw water supply from Nipissar Lake prior to treatment	62° 49' 24" N 92° 6' 53" W
GRA-6	Char River Water pumped to Nipissar Lake	62° 51' 35" N 92° 9' 3" W
GRA-7	Lower Landing Lake	62° 51' 59" N 92° 9' 12" W

The locations of the Nipissar Lake, Lower Landing Lake, and Char River Monitoring Program Stations are displayed in the following figure.

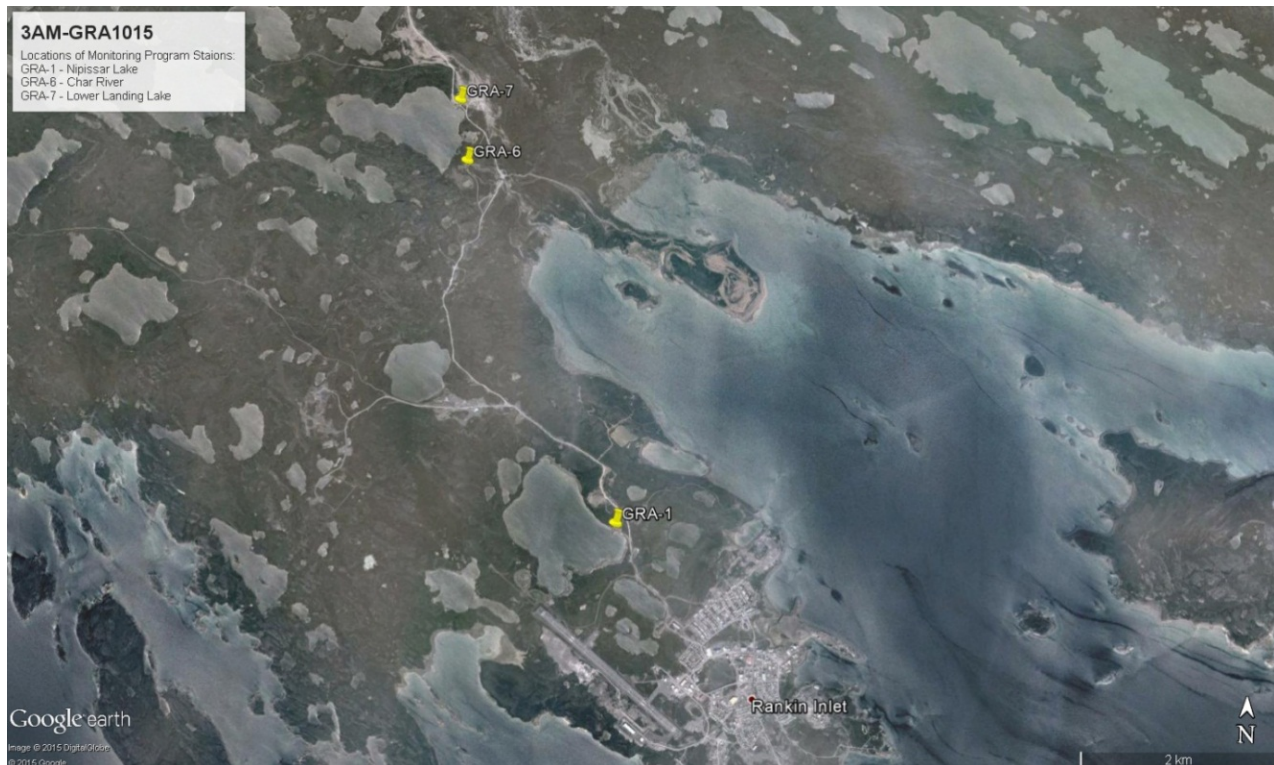


Figure 5: Locations of Monitoring Program Stations GRA-1, GRA-6 and GRA-7

3.1 Water Chemistry Data 2014

Water samples were sent to ALS Environmental in Winnipeg on June 24 and October 7, 2014. The *Summary of Water Chemistry Analysis* (Appendix D) confirms that all parameters analyzed for Nipissar Lake, Char River and Lower Landing Lake are within the maximum acceptable concentrations, as well as aesthetic objectives and operational guidance values, of the Guidelines for Canadian Drinking Water Quality.

The *Summary of Hydrocarbon Contamination Analysis* (Appendix E) confirms there is no indication of hydrocarbon presence in either Char River or Lower Landing Lake. BTEX, Total Hydrocarbon, and Polyaromatic Hydrocarbon results all came back as being under the detection limit, and within Guidelines for Canadian Drinking Water Quality.

Certificates of Analysis for these results are found in Appendix F and G.

3.2 Water Chemistry Data 2015

Water samples were collected from Nipissar Lake, Char River and Lower Landing Lake at Monitoring Program Stations GRA-1, GRA-6 and GRA-7, respectively, on June 24, 2015 and analyzed for the parameters outline in Part H, Item 14 of the Water Licence. These samples were sent to ALS Environmental in Winnipeg for analysis. The *Summary of Water Chemistry Analysis 2015* (Appendix H) confirms that all parameters analyzed for Nipissar Lake, Char River and Lower Landing Lake are within the maximum acceptable concentrations, as well as aesthetic objectives and operational guidance values, of the Guidelines for Canadian Drinking Water Quality.

The *Summary of Hydrocarbon Contamination Analysis 2015* (Appendix I) confirms there is no hydrocarbon presence in Nipissar Lake, Char River or Lower Landing Lake. BTEX, Total Hydrocarbon, and Polyaromatic Hydrocarbon results all came back as being under the detection limit, the same as results for 2014.

Certificates of Analysis for these results are found in Appendix J and K. The sample bottle for polyaromatic hydrocarbons (PAHs) from Nipissar Lake, GRA-1, broke in transit to the lab and had to be resampled.

The *Guidelines for Canadian Drinking Water Quality, October 2014* can be found in Appendix L.

3.3 Water Chemistry Data 2016

Water samples will be collected from Nipissar Lake, Char River and Lower Landing Lake at Monitoring Program Stations GRA-1, GRA-6 and GRA-7 during spring freshet 2016 (anticipated June 2016). This analysis will be included in the applicable Quarterly and Annual Reports.

3.4 Water Chemistry Assessment

The water chemistry for Nipissar Lake, Char River and Lower Landing Lake is very similar. No impacts on the water quality of Nipissar Lake are anticipated.

Aboriginal Affairs and Northern Development Canada (AANDC) submitted a review of the 2014 water chemistry data to the NWB on October 23, 2014 stating:

“The water chemistry results indicate that there is no significant difference between the three different waterbodies on any of the parameters tested and that all three waterbodies have water chemistry that meets the guideline for drinking water standards in Canada”

and:

“At this time AANDC is satisfied that the water chemistry of all three waterbodies of similar quality as well as being suitable for drinking and poses no risk to the residents of Rankin Inlet”.

A copy of this Memorandum is available in Appendix M.

Review of the 2015 water chemistry data for Nipissar Lake, Char River and Lower Landing Lake has remained very similar. Annual sampling at these Monitoring Program Stations will confirm the water quality in Nipissar Lake is not being negatively impacted by the transfer of water.

4. In-Stream Flow Objectives for Char River

As per Part C, Item 11 of Water Licence No. 3AM-GRA1015 Amendment No. 1, the in-stream flow objectives for Char River including a flow based low cut-off limit of 10% of the instantaneous flow and 0.5 m minimum flow depth in the Char River, at which point no further water is authorized to be withdrawn from Char River.

Refer to Section 2 for details on how these flow objectives are being monitored.

The *Technical Memorandum: Char River Theoretical Ratings Curves* found in Appendix B states that flow depths of 0.5 m may result in mean channel velocities that would present an impediment to fish passage for some species, and that in the experience of Golder, much lower flow depths can provide fish passage.

5. Details of Char River on-going viability assessment

The *Technical Memorandum: Char River Theoretical Rating Curve Based on Field Data* was submitted to the NWB on February 16, 2016 as Appendix B of the *Nipissar Lake and Lower Landing Lake Water Balance Assessment*.

Due to the in-stream flow objectives imposed by Amendment No. 1, it is anticipated that sufficient volumes to meet water use requirements will not be available from Char River during average conditions because flow depth objectives can only be met for approximately 50 days each year.

Refer to Section 2 for details on how the flow objectives for Char River are being monitored and Section 6 for details on options for a long-term alternative water source to replenish Nipissar Lake.

6. Mitigation options and procedures

When flow in Char River is insufficient to meet the in-stream pumping objectives, the annual pumping from Char River to Nipissar Lake will be stopped.

GN-CGS is currently looking at options for a long-term alternative water source to replenish Nipissar Lake. CGS contracted Golder Associates to complete a water balance study for Lower Landing Lake during summer/fall 2015. This study will include details on the recharge rate and available water in Lower Landing Lake, the impact withdrawing water from Lower Landing Lake will have on Char River, and the volume of water required to be pumped to Nipissar Lake to meet the natural recharge deficit caused by increasing water consumption.

The *Nipissar Lake and Lower Landing Lake Water Balance Assessment* was submitted to the NWB on February 16, 2016. Due to the large size of the report, it is not included as an appendix of this Plan.

The Lower Landing Lake watershed is significantly larger than the Nipissar Lake watershed, cover approximately 66.9 km² and 3 km², respectively. The larger watershed area of Lower Landing Lake

accumulates more precipitation in the water balance than Nipissar Lake.

Based on this report, under historic and climate change scenarios, Lower Landing Lake is estimated to have sufficient supplementary water supplies to accommodate the water deficit from Nipissar Lake under low and moderate consumption rates (1,600 m³/day and 3,300 m³/day, respectively).

The total outflow (surplus) from Lower Landing Lake under median historic climatic conditions is approximately 10 million m³/year. If the total outflow was able to be utilized for consumption, it could support consumption of approximately 40,000 people, based on the current per capita consumption rate of 0.68 m³/person/day (approximately 1900 m³/day).

Under extreme climatic conditions (lowest historic rainfall runoff and snowfall accumulation) and a maximum duration winter, winter consumption will exceed the available active winter storage capacity of Nipissar Lake with a daily consumption rate of approximately 3,900 m³. Based on the current per capital consumption rate of 0.68 m³/person/day, the daily consumption will reach 3,900 m³ in approximately 2062 (46 years).

Lower Landing Lake is a valid option as a supplementary water source for Rankin Inlet far beyond the 8 year time frame requested in the current Licence renewal process. Full details of the water balances, predicted Nipissar Lake water supply deficits under various climate regimes, and water taking rates are presented in the *Nipissar Lake and Lower Landing Lake Water Balance Assessment*.

7. Revised Plan

As per Part C, Item 11 of Water Licence No. 3AM-GRA1015 Amendment No. 1, a revised *Water Pumping Adaptive Management Plan* was to be submitted to the NWB within ninety (90) days of completion of the 2015 hydrological field study. Due to the delay in receiving the water balance assessment from Golder, the revised *Water Pumping Adaptive Management Plan* was submitted to the NWB on February 16, 2016.

The *Water Pumping Adaptive Management Plan* will be reviewed annually and modified as necessary, with revised versions being submitted to the NWB within the Annual Reports.

8. References

AANDC (2014). *Aboriginal Affairs and Northern Development Canada's Technical Review of additional information submitted as per the public hearing proceedings which took place on Sept 25, 2014 by the Government of Nunavut, Department of Community and Government Services (GN-CGS) for the Seasonal Replenishment of Nipissar Lake*. Iqaluit, Nunavut.

Golder Associates (2016). *Nipissar Lake and Lower Landing Lake Water Balance Assessment*. Edmonton, Alberta.

Golder Associates (2015). *Technical Memo: Char River Theoretical Rating Curves*. Edmonton, Alberta.

Health Canada (2014). *Guidelines for Canadian Drinking Water Quality—Summary Table*. Water and Air Quality Bureau, Healthy Environments and Consumer Safety Branch, Health Canada, Ottawa, Ontario.

Nunavut Water Board (2014). *3AM-GRA1015 Type "A" Licence Amendment No. 1*. Gjoa Haven, Nunavut.

Appendixes

Appendix A – Water Licence No. 3AM-GRA1015 Amendment No. 1

NUNAVUT WATER BOARD



3AM-GRA1015 Type “A” LICENCE AMENDMENT No. 1

Licensee:	GOVERNMENT OF NUNAVUT, DEPARTMENT OF COMMUNITY AND GOVERNMENT SERVICES
Licence Issued:	June 9, 2010
Minister Approval of Licence:	July 28, 2010
Licence Expiry:	May 31, 2015
Amendment No. 1 Issuance:	December 23, 2014

Pursuant to its authority under Article 13 of the *Agreement between the Inuit of the Nunavut Settlement Area and Her Majesty the Queen in Right of Canada* and the *Nunavut Waters and Nunavut Surface Rights Tribunal Act*, with respect to an application for an amendment dated August 14, 2012 (with additional information provided on October 6, 2012 and August 12, 2013), made by Stantec Architecture Ltd. on behalf of the Government of Nunavut, Community and Government Services for the Hamlet of Rankin Inlet’s Municipal Type “A” Water Licence 3AM-GRA1015, and the Reasons for Decision issued by the Nunavut Water Board following the Public Hearing held with respect to the Application, the Nunavut Water Board hereby issues Amendment No. 1 to Licence 3AM-GRA1015 as follows:



NUNAVUT WATER BOARD
WATER LICENCE 3AM-GRA1015 - AMENDMENT NO.1

Pursuant to the *Nunavut Waters and Nunavut Surface Rights Tribunal Act* and the *Agreement Between the Inuit of the Nunavut Settlement Area and Her Majesty the Queen in right of Canada*, the Nunavut Water Board, hereinafter referred to as the Board, hereby grants to

GOVERNMENT OF NUNAVUT, COMMUNITY AND GOVERNMENT SERVICES

(Licensee)

P.O. BAG 002, GOVERNMENT OF NUNAVUT
RANKIN INLET, NUNAVUT X0C 0G0

(Mailing Address)

hereinafter called the Licensee, the right to alter, divert or otherwise use Water or dispose of Waste for a period, subject to restrictions and conditions contained within this Licence amendment:

Licence Number/Type: 3AM-GRA1015 TYPE "A"

Water Management Area: WILSON WATERSHED (13)

Location: RANKIN INLET, KIVALLIQ REGION, NUNAVUT
LATITUDE 62°49'24" N, LONGITUDE 92°06'53" W

Classification: MUNICIPAL UNDERTAKING

Purpose: USE OF WATERS

Quantity of Water use not to Exceed: 2,330 CUBIC METERS PER DAY FROM NIPISSAR LAKE,
3,485 CUBIC METERS PER DAY FROM CHAR RIVER TO NIPISSAR LAKE

License Issuance: JUNE 9, 2010

Expiry of Licence: MAY 31, 2015

This Licence Amendment No.1, issued and recorded at Gjoa Haven, Nunavut on December 23, 2014.

Thomas Kabloona,
Nunavut Water Board
Chair

APPROVED
BY:

Minister of Aboriginal Affairs and Northern
Development Canada

DATE:

PART A: SCOPE, DEFINITIONS AND ENFORCEMENT

2. Definitions

Amend **“Water Supply Facilities”**

“Water Supply Facilities” means the areas and associated infrastructure at the Char River exiting the Lower Landing Lake including the water intake and pipeline extending from the Char River to Nipissar Lake as described in the Application for Water Licence Amendment dated August 14, 2012 and associated documents; Nipissar Lake including intake lines, pump-houses, underground pipeline and the Williamson Lake water tank.

PART C: CONDITIONS APPLYING TO WATER USE AND MANAGEMENT

Insert

Item 11 The Licensee shall submit to the Board for approval in writing, prior to March 31, 2015, a Water Pumping Adaptive Management Plan, that shall include the following:

- a. Details of seasonal hydrological monitoring of Char River;
- b. Details of Char River, Lower Landing Lake and Nipissar Lake water chemistry monitoring and assessment of impacts on Nipissar Lake water quality/chemistry due to the transfer of water from Char River;
- c. In-stream flow objectives for Char River including a flow based low cut-off limit of 10% of the instantaneous flow and 0.5m minimum flow depth in the Char River, at which point no further Water is authorized to be withdrawn from the Char River;
- d. Details of Char River on-going viability assessment in meeting pumping objectives and water use requirements;
- e. Mitigation options and procedures for occurrences when flow is insufficient to meet pumping objectives and consumption requirements.

Insert

Item 12 The Licensee may, withdraw fresh Water from the Char River, exiting the Lower Landing Lake at Monitoring Station GRA-6, and pump to Nipissar Lake annually in accordance with the approved Water Pumping Adaptive Management Plan as submitted under Part C, Item 11.

Insert

Item 13 The daily quantity of Water pumped from the Char River to Nipissar Lake shall not exceed three thousand, four hundred and eighty-five (3,485) cubic metres per day, to be withdrawn in accordance with the approved Water Pumping Adaptive Management Plan, as submitted under Part C, Item 11. Withdrawal of water shall not exceed 10 % of the instantaneous flow of Char River.

Insert

Item 14 The Licensee shall submit to the Board for approval in writing, a revised Water Pumping Adaptive Management Plan, within ninety (90) days of completion of the 2015 hydrological field study, to include actual field flow data analysis. The Licensee shall annually review the Water Pumping Adaptive Management Plan and modify it as necessary. Revised Plans shall be submitted to the Board within the Annual Reports.

Insert

Item 15 The Licensee shall cease water pumping activities from Char River to Nipissar Lake should the In-stream flow objectives for Char River, as per the Water Pumping Adaptive Management Plan and restrictions imposed in Part C, Item 13, not be met.

PART F: CONDITIONS APPLYING TO OPERATIONS AND MAINTENANCE

Amend

Item 1 The Board has approved the Plan entitled “Addendum to Operations and Maintenance (O&M) Plan for the Water Supply Facility, Char River, Rankin Inlet, Nunavut”, prepared for the Government of Nunavut, Department of Community and Government Services, by Stantec Architecture Ltd., dated May 2014.

Amend

Item 3 The Board has approved the Plan entitled “Spill Contingency Plan for Water Supply and Sewage Treatment Facilities Rankin Inlet, Nunavut”, prepared for: the Government of Nunavut, Department of Community and Government Services, by Stantec Architecture Ltd., dated May 2014.

PART H: CONDITIONS APPLYING TO THE MONITORING PROGRAM

Amend

Item 1 The Licensee shall maintain Monitoring Program Stations at the following locations:

Monitoring Program Station Number	Description	Frequency	Status
GRA-1	Raw water supply from Nipissar Lake prior to treatment	Daily, Monthly, Annually; Annually (spring freshet)	Active (Volume) (Quality)
GRA-2	Point of discharge in Prairie Bay (within 20	Quarterly	Inactive (Quality)

	m of discharge pipe outfall approximately 5 m below the surface)		
GRA-3	Effluent discharge from Sewage Treatment Facility	Quarterly	Active (Quality)
GRA-4	Sludge removed from the Sewage Treatment Facility	Monthly	Active (Volume)
GRA-5	Water level gauge in Nipissar Lake	Monthly (during periods of open water)	Active (Water Level)
GRA-6	Char River Water pumped to Nipissar Lake	Daily, Monthly, Annually; Annually (spring freshet)	New (Volume/Quality)
GRA-7	Lower Landing Lake	Annually (spring freshet)	New (Water Quality)

Amend

Item 2 The Licensee shall measure by instrument and record in cubic metres, the daily, monthly and annual quantities of Water extracted for all purposes at Monitoring Program Station GRA-1, and from the Char River exiting Lower Landing Lake at Monitoring Program Station GRA-6.

Insert

Item 13 The Licensee shall, during water pumping activities from Char River to Nipissar Lake, record daily the total Water flow within the Char River to ensure the Licensee adheres to the Part C, Items 13, 14 and 15 of the Licence, and “Framework for Assessing the Ecological Flow Requirements to Support Fisheries in Canada”, (DFO 2013, or more recent).

Insert

Item 14 The Licensee shall sample annually during spring freshet, at Monitoring Program Stations GRA-1, GRA-6 and GRA-7 and analyze for the following parameters in accordance with the Canadian Council of Ministers of the Environment (CCME, 2013) Water Quality Guidelines for the Protection of Freshwater Aquatic Life:

pH	Conductivity
Total Suspended Solids	Ammonia Nitrogen
Nitrate – Nitrite	Oil and Grease (visual)
Total Phenols	Sulphate
Total Hardness	Total Alkalinity
Sodium	Potassium
Magnesium	Calcium

Chloride	Total Cadmium
Total Copper	Total Chromium
Total Iron	Total Lead
Total Mercury	Total Nickel
Total Zinc	Total Phosphorous
Total Aluminum	Total Manganese
Total Cobalt	Total Arsenic
Total Petroleum Hydrocarbons (TPH)	
Benzene, Toluene, Ethylbenzene, Xylene (BTEX)	

All remaining terms and conditions of Licence 3AM-GRA1015 Type “A” dated June 9, 2010 shall continue to apply.

Appendix B – Technical Memo: Char River Theoretical Rating Curves, July 20, 2015



TECHNICAL MEMORANDUM

TO Nicole Lanchuske, Project Officer

DATE July 20, 2015

CC Project File

FROM Chris Davidson; Nathan Schmidt

PROJECT No. 1534002

CHAR RIVER THEORETICAL RATING CURVES

1.0 INTRODUCTION

This Technical Memorandum details the background, objectives, methodology, and results for the development of the theoretical flow rating curve for the Char River near Rankin Inlet, Nunavut.

2.0 BACKGROUND

The community of Rankin Inlet (*Kangiqtinik*) currently depends on Nipissar Lake to provide its year-round municipal water supply (see Figure A in attachments). Given that the Nipissar Lake watershed is frozen over for approximately eight to nine months each year, raw water supplies at the outset of winter need to be sufficient to service the community over the winter until snowmelt runoff replenishes the reservoir during the following freshet. A water supply pipeline from the nearby Char River, downstream of Lower Landing Lake (also referred to as First Landing Lake), to augment water supplies in Nipissar Lake was consequently constructed; however, concerns regarding the viability of this secondary supply source have been expressed in light of sustainable flow and water depth objectives imposed by the Nunavut Water Board (NWB) and the Canada Department of Fisheries and Oceans (DFO).

Although cross-sectional data were collected at thirteen cross-sections along the Char River in 2014 (AMEC 2014), no flow or water level data have been collected to provide a characterisation of baseline flows or levels for the river. In the absence of flow and water level data for the Char River, the DFO and NWB objectives are currently set to limit withdrawals to 10% of instantaneous flow and to maintain a minimum flow depth of 0.5 m.

3.0 OBJECTIVE

IMG-Golder was retained by the Government of Nunavut in July 2015 in order to undertake water balance studies for the Char River and a potential secondary water supply supplementation source, Lower Landing Lake, located immediately upstream of the lower reach of the Char River.

As part of this work, it was requested that IMG-Golder prepare a theoretical rating curve of the Char River using available cross-sectional data to provide a temporary characterisation of baseline flows and water levels until such time that monitoring data become available.

The objective of this work was to develop a theoretical rating curve for the Char River at the water intake location, situated slightly downstream of Lower Landing Lake.



4.0 METHODOLOGY

In order to produce rating curves, a hydraulic model of the Char River between First Landing Lake and Hudson Bay was created in HEC-RAS. HEC-RAS software, created by the U.S. Army Corps of Engineers, allows one-dimensional modelling of stream systems using Manning's flow equation. Users apply river cross-sectional information, streambed roughness, bridge dimensions, boundary conditions, and a set of flows, allowing the model to estimate resulting water levels throughout the modelled reach.

4.1 Cross-Sectional Information

Cross-sectional information for the Char River was obtained from the "*Rankin Inlet – Char River Channel Topographic Survey*" technical memorandum (AMEC 2014) provided to IMG-Golder with the original request for quotation. The provided data comprises 13 surveyed cross-sections along a 1400 metres (m) length of the Char River between Lower Landing Lake and Hudson Bay (Attachment A). These surveyed cross-sections range in width from 22 m to 173 m, with an average of 14 station-elevation points defining each cross-section. The collected data depict a reasonably well-defined floodplain (with banks of 1 to 3 m in height), but do not define a low-flow channel. It is therefore currently unclear whether such a feature was accidentally omitted from the survey or whether a low-flow channel is absent altogether. Existing aerial imagery from Google Earth does not clearly show a low flow channel; but its presence/absence will be confirmed during a field visit scheduled between July 10 and 13.

Cross-sectional information for all 13 cross-sections was entered into HEC-RAS as station-elevation points taken across each cross-section. The station number for each point (i.e., distance along the cross-section) was determined using the northing and easting provided in AMEC (2014).

The Char River water taking location is shown on the AMEC drawing as being situated between Cross-section 12 and Cross-section 13; results from both of these points will be used to estimate conditions at the pumping location although it is not yet known whether the available cross-sectional data provide a suitable characterisation of channel geometry at the intake.

4.2 Hudson Bay Tide Levels

Hudson Bay is subject to tides; during high tide, the water level in Hudson Bay is expected to cause a backwater effect in the Char River, filling a portion of the channel for distance upstream and reducing channel capacity. This can cause a temporary backwater effect leading to increased water levels for a short distance upstream. As such, it is important to consider tidal effects in the hydraulic model. In particular, it is important to determine whether or not the pumping location is above the potential tidal effects in the Char River.

A maximum tidal range of 4.64 m has been reported for Rankin Inlet (TF 2015); however a more typical maximum spring tidal range may be 4.5 m as reported by DFO (2015) for 2015. Applying the latter value to the cross-sectional data provided in AMEC (2015) indicates that maximum high spring tides may encroach into Char River up to an estimated elevation of 2.25 masl (not accounting for meteorological effects).

For the purposes of the modelling exercise the 2.25 masl high tide value was




TECHNICAL MEMORANDUM

4.3 Streambed Roughness

An empirically-derived Manning's value was assigned to represent streambed roughness at each cross-section. Manning's roughness values are assigned to simulate energy loss within the watercourse. Typically, Manning's roughness is used to calibrate hydraulic models based on observed water level and flow data. However, no flow or water level data are available at this time; therefore, a Manning's roughness value of 0.04 was assigned to all surfaces based on the literature value for unlined open rock channels (MTO 1997).

4.4 Bridge Dimensions

The aerial imagery provided in AMEC (2014) shows a single bridge crossing of the Char River immediately upstream (west) of Cross-section 9 (See Attachment A). While the elevation details for the bridge are not specifically identified, the survey information for Cross-section 9 appears to show the road and footing elevations for a single span bridge (Figure 1). In the absence of more specific information, the cross-sectional data were therefore used to estimate a solid deck bridge, with a superstructure 29.5 m long and 1.9 m deep, with a deck elevation of 12.1 masl. The width of the bridge was estimated from aerial photos to be approximately 5 m. The bridge was assumed to be located 1 m upstream of Cross-section 9. In order to provide a representation of the bridge in HEC-RAS, a second cross-section (Cross-section 9.5) was created 1 m upstream of the upstream of the bridge face, using the same cross-section data as Cross-section 9.

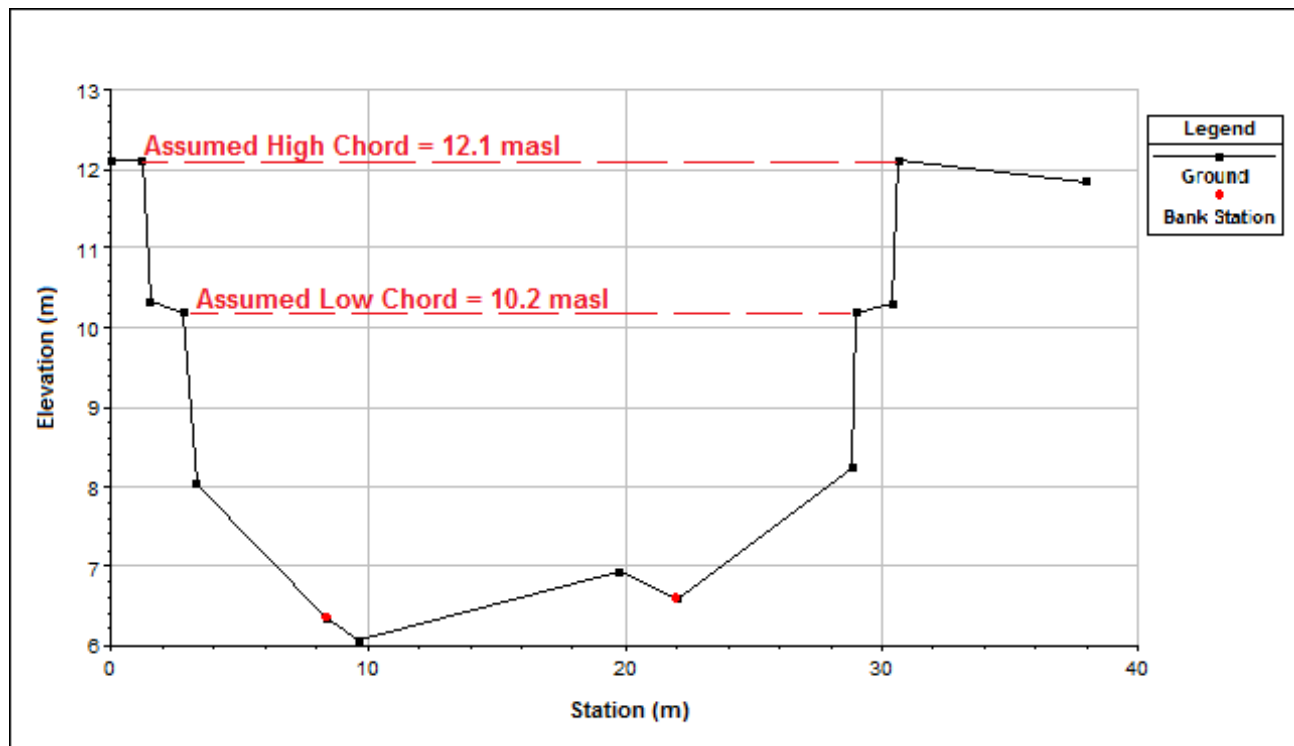



4.5 Flows

Flow measurements for the Char River are not available to define the range of flows for the HEC-RAS model; as such, the analysis described below relies on indirect methods of flow estimation.

Flow ranges for the Char River were estimated using flow records for a nearby station. Based on available Water Survey of Canada (WSC) mapping, the nearest WSC flow gauge is located on the Diana River, approximately 18 km west of Rankin Inlet (ID# 06NC001 Diana River near Rankin Inlet). The catchment area for the Diana River WSC station (1460 km² based on WSC data) is roughly 20 times larger than the Char River catchment (estimated as 69.8 km² based on coarse topographic mapping). Mean daily flow data are available for this station from January 1989 to December 1995, although the station is now inactive.

Mean daily flows for the Diana River station were obtained from WSC, and the data were prorated to the Char River by the ratio of drainage area using the following equation:

$$Q_2 = Q_1 * (A_2/A_1)^B$$

Where:

- Q_2 is the flow rate to be estimated at the point of interest (m³/s);
- Q_1 is the flow rate in the gauged watershed (m³/s);
- A_2 is the watershed area contributing to the point of interest (estimated as 69.8 km² for the Char River based on initial coarse mapping);
- A_1 is the watershed area contributing to the reference watercourse at the gauge location (given as 1460 km² for the Diana River WSC gauge); and
- B is an empirical exponent equal to 1.00 for mean daily flow estimates.

The range of prorated flows for the Char River is shown on Figure 2 below. Generally, the mean daily flows range from 0 m³/s to 4.9 m³/s. It should be noted that actual peak flows in the Char River may be marginally greater in magnitude and shorter in duration owing to the smaller watershed associated with the Char River (approximately 5% of that for the Diana River gauge). To account for this possibility, the range of flows used in HEC-RAS for Char River was therefore expanded up to 10 m³/s.



TECHNICAL MEMORANDUM

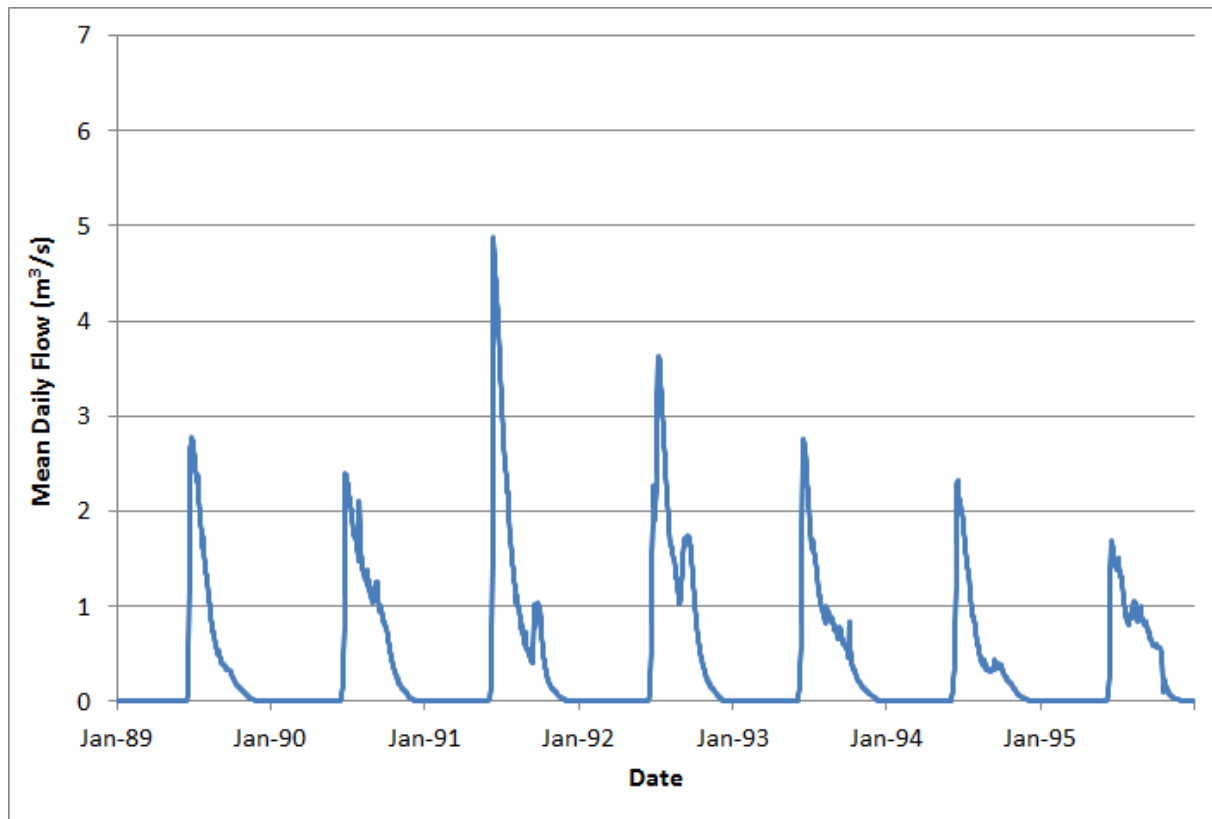


Figure 2: Prorated Flows for the Char River, 1989 to 1995

5.0 RESULTS AND DISCUSSION

5.1 Streamflow Profile

The HEC-RAS model was run for the selected range of flows; a graphical summary of the results (in the form of a stream profile) is shown on Figure 3 below. For the flows examined, water depths throughout the watercourse generally behaved similarly at each cross-section; the exceptions being Cross-sections 1 to 5 which can experience backwater effects during high tides and Cross-sections 9.5 and 10 which experience a small backwater effect as flows are constricted at the bridge. Full tabular results and graphical cross-sections are provided in Attachment B.



TECHNICAL MEMORANDUM

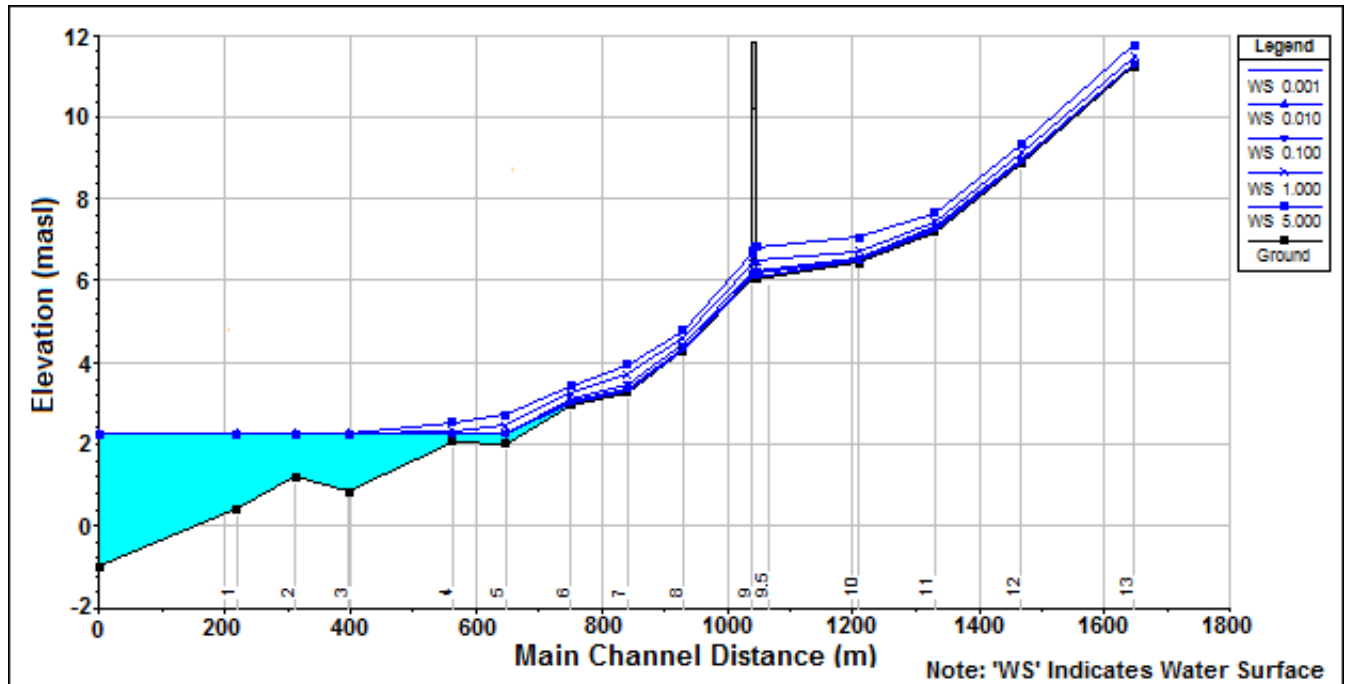


Figure 3: Char River HEC-RAS Results Profile

5.2 Theoretical Rating Curves

Based on AMEC (2014), the pumping station is located between Cross-Sections 12 and 13. The rating curves for both of these sections are plotted on Figure 4 below. In addition, theoretical rating curve equations (relating depth of flow to flow rate for both cross-sections) are provided. The equations are:

$$\text{At Cross-Section 12: } Q = 4.03 D^{2.53}$$

$$\text{At Cross-Section 13: } Q = 4.64 D^{1.92}$$

Where:

- Q is the flow rate (m³/s); and
- D is the depth of flow above the lowest channel elevation (m).



TECHNICAL MEMORANDUM

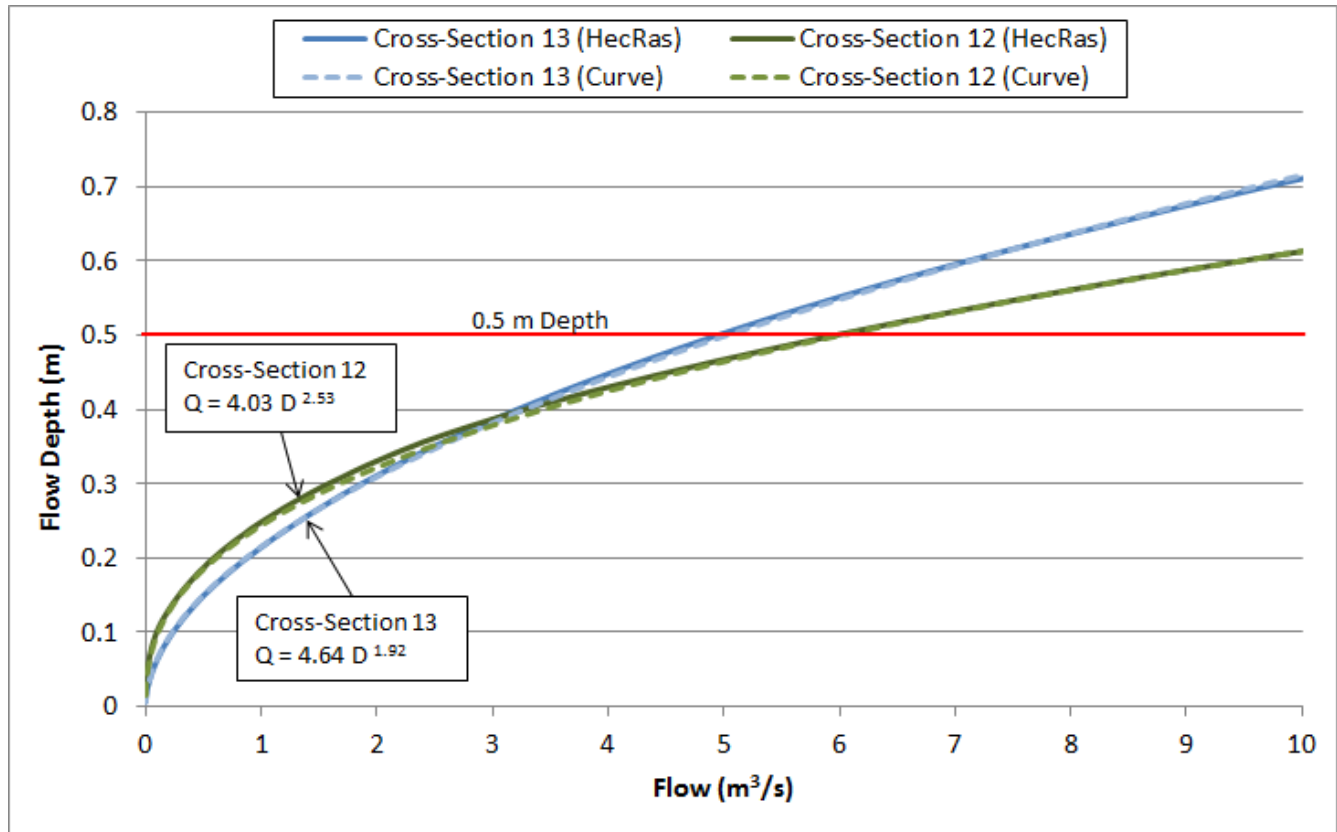


Figure 4: Char River Theoretical Rating Curves

Based on the rating curves depicted in Figure 4, the flow rate at Cross-sections 13 needs to reach approximately 6 m³/s and the flow rate at Cross-Section 12 needs to reach approximately 5 m³/s, in order to sustain a water depth of 0.5 m. This finding is significant in terms of the interim water level objective established by NWB for this location when considering that the prorated flow record from the Diana River gauge (Figure 2) would suggest that this flow condition is likely to occur infrequently and for short durations. The validity of this finding would need to be revisited if a low-flow channel, not represented in available cross-sectional data (refer to Attachment B), or the presence of a pool between these cross-sections, is identified as part of the field visit.

6.0 CONCLUSIONS AND RECOMMENDATIONS

6.1 Assumptions and Limitations

The analysis described above is based on the following assumptions and limitations:

- Cross-sectional data provided in AMEC (2014) are assumed to be accurate, up-to-date and representative of channel morphology;
- The lower boundary condition



TECHNICAL MEMORANDUM

- The channel roughness coefficient, based on literature values for an unlined rock channel, are assumed to be representative;
- The HEC-RAS model is not calibrated due to a current lack of measured flow and water level data; and
- A range of flows was assumed based on seven years of prorated flows from a nearby WSC gauge.

6.2 Conclusions

Based on the preceding information and subject to the assumptions and limitations documented herein:

- The lower portion of the Char River (Cross-Sections 1 to 5) is affected by backwater effects from high tide in Hudson Bay;
- The mid portion of the Char River (Cross-Sections 9.5 and 10) is affected by backwater effects from the bridge crossing; and
- Based on the available cross-sectional data, the 0.5 m minimum flow depth objective recommended by NWB appears to be met only infrequently under baseline conditions. The presence of a low-flow channel or pool (not represented in the existing survey) would reduce the flow rate required to achieve the 0.5 m flow depth objective specified by the NWB.

6.3 Recommendations

Based on the preceding conclusions, the following recommendations are made:

- Additional field survey work is recommended to verify the presence/absence of a low flow channel (to be verified during the upcoming field investigation);
- If no low-flow channel is identified, the rationale and appropriateness of the imposed flow depth objective should be discussed with the NWB and DFO. In our experience, much lower flow depths can provide fish passage, and the modelling indicates that at flow depths of 0.5 m, mean channel velocities may present an impediment to fish passage for some species. Site-specific considerations may result in less stringent depth criteria;
- Flow and water level measurements should also be obtained for the Char River during periods of flow in the river as a matter of priority in order to permit calibration of the HEC-RAS model (to be collected during the upcoming field investigation); and
- Any additionally available information regarding the characteristics of the Char River, including local knowledge of flooding, water levels, historically high and low flows, freeze up/thaw timing should be shared with the project team.



TECHNICAL MEMORANDUM

7.0 CLOSURE

If you have any questions or require additional information, please do not hesitate to contact us at your convenience.

Signed for:

Christopher Davidson, P.Eng.
Water Resources Engineer
Mississauga, ON

Nathan Schmidt, Ph.D., P.Eng.
Principal, Senior Water Resources Engineer
Edmonton, AB



Attached:

Figure A - General Location Plan

Attachment A - Survey Figure Excerpted From AMEC 2014

Attachment B1 - HEC-RAS Modelling Results

Attachment B2 – HEC RAS Sections



TECHNICAL MEMORANDUM

8.0 REFERENCES

- AMEC (2014) Rankin Inlet – Char River Channel Topographic Survey, provided to IMG-Golder as part of the RFQ package.
- DFO (2015) Rankin Inlet 2015 Tide Tables, Downloaded from “http://www.tides.gc.ca/eng/data/table/2015/wlev_sec/5100” on July 6, 2015.
- TF (2015) Tide Times for Rankin Inlet, Downloaded from “<http://www.tide-forecast.com/locations/Rankin-Inlet-Nunavut/tides/latest>” on July 6, 2015.
- MTO (1997) Drainage Management Manual, Ontario Ministry of Transportation (MTO) Drainage and Hydrology Section, Transportation Engineering Branch, Quality and Standards Division.

\\golder.gds\gal\Mississauga\Active\2015\3 Proj\1534002 Gov of Nunavut_Water Balance & Water Supply Forecast_Rankin Inlet\05. Reporting\1. Tech Memos\1. Theoretical Rating Curve\Final\1534002 Char River Rating Curve Memo (2015-07-20) Final.docx




FIGURES AND ATTACHMENTS



FIGURE A

General Location Plan

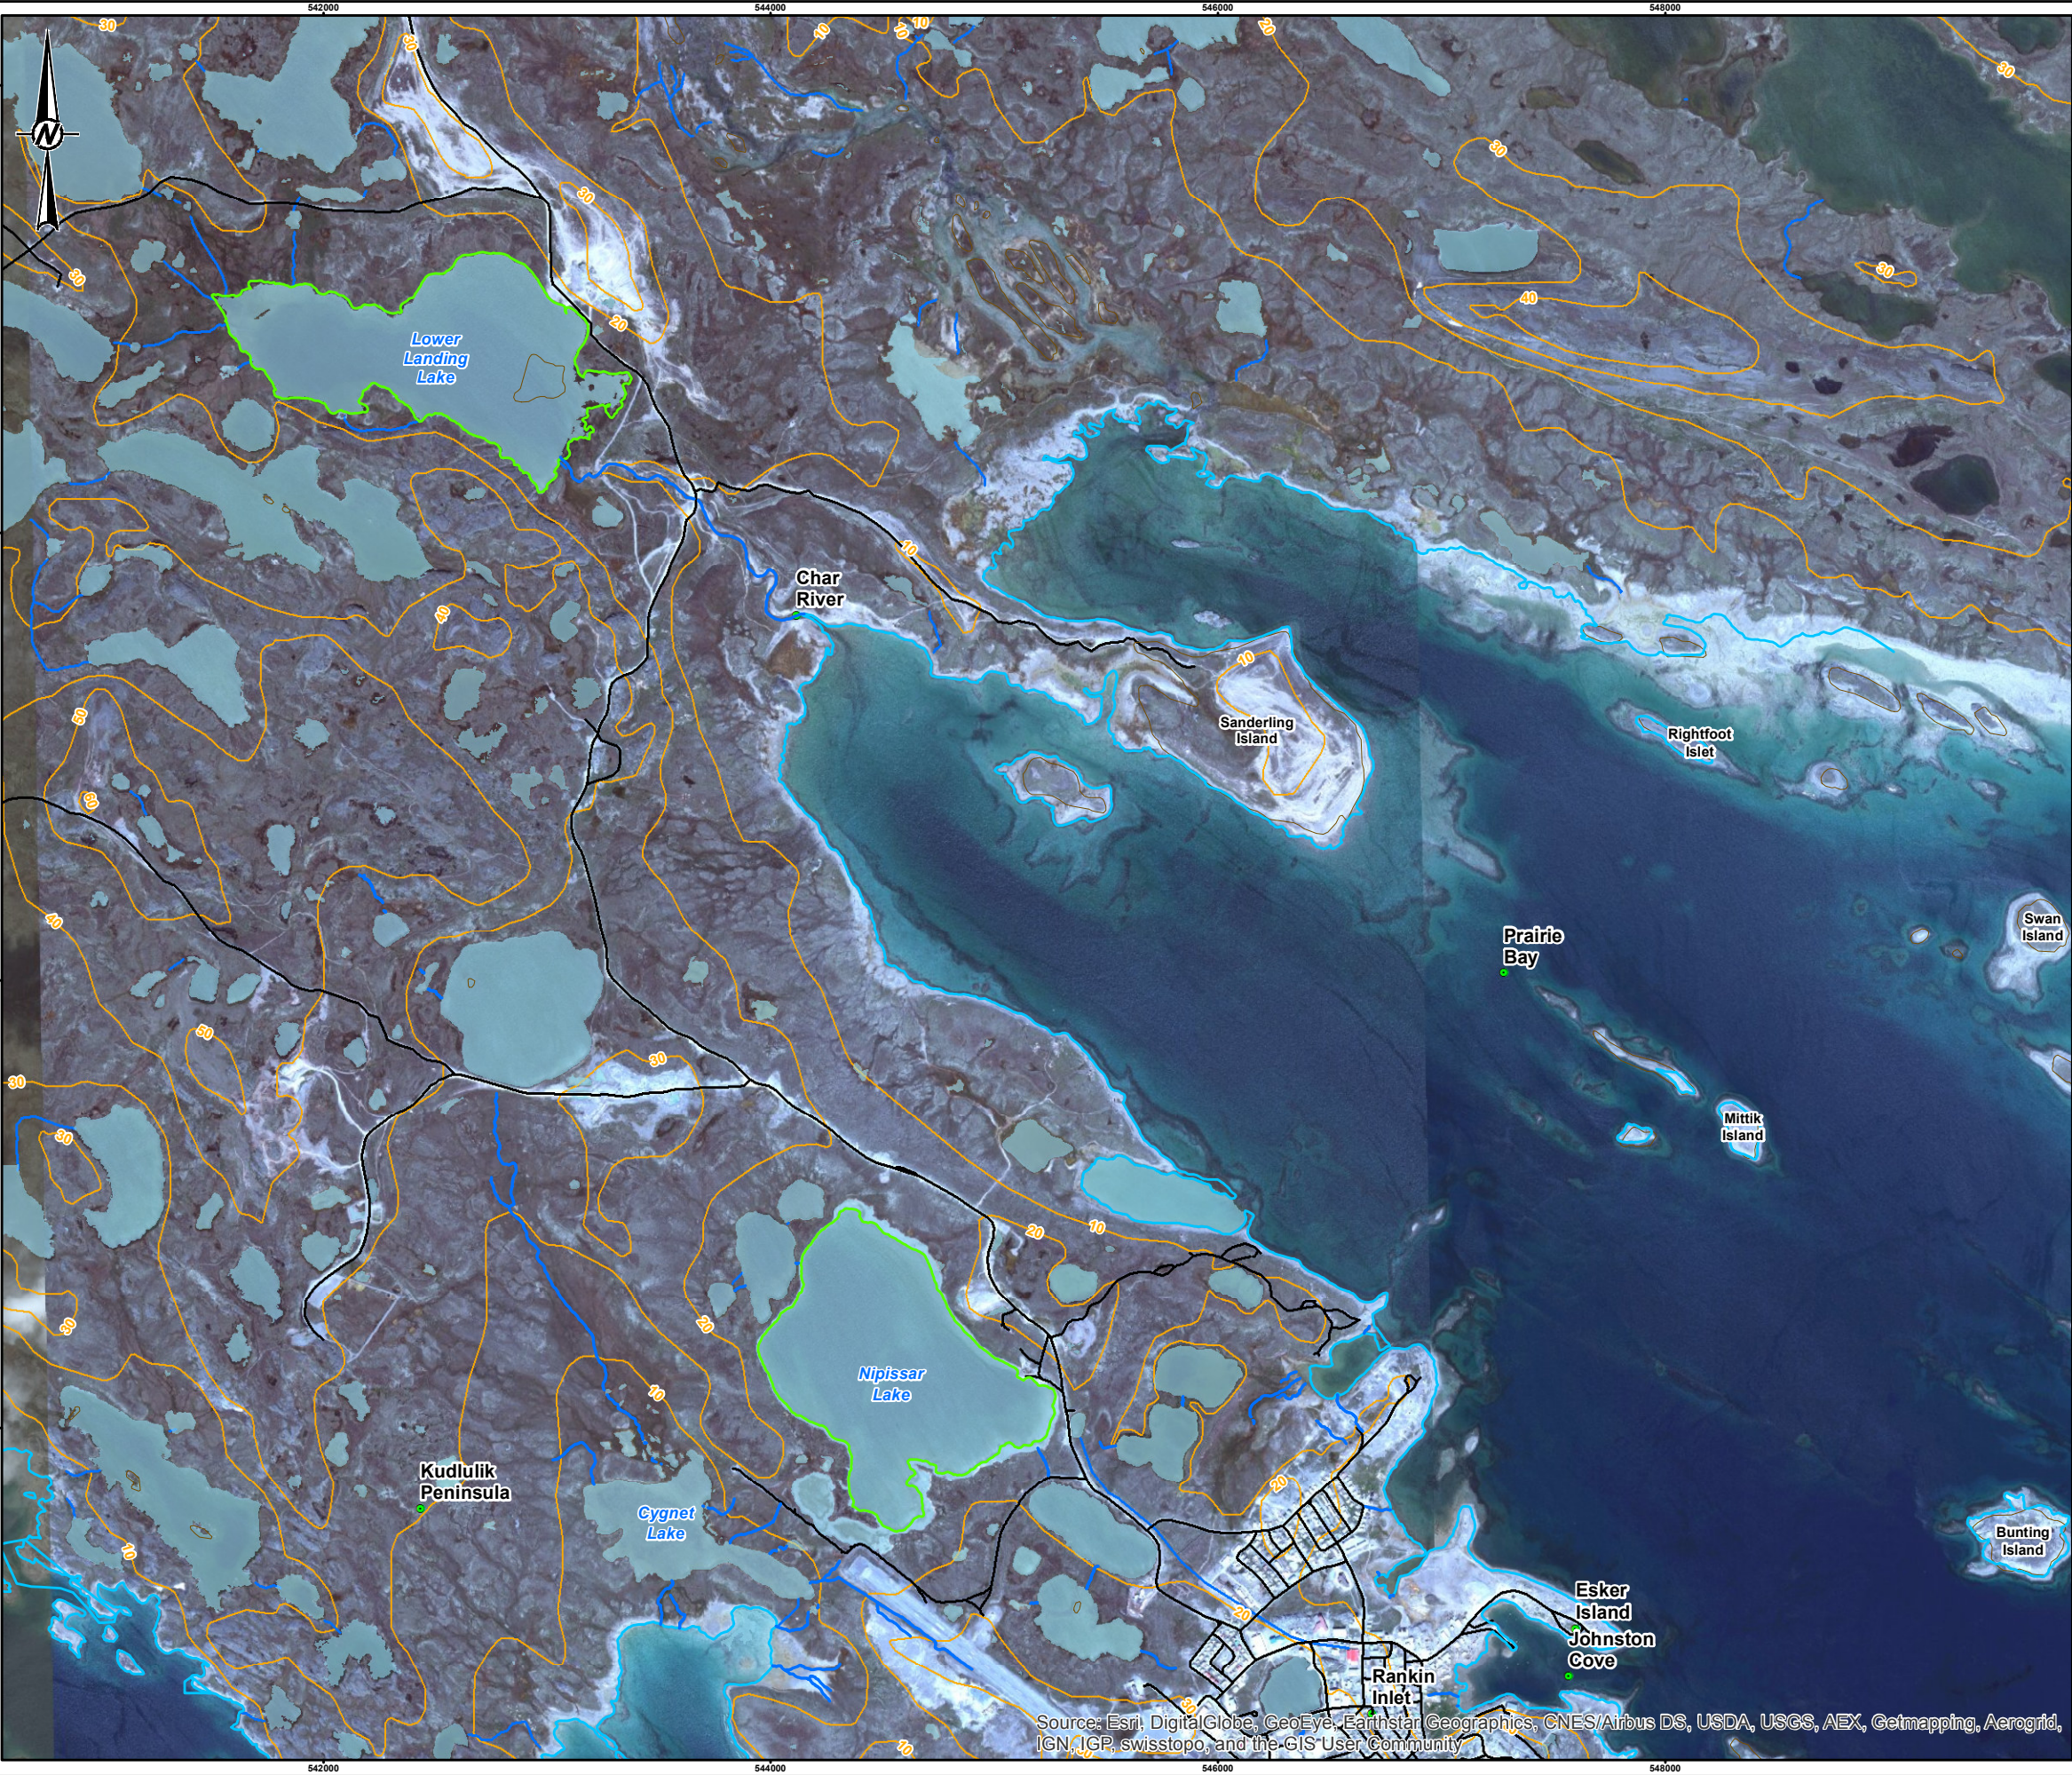



TECHNICAL MEMORANDUM

ATTACHMENT A

Survey Figure Excerpted From AMEC 2014



TECHNICAL MEMORANDUM

ATTACHMENT B1

HEC-RAS Modelling Results

Reach	River Sta	Profile	Q Total	Min Ch El	W.S. Elev	Crit W.S.	E.G. Elev	E.G. Slope	Vel Chnl	Flow Area	Top Width	Froude # Chl
			(m3/s)	(m)	(m)	(m)	(m)	(m/m)	(m/s)	(m2)	(m)	
1	13	0.001	0	11.27	11.2772	11.27	11.28	0.011462	0.07	0.01	3.01	0.35
1	13	0.005	0	11.27	11.2845	11.28	11.29	0.012112	0.13	0.04	3.5	0.41
1	13	0.01	0.01	11.27	11.2898	11.28	11.29	0.012775	0.18	0.06	3.66	0.45
1	13	0.05	0.05	11.27	11.3139	11.3	11.32	0.013894	0.34	0.15	4.04	0.55
1	13	0.1	0.1	11.27	11.3333	11.32	11.34	0.014086	0.45	0.23	4.34	0.59
1	13	0.5	0.5	11.27	11.4192	11.39	11.45	0.014457	0.83</			

1	6	0.5	0.5	2.98	3.186	3.15	3.21	0.014175	0.66	0.76	7.34	0.65
1	6	1	1	2.98	3.2584	3.21	3.28	0.013452	0.64	1.56	14.98	0.63
1	6	5	5	2.98	3.446	3.38	3.48	0.009759	0.81	6.14	32.67	0.6
1	6	10	10	2.98	3.5731	3.47	3.62	0.007011	0.96	10.45	34.32	0.55
1	5	0.001	0	2.01	2.25	2.03	2.25	0	0	0.68	5.66	0
1	5	0.005	0	2.01	2.2501	2.04	2.25	0.000001	0.01	0.68	5.66	0.01
1	5	0.01	0.01	2.01	2.2503	2.05	2.25	0.000006	0.01	0.68	5.67	0.01
1	5	0.05	0.05	2.01	2.2559	2.09	2.26	0.000129	0.07	0.72	5.81	0.06
1	5	0.1	0.1	2.01	2.2695	2.11	2.27	0.000387	0.13	0.8		




ATTACHMENT B2

HEC-RAS Sections


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 12

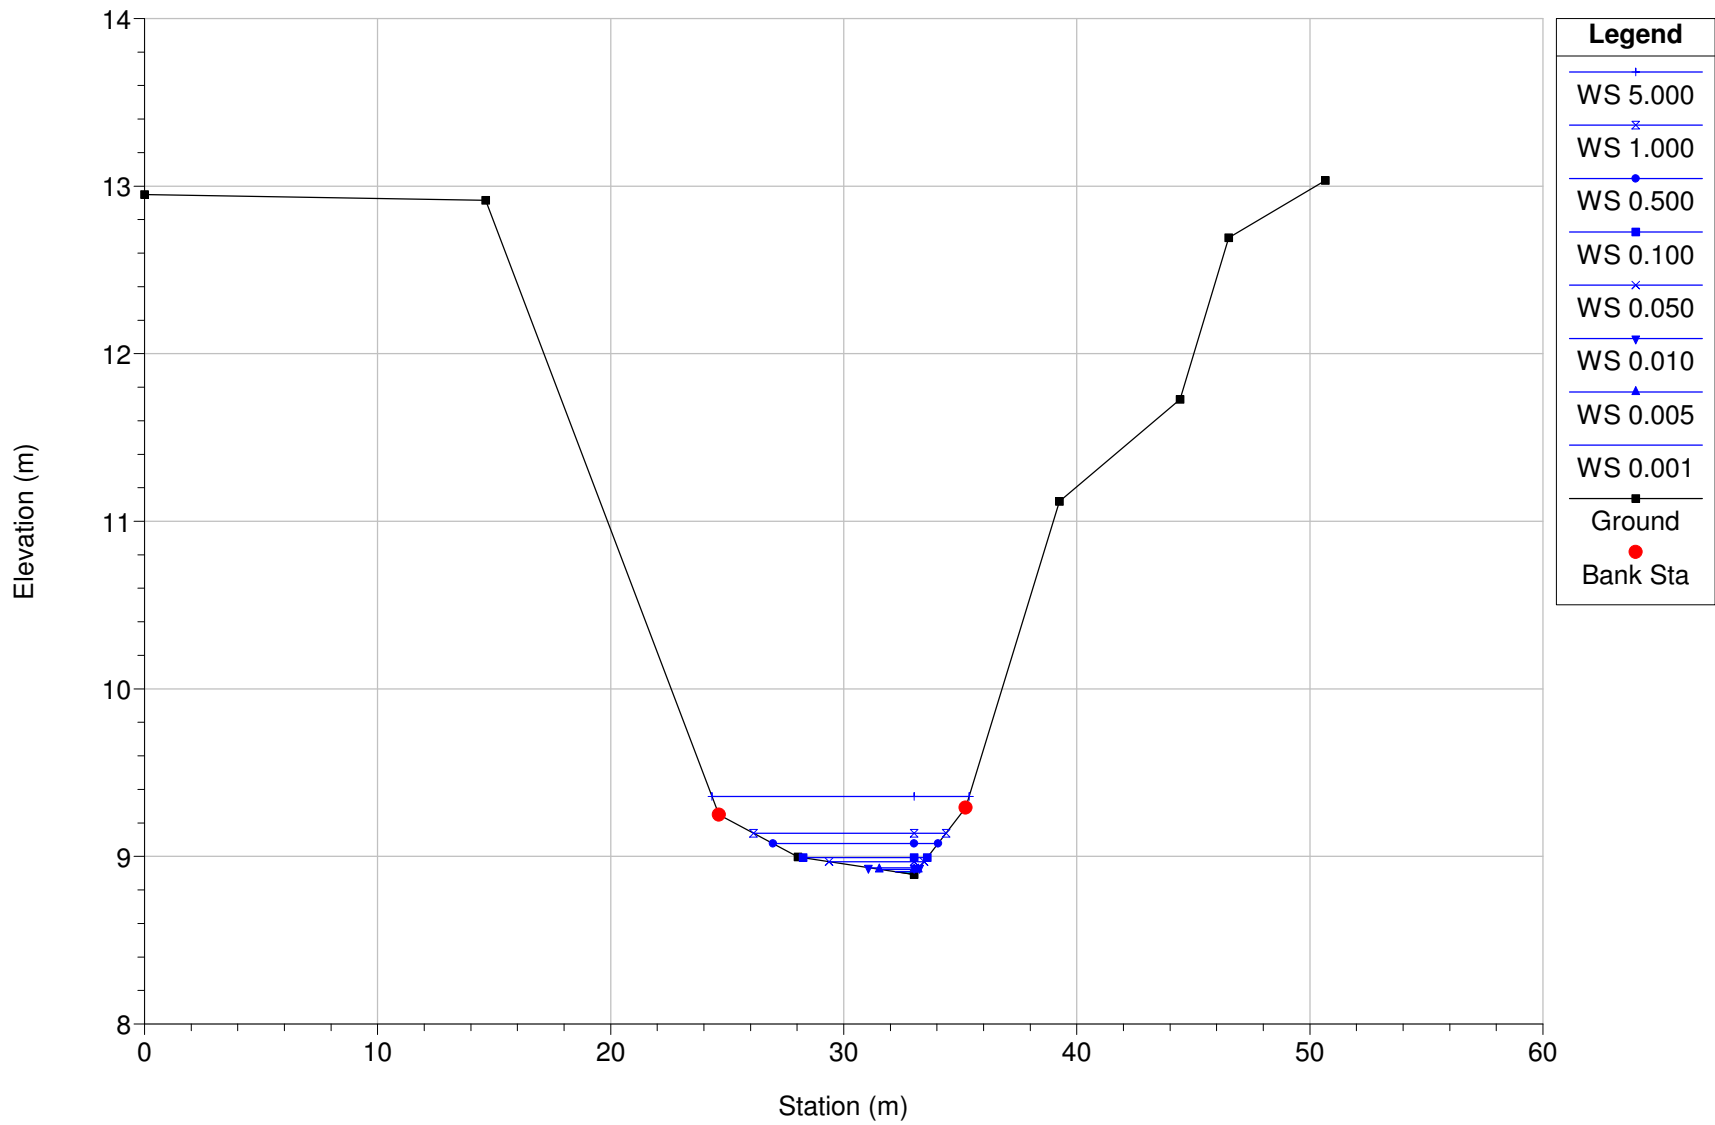


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 11

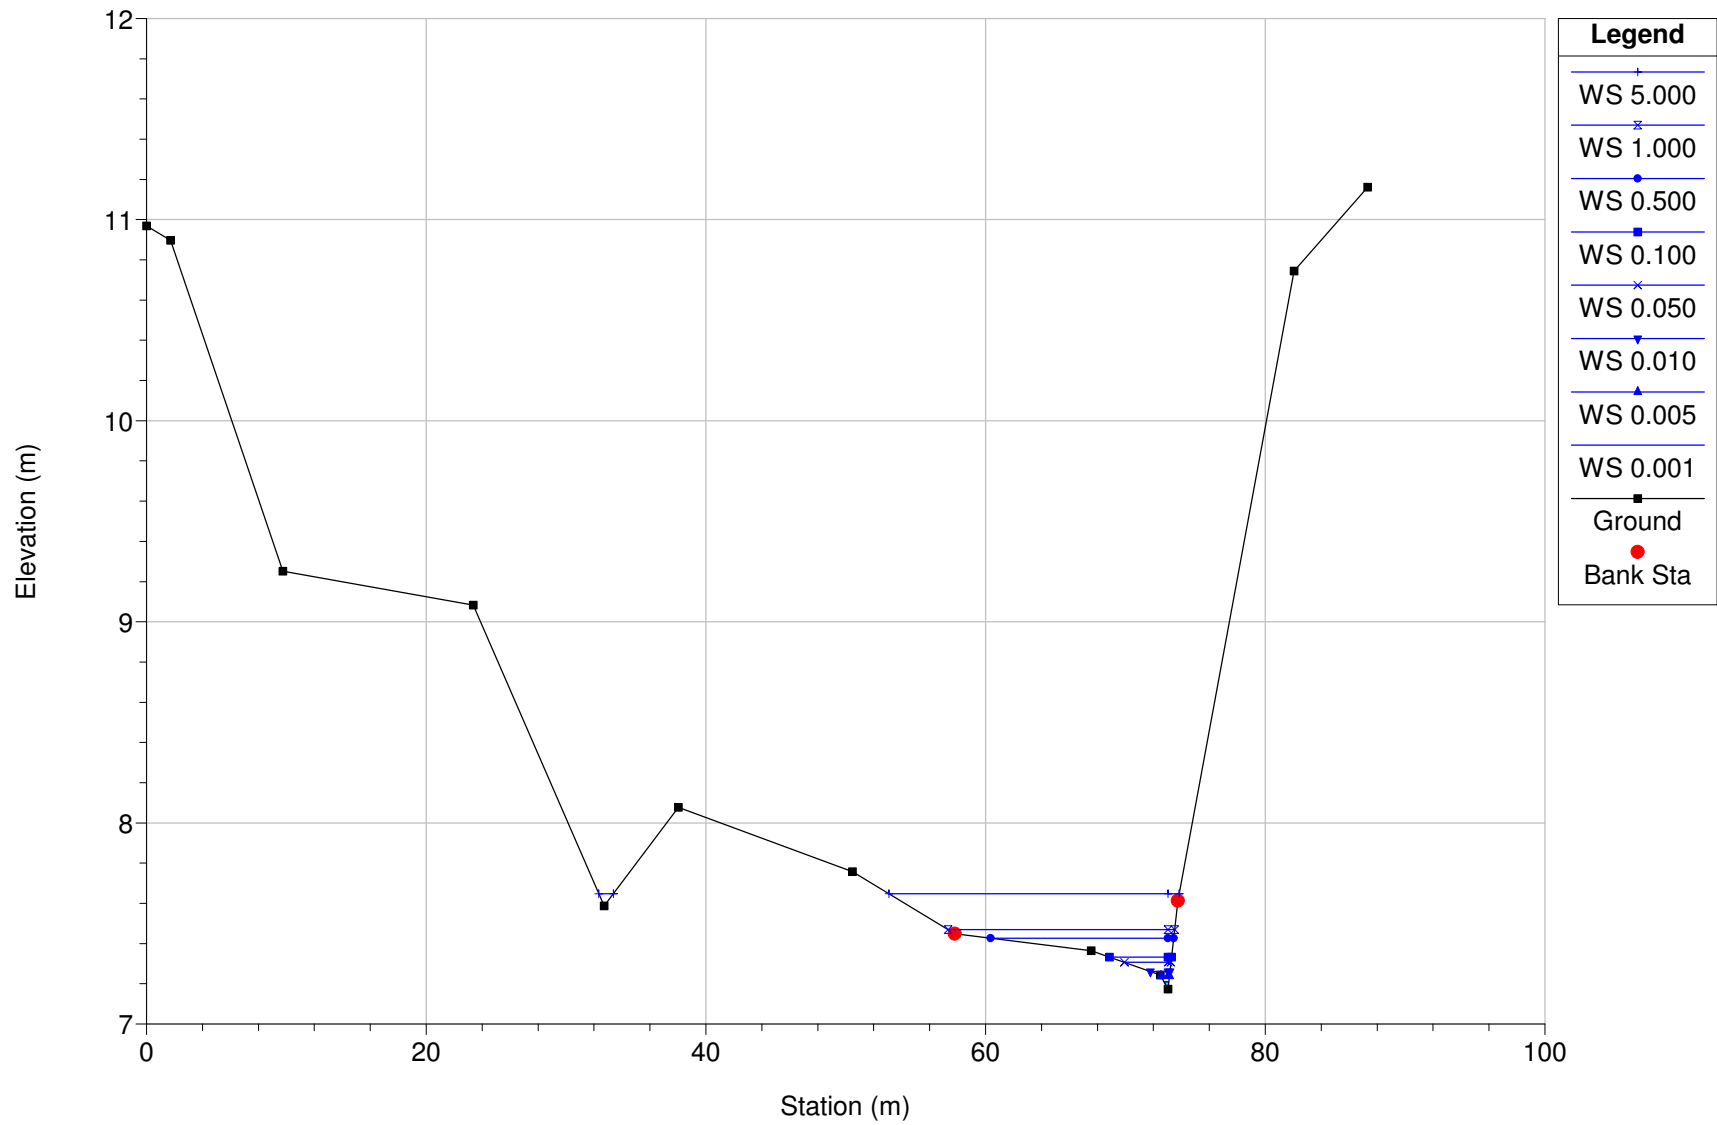


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 10

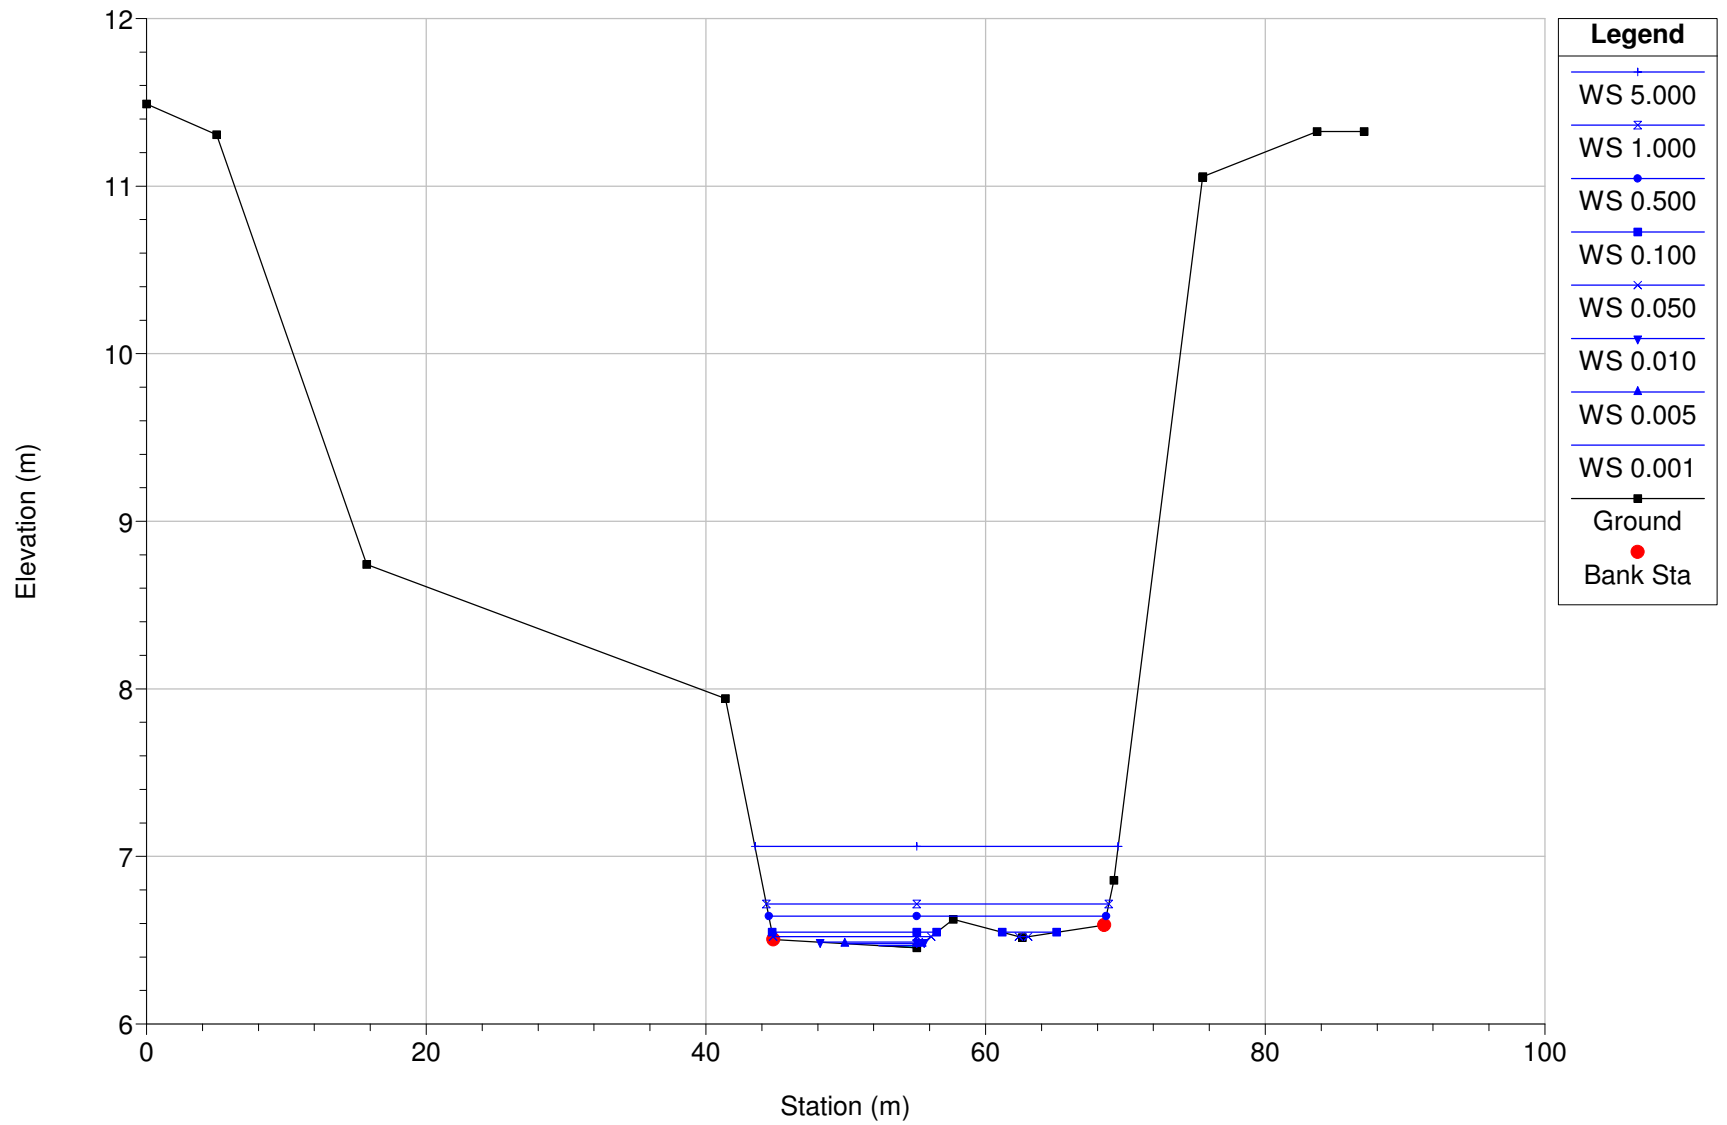


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 9.5

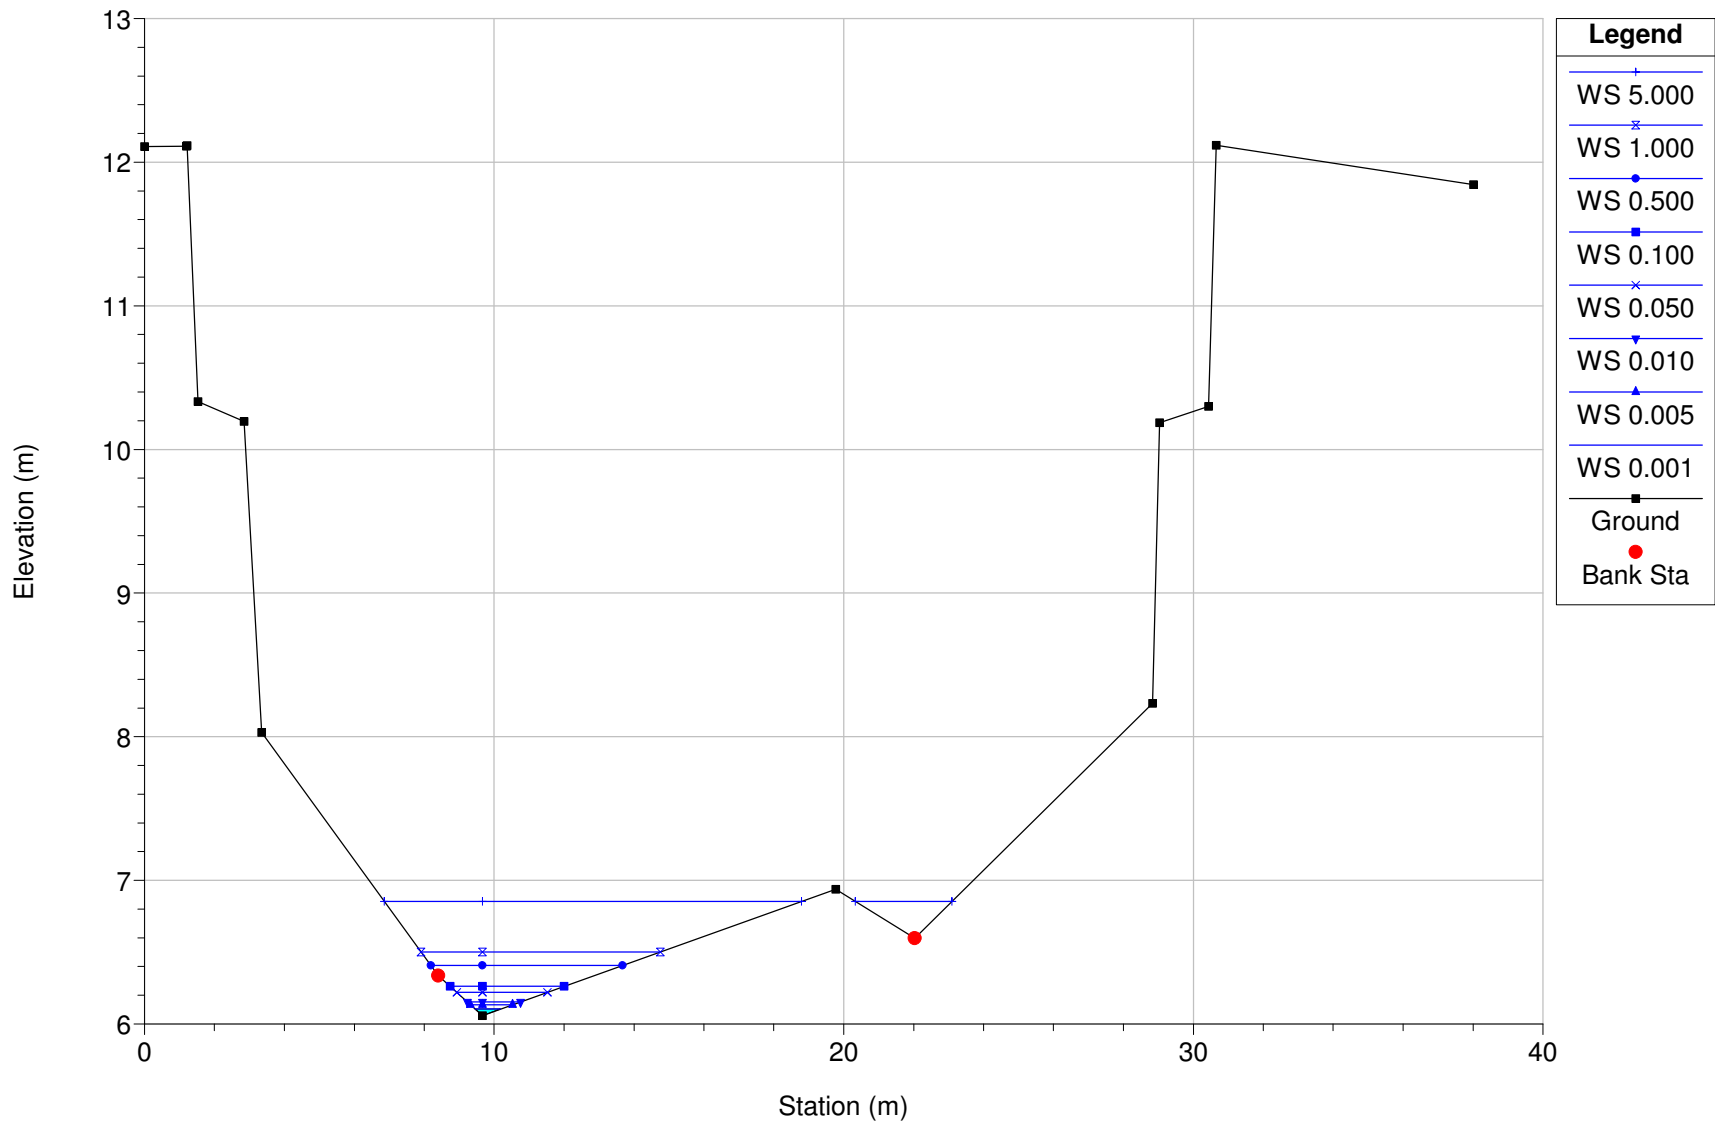


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 9.25 BR Char River Bridge - With Elevations assumed from AMEC Section su

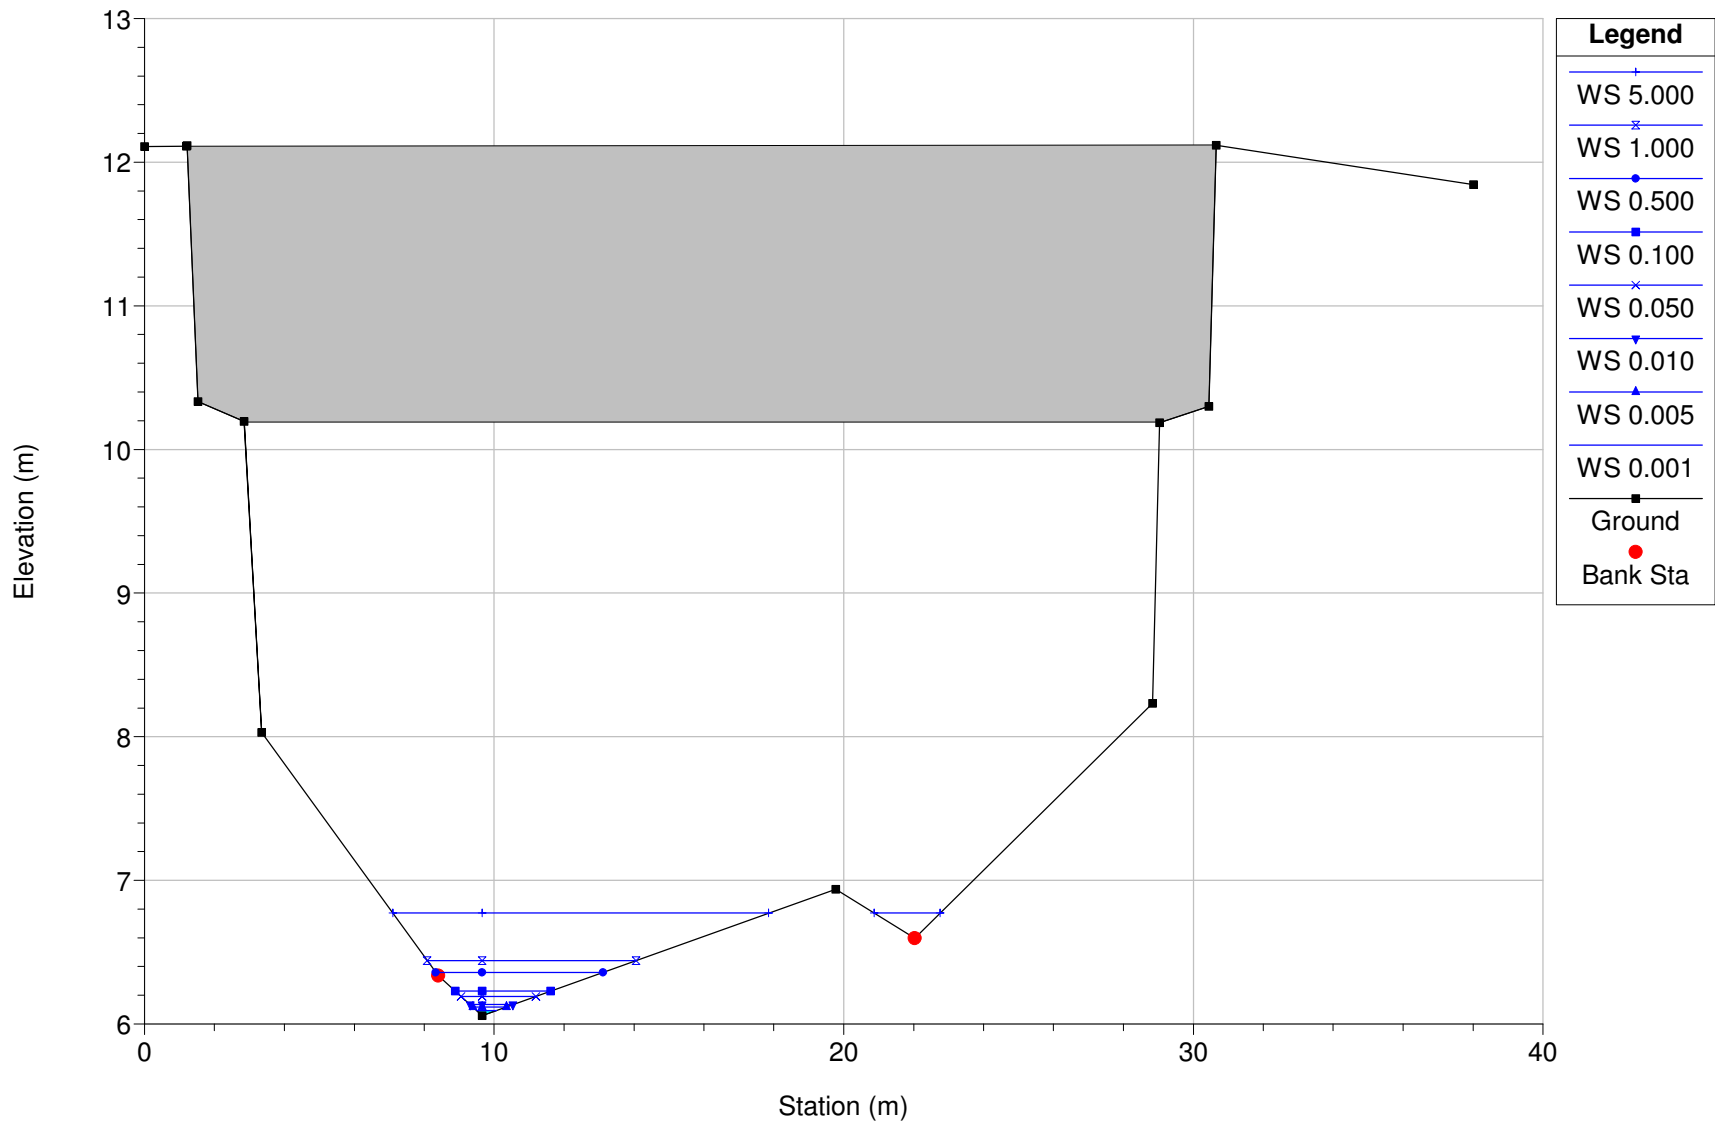


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 9

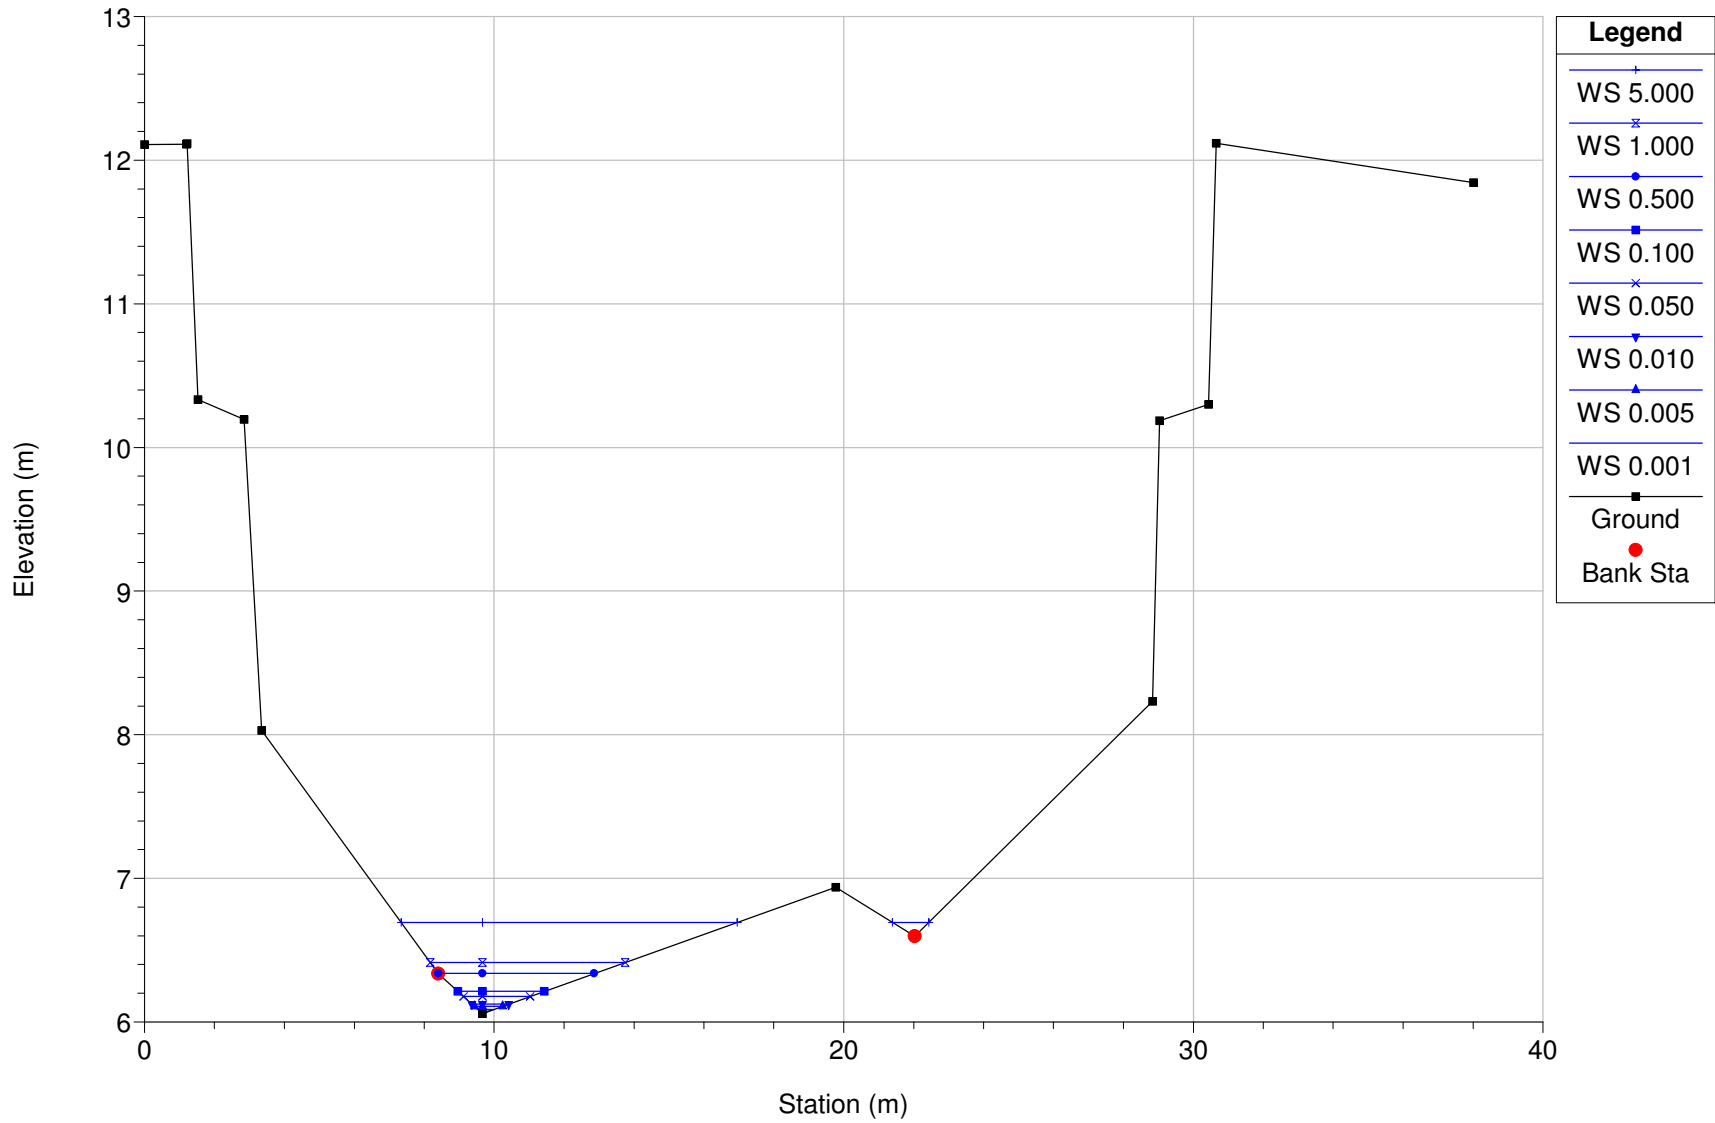


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 8

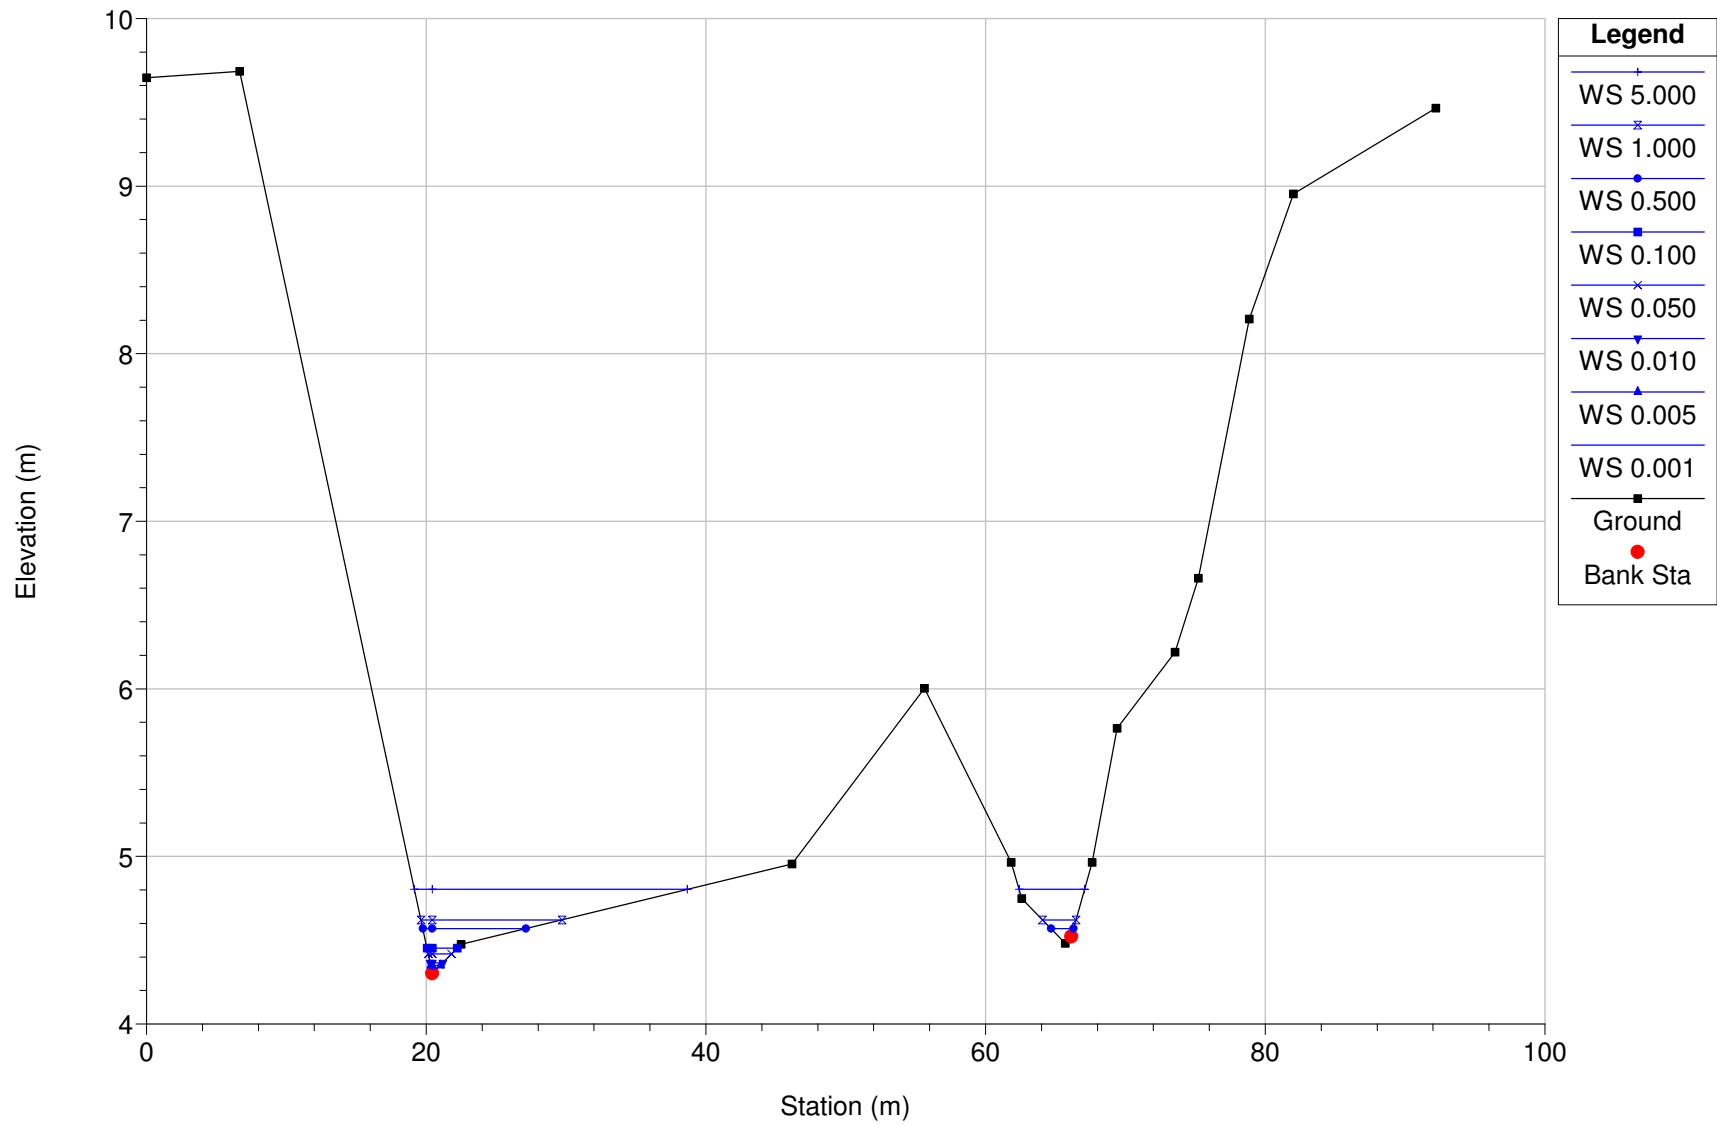


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 6

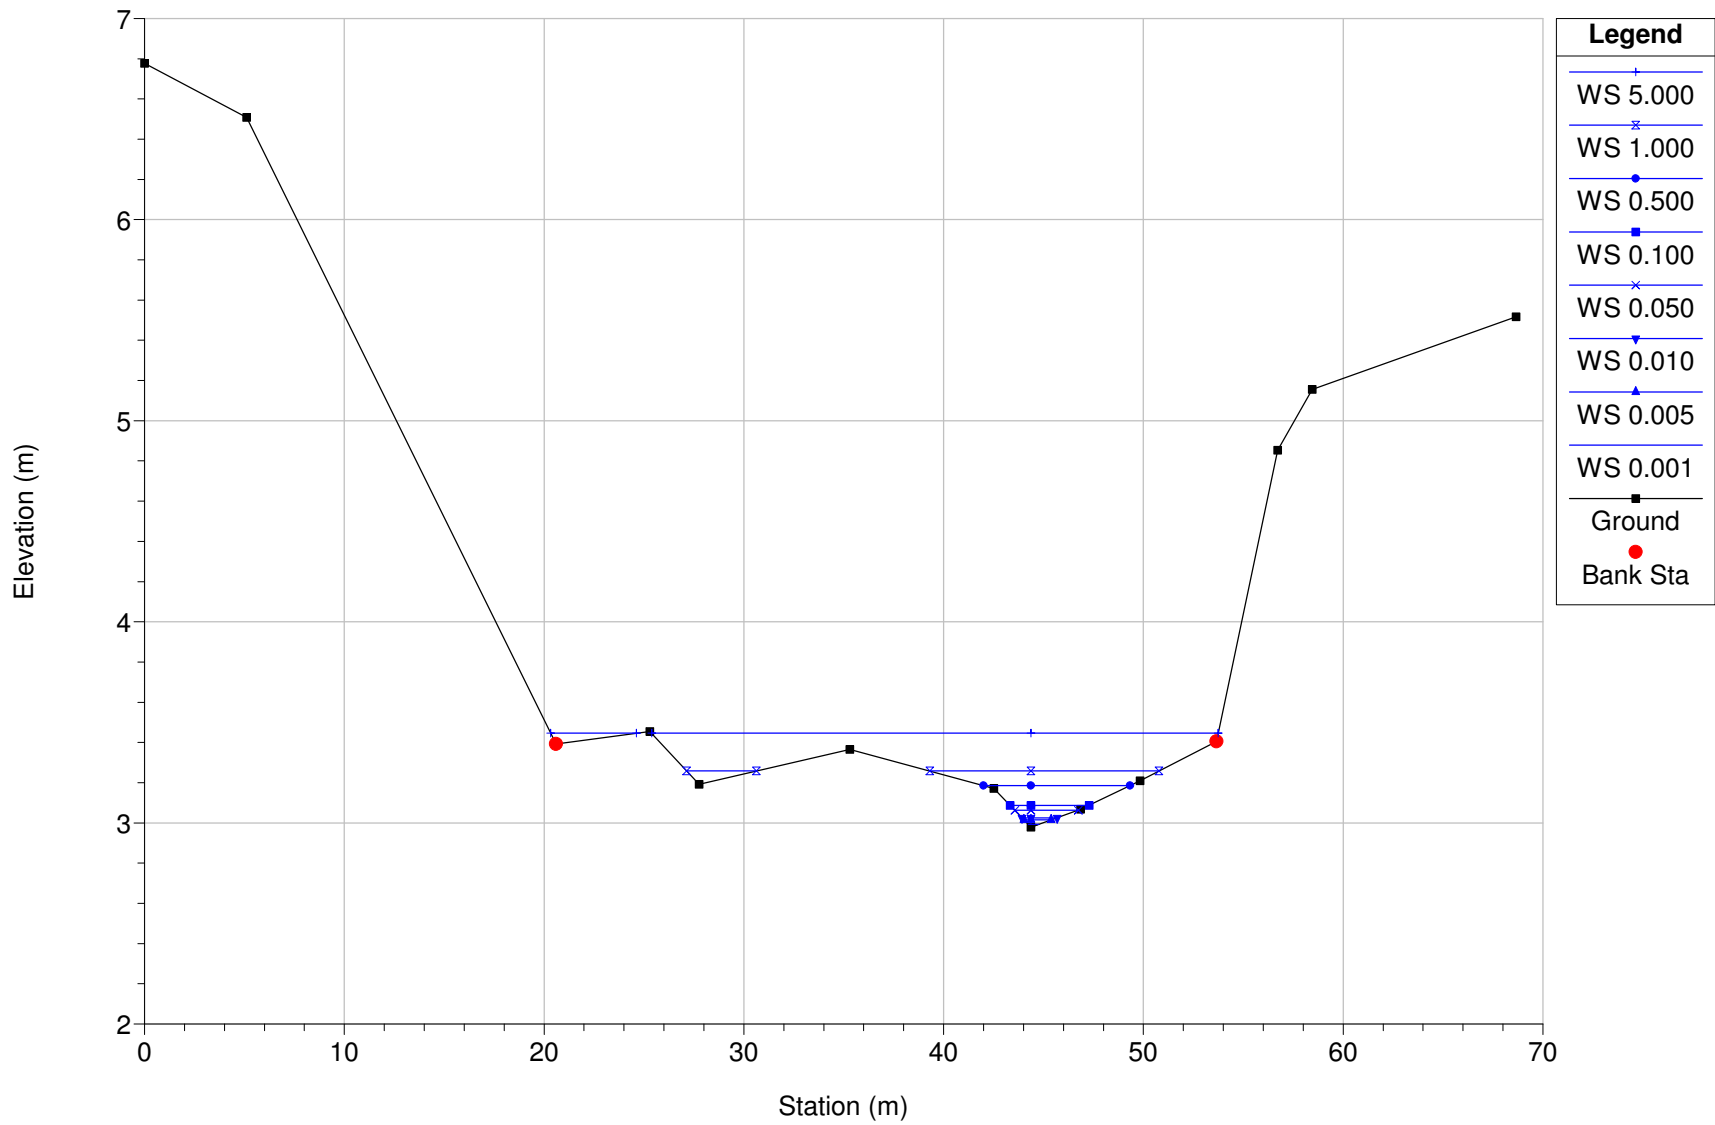


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 5

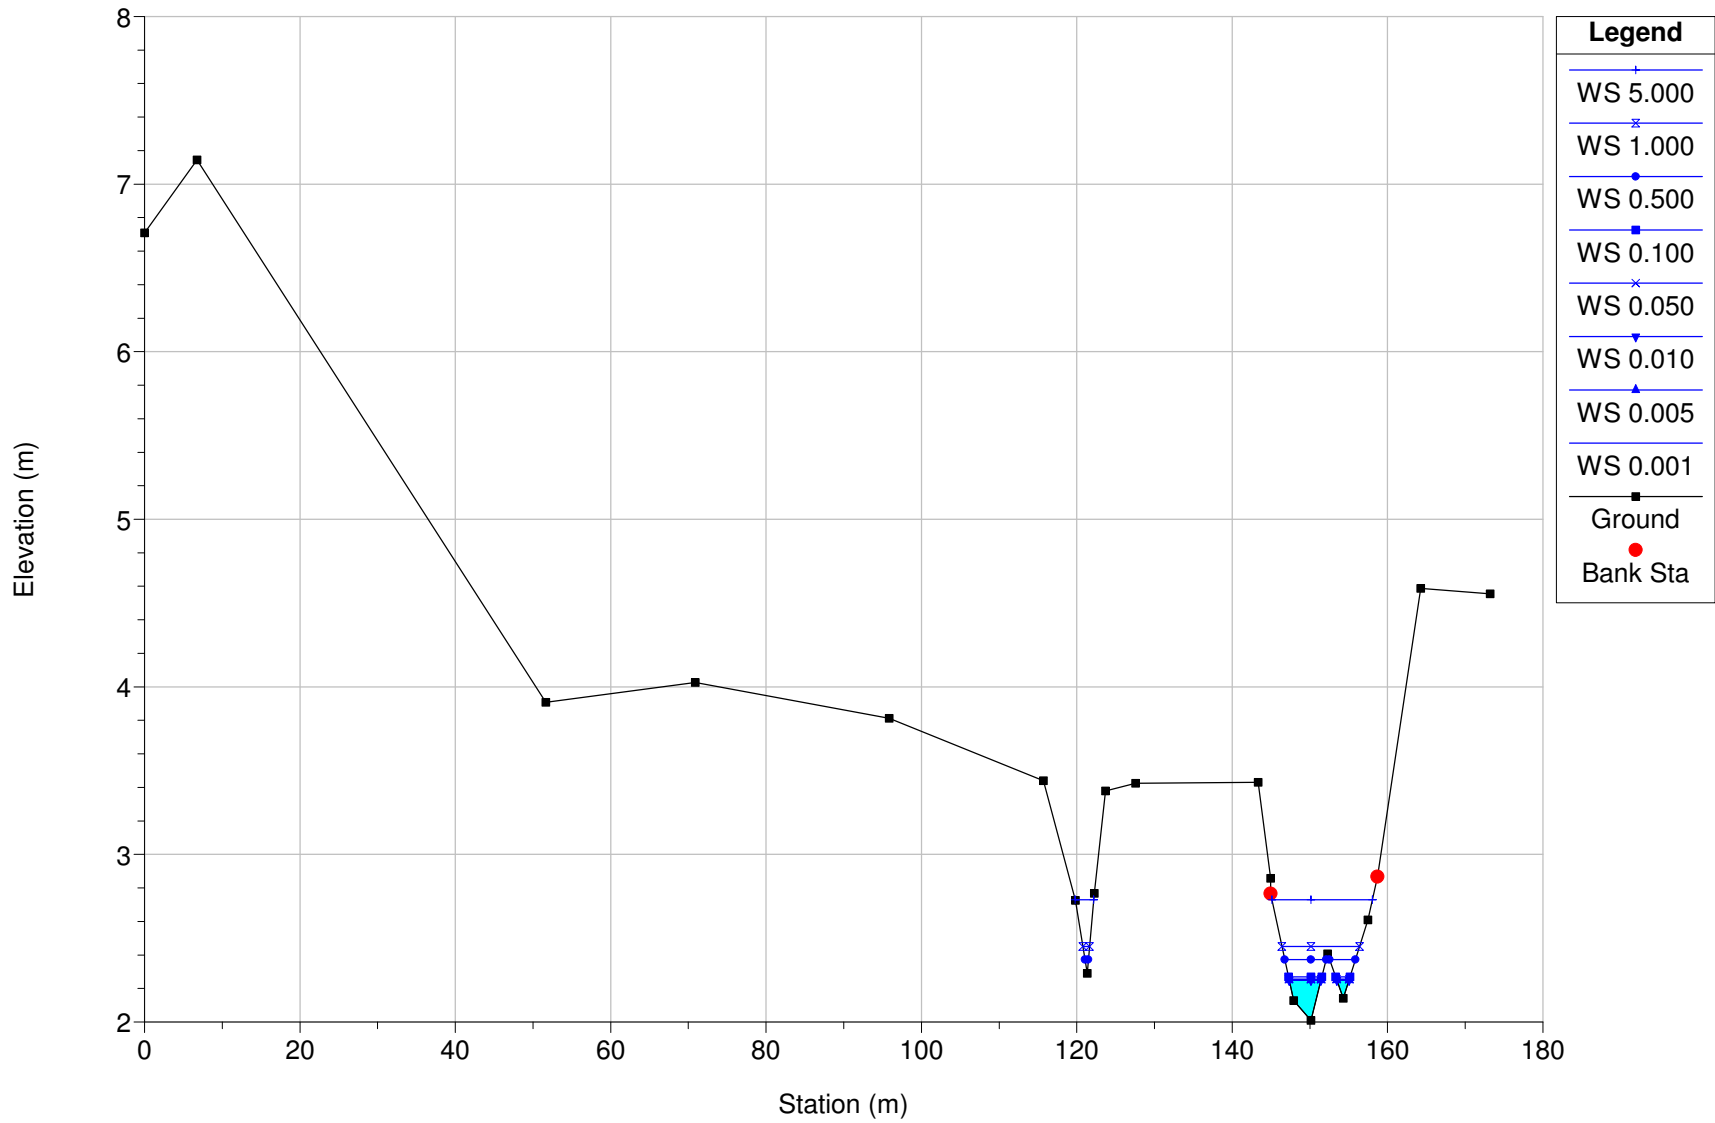


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 3

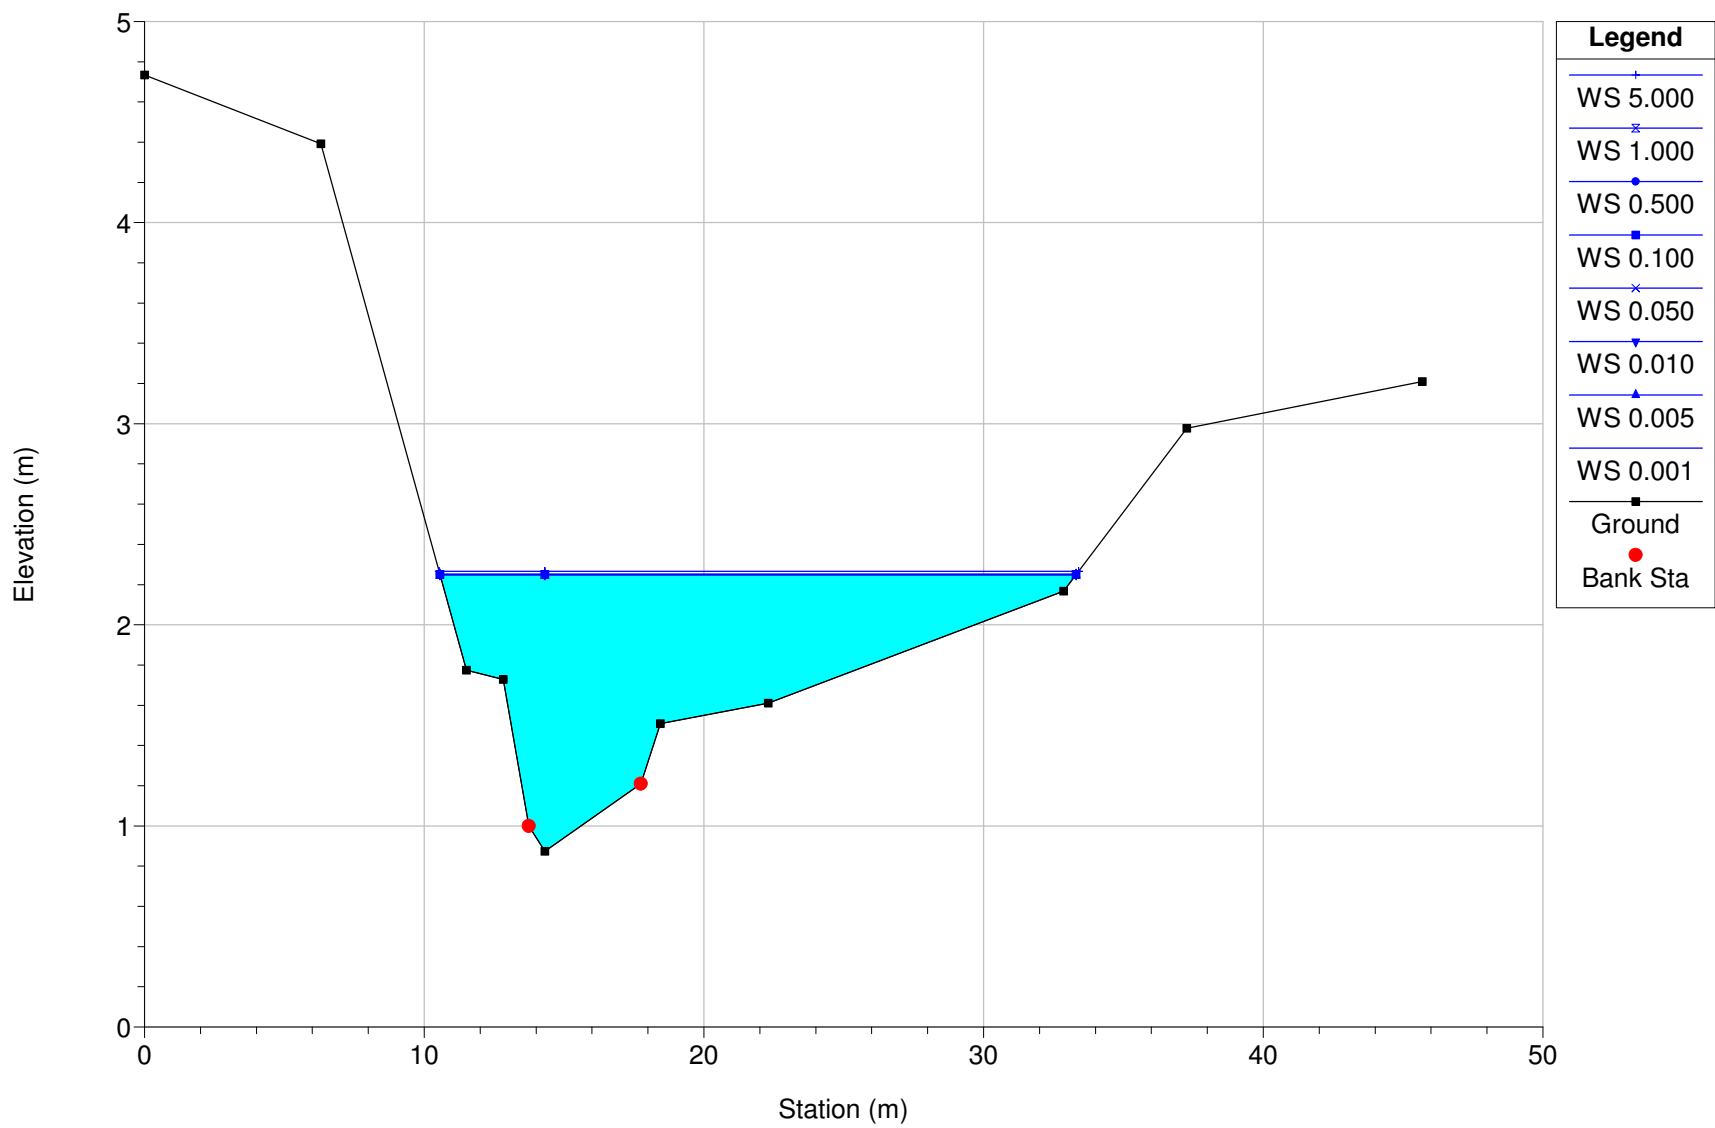


Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 2

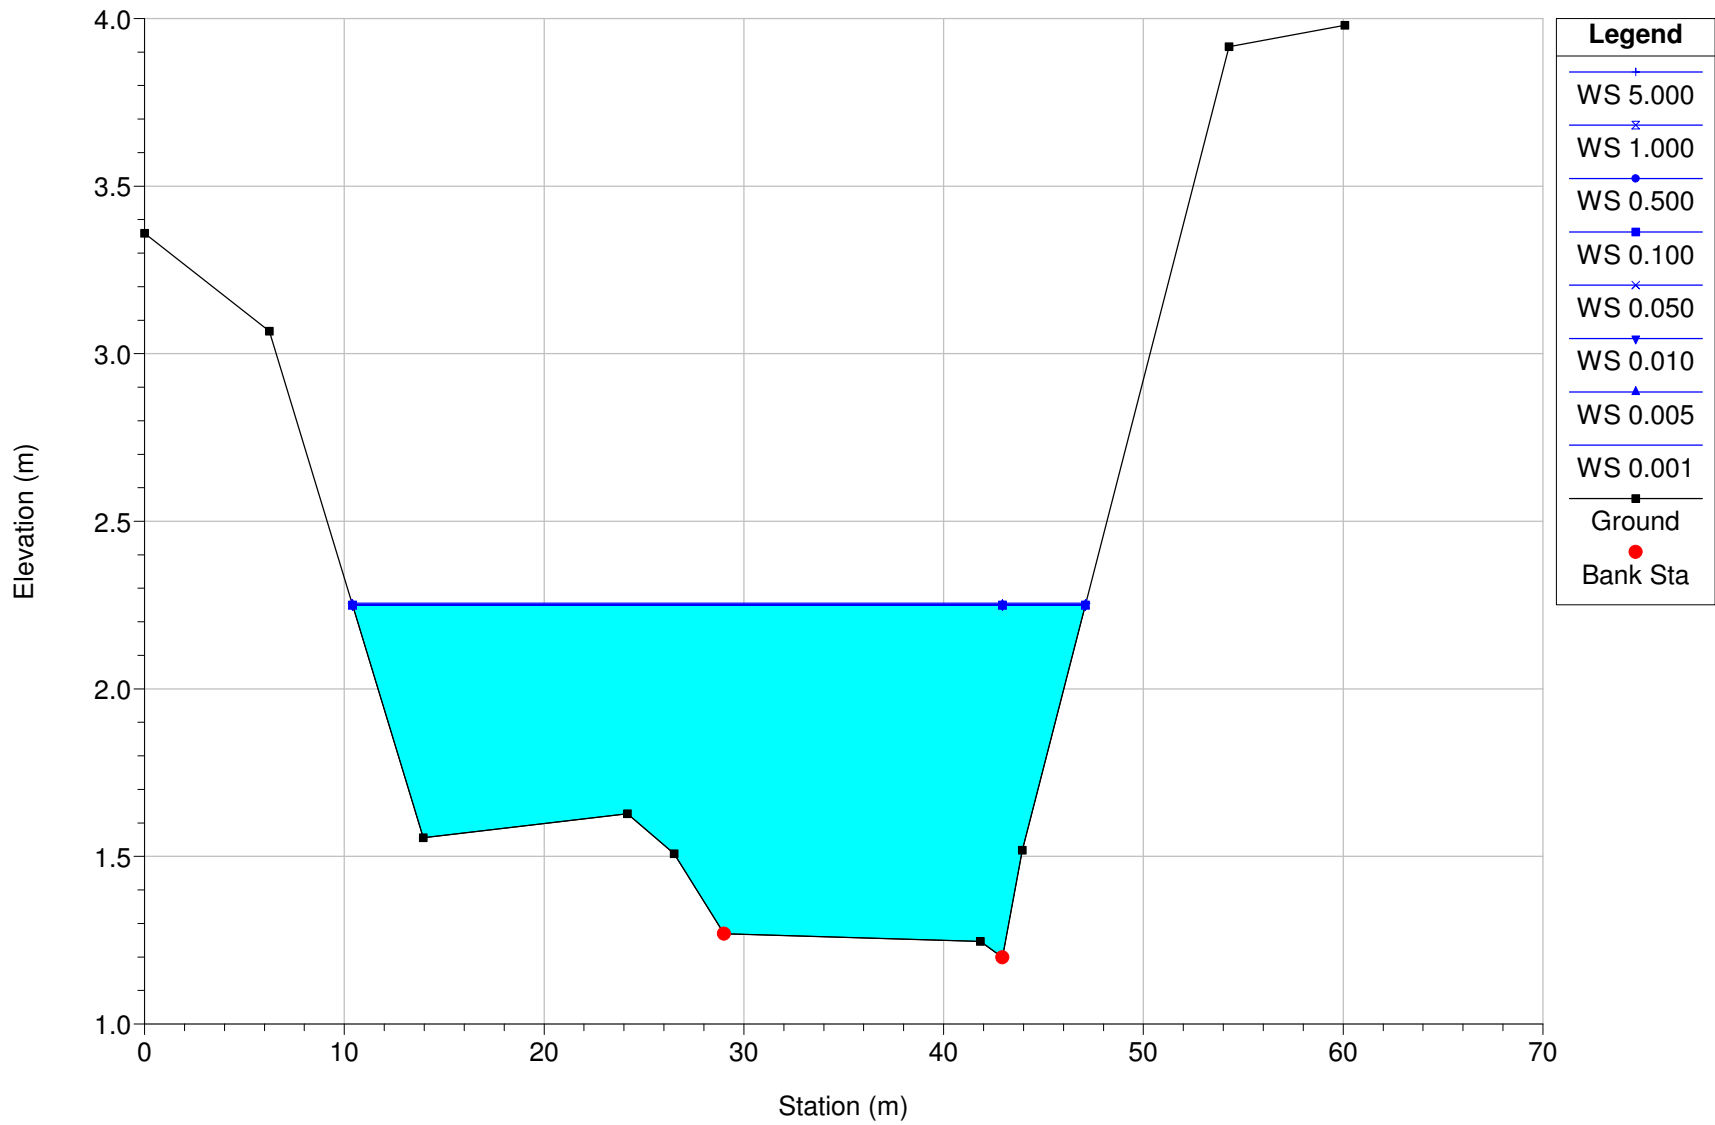

Char River Plan: Char River Rating Curve

River = Char Reach = 1 RS = 1

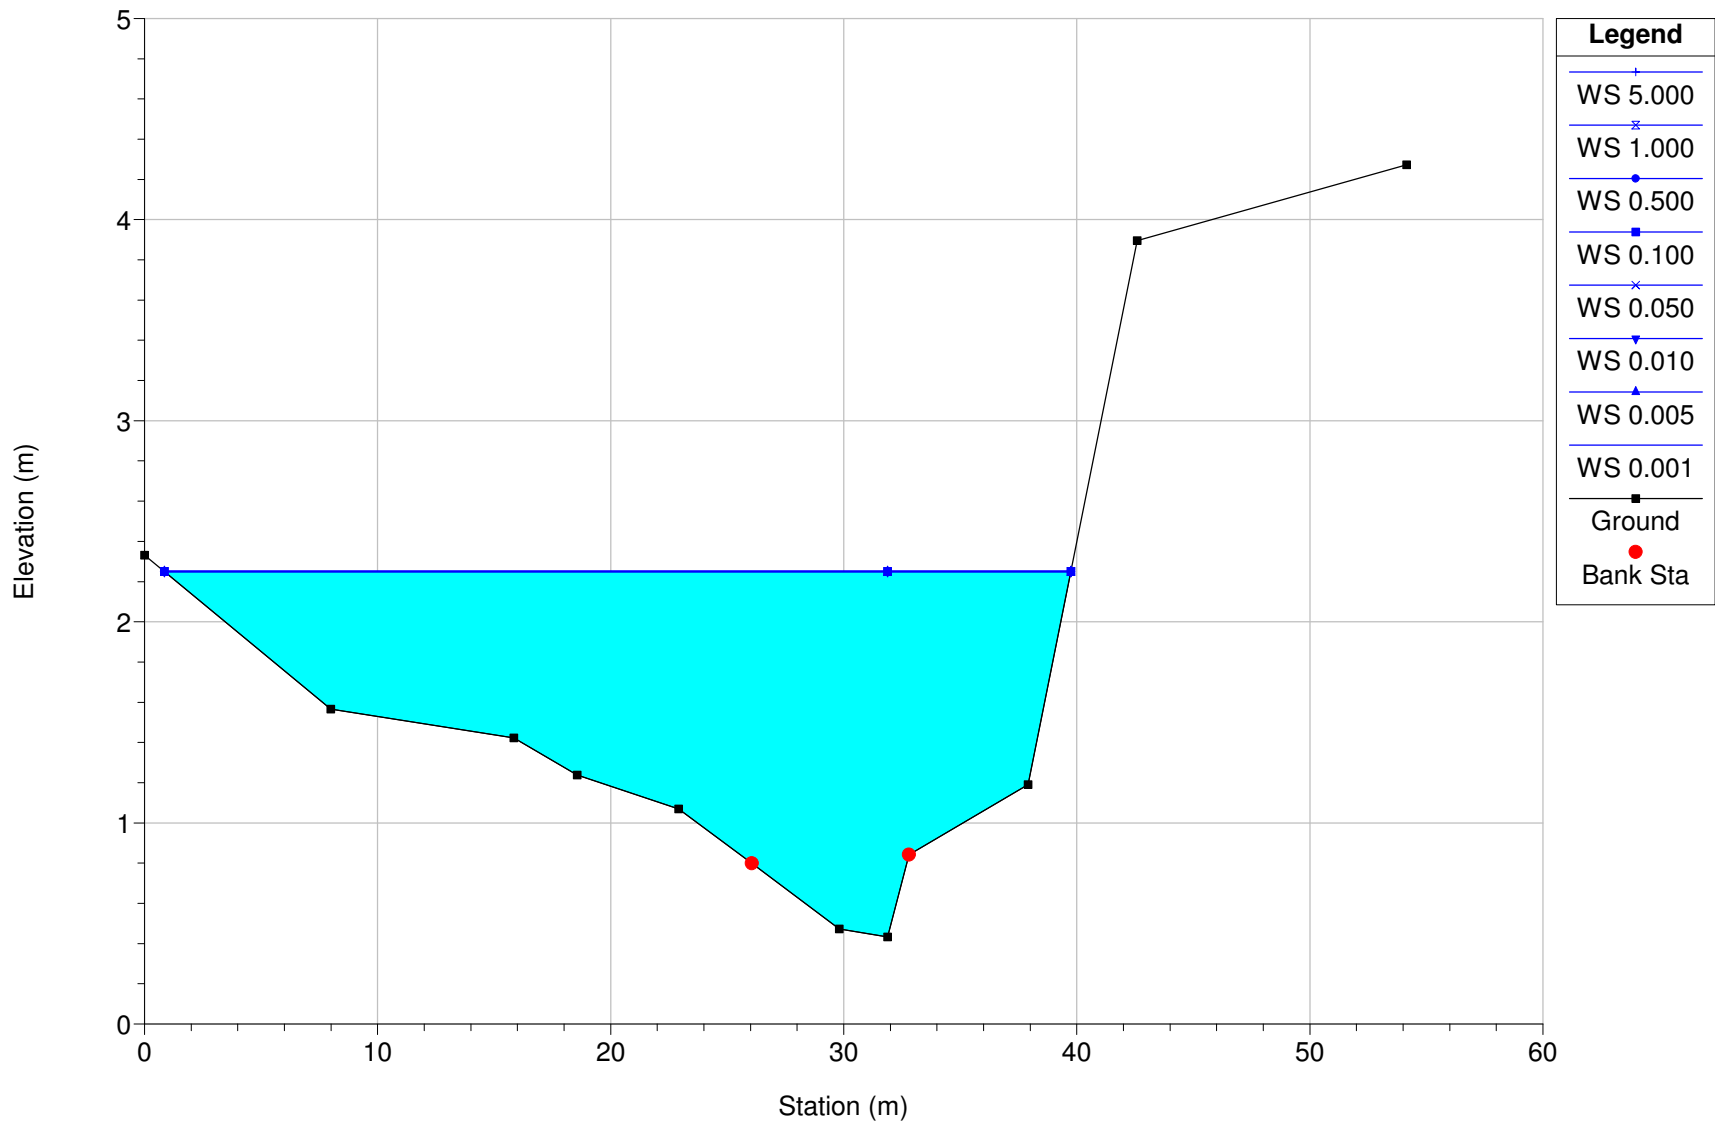

Appendix C – Char River Water Pumped to Nipissar Lake 2015



Char River Water Pumped to Nipissar Lake

Water Licence No. 3AM-GRA1015

GRA-6

Date	Time	Flow Meter Reading (m ³)	Daily Volume Pumped (m ³)	Total Volume Pumped (m ³)	Nipissar Lake Elevations		Change in Elevation*	
					(inches)	(m)	(inches)	(m)
18-Jun-15	11:40 AM	7	-	-				
19-Jun-15	9:05 AM	2651	2644	2644	123.875	3.146425		
20-Jun-15	7:45 AM	5427	2776	5420				
21-Jun-15	8:00 AM	8399	2972	8392				

28-Jul-15								
29-Jul-15	9:30 AM	117609	5845	117602				
30-Jul-15	1:53 PM	121007	3398	121000				
31-Jul-15	9:30 AM	123371	2364	123364				
01-Aug-15	7:45 AM	126016	2645	126009				
02-Aug-15	7:45 AM	128880	2864	128873				
03-Aug-15	7:45 AM	131766	2886	131759				
04-Aug-15	8:30 AM	134796	3030	134789				
05-Aug-15	9:15 AM	137481	2685	137474				
06-Aug-15	10:15 AM	140815	3334	140808				

17-Sep-15								
18-Sep-15								
19-Sep-15								
20-Sep-15								
21-Sep-15								
22-Sep-15								
23-Sep-15								
24-Sep-15								
25-Sep-15					113.25	2.87655	10.625	0.269875

*from first reading

Last day of pumping

Appendix C – Summary of Water Chemistry Analysis 2014

