
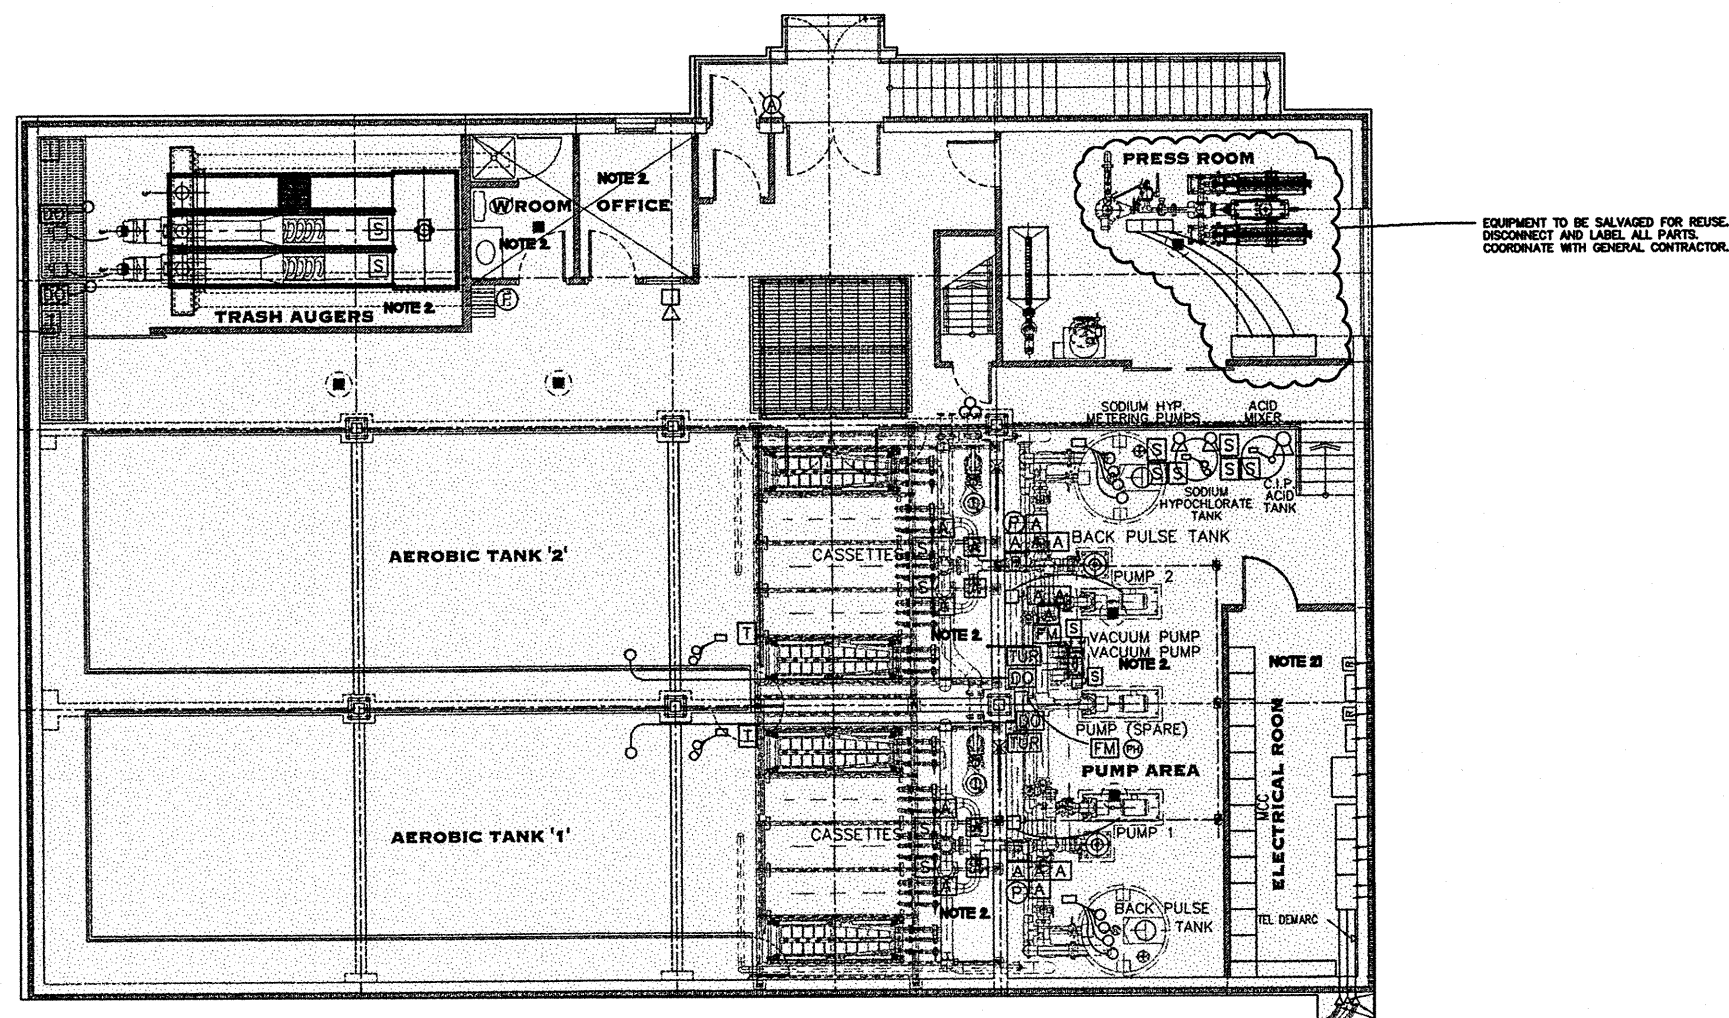


NOTES

1. ALL ELECTRICAL EQUIPMENT IS TO BE DISCONNECTED AND REMOVED EXCEPT WHERE NOTED OTHERWISE.
2. ALL ELECTRICAL CONDUIT WIRING AND EQUIPMENT IS TO BE DISCONNECTED AND REMOVED. NO EXISTING CONDUIT, WIRING OR EQUIPMENT IS TO BE REUSED.

LOWER LEVEL - DEMOLITION PLAN

1:75



UPPER LEVEL - DEMOLITION PLAN

1:75

**PRELIMINARY
Not For Construction**

OCT.15.2004

No.	Date	Description
A	2004 OCT 15	ISSUED FOR 90% REVIEW

REVISIONS

City of Iqaluit, Nunavut

Design: WA

Drawn: YLC

Approved: Chief

Director

Project Title

**CITY OF IQALUIT
WASTEWATER
TREATMENT PLANT**

Drawing Title

**ELECTRICAL
DEMOLITION PLAN**

Scale: AS SHOWN

Project No. 75360

Date: SEPT 2004

Drawing No. E2.01

Revision: A