
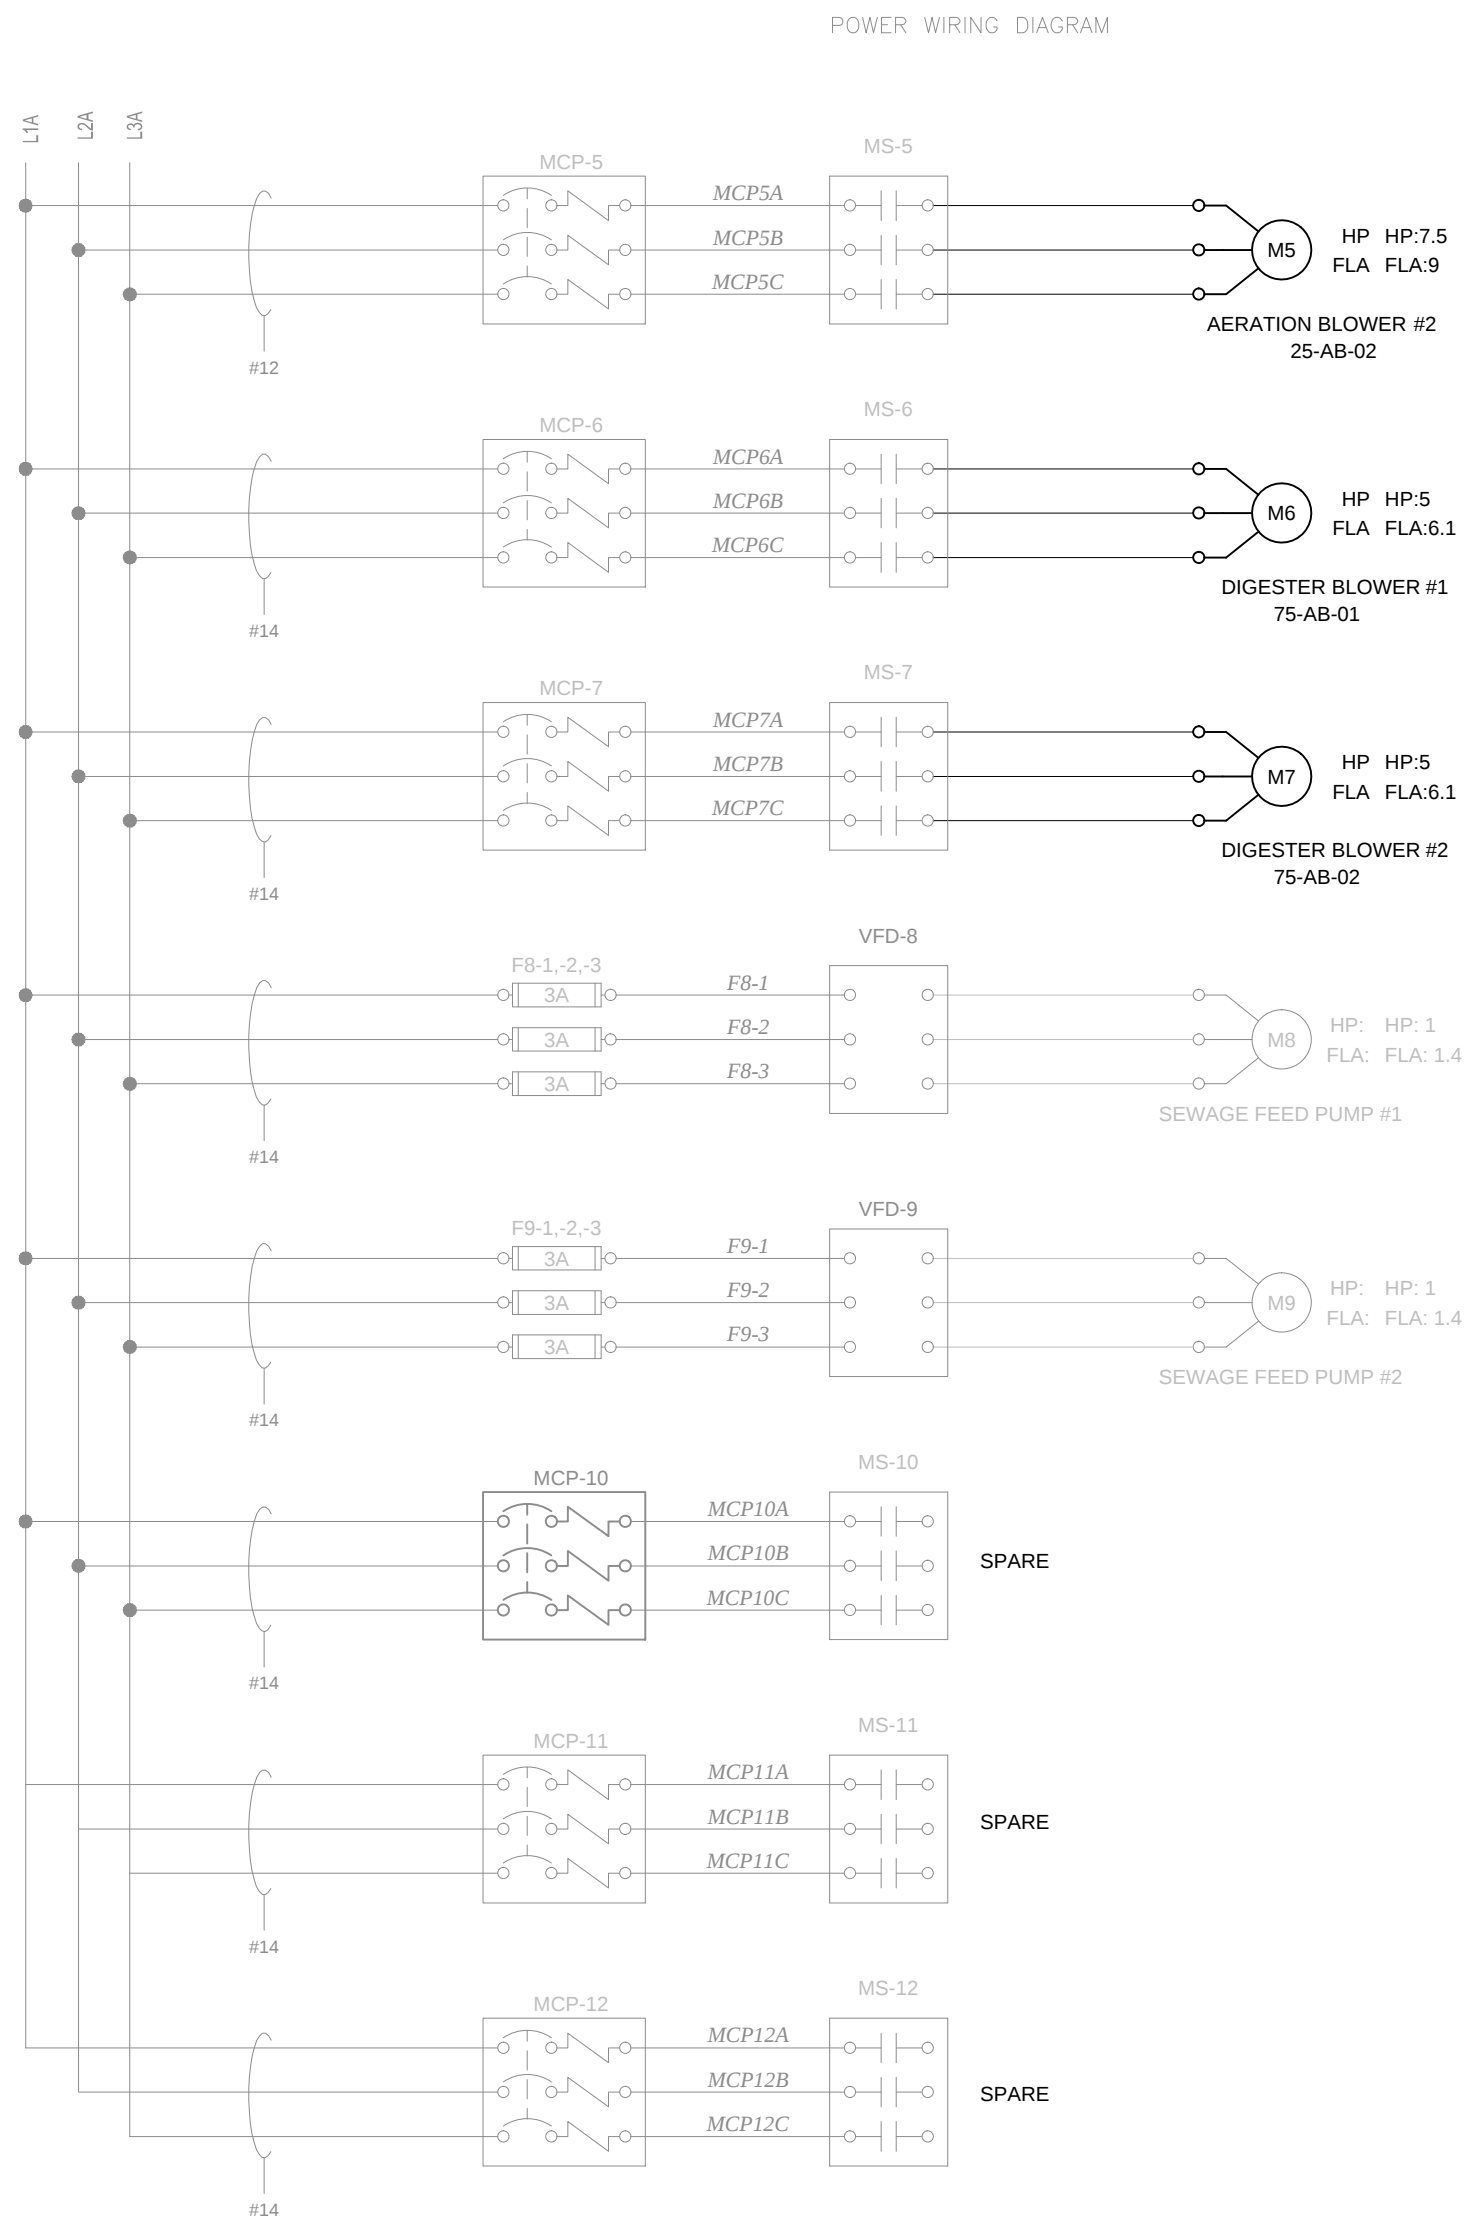


PLC #3 POWER WIRING

NOTES

DATE: 2013/07/15

PLC #3 POWER WIRING

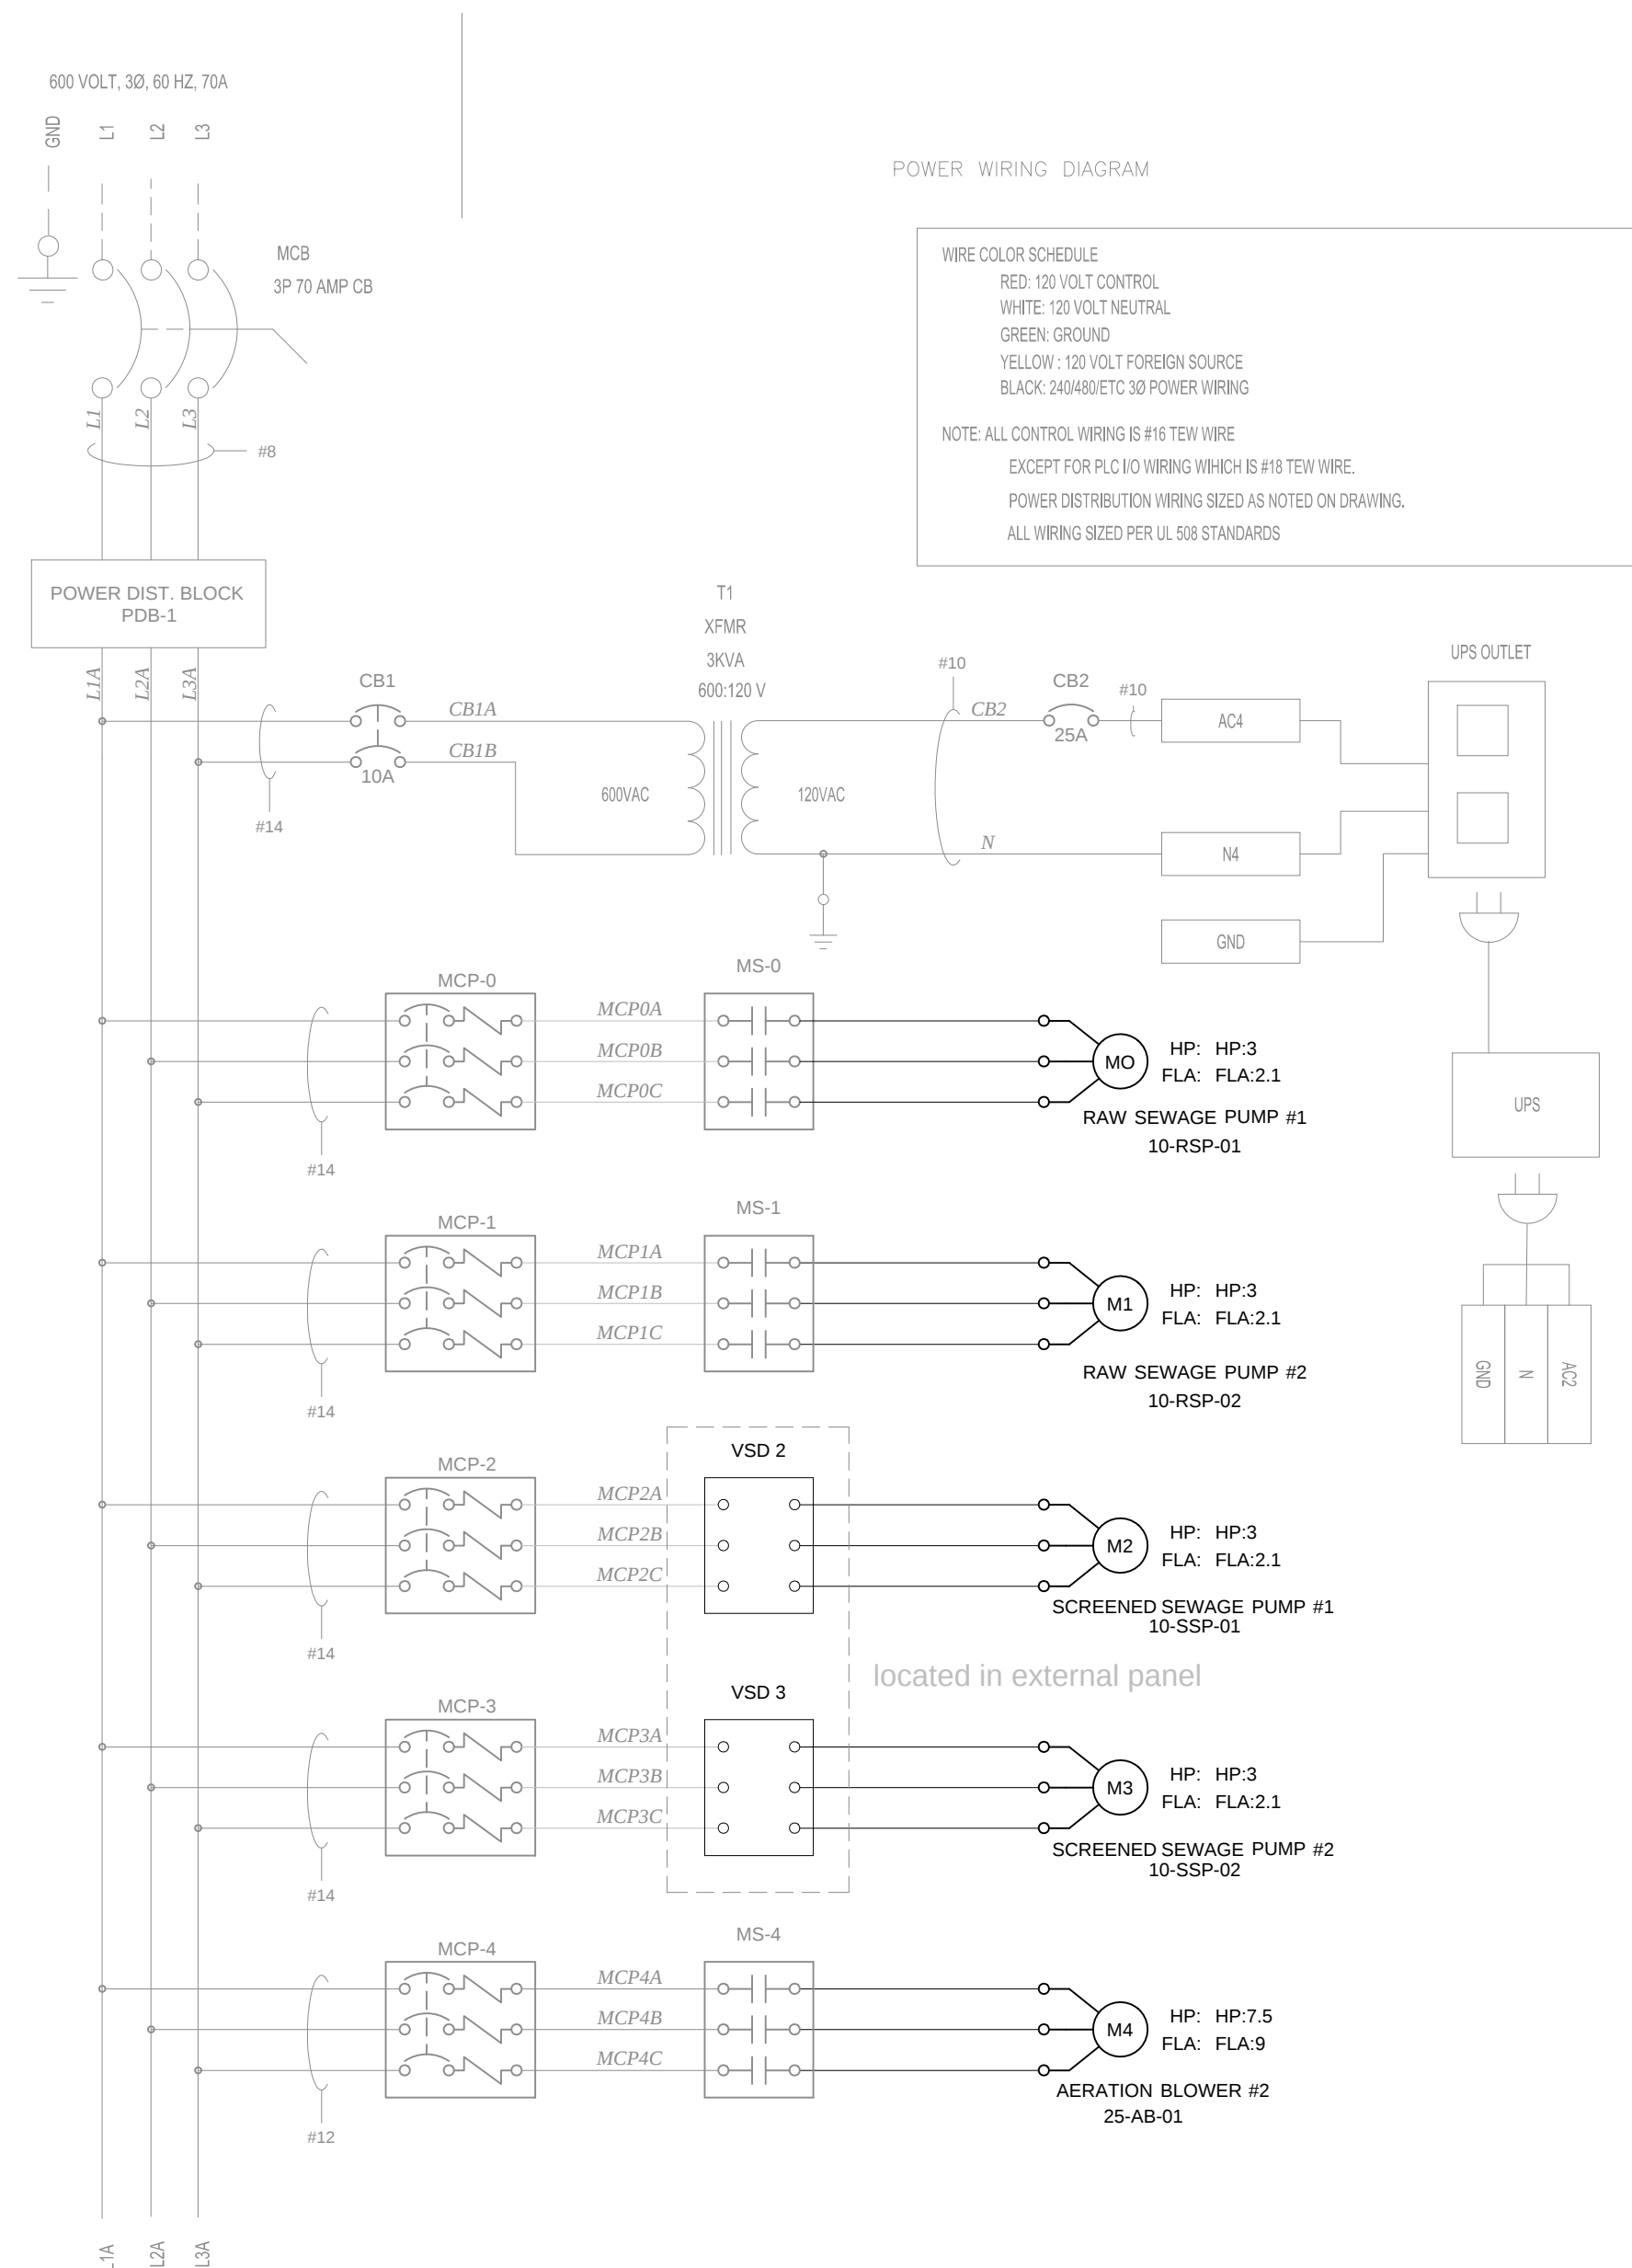

NOTES:

1. VERIFY MOTOR OVERLOAD SIZE IS CORRECT FOR NEW MOTOR. CONTRACTOR TO PROVIDE NEW OVERLOAD AS REQUIRED.
2. ALL WIRING, CONDUITS, AND CABLES ASSOCIATED WITH THE FOLLOWING EQUIPMENT IS TO BE REMOVED BACK TO THE SOURCE: 2 x MAIN FEED PUMPS, 4 x WASTE SLUDGE PUMPS, 4 x SCUM PUMPS, 2 x EQUALIZATION BLOWERS.
3. REMOVE ANY LOCAL DISCONNECTS ASSOCIATED WITH THE EQUIPMENT LISTED IN 2.
4. RE-PURPOSE BREAKERS AND STARTERS IN THE PANEL WHERE POSSIBLE. MARK ANY UNUSED AS SPARE.
5. PLUG ANY UNUSED PENETRATIONS IN ELECTRICAL ENCLOSURES.
6. REMOVE ALL WIRING AND CONDUIT ASSOCIATED WITH THE EXISTING EFFLUENT FLOW METER BACK TO PANEL.

No.	Issue	Date
1	60% REVIEW SUBMISSION	2013-MAR-08
2	ISSUED FOR TENDER	2013-APR-10
3	RELEASED FOR CONSTRUCTION	2013-JUN-27



No.	Revision	Ckd. By	Date

PERMIT OF PRACTICE
EXP SERVICES INC.

Signature: *[Signature]*

Date: 2013/JUN/27

PERMIT NUMBER: P483
NT/NU Association of Professional Engineers and Geoscientists.

RELEASED FOR CONSTRUCTION

Const. North

Drawn By: TAW

Dwg. Standards Ckd. By: PD

Designed By: DEB

Dwg. Design Ckd. By: JFP

Date Printed

exp Services Inc.

t: +1.613.688.1899 | f: +1.613.225.7330

2650 Queensview Drive, Unit 100

Ottawa, ON K2B 8H6

CANADA

www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title

WASTE WATER TREATMENT PLANT UPGRADE PANGNIERTUNG, NU

Dwg. Title

PLC #3 PANEL WIRING (SHEET 2 OF 3)

Project No. OTT-00204430-A0

Dwg. No. E2611-1 Rev. No. 0

Scale

NOT TO SCALE
This drawing is not to be scaled