
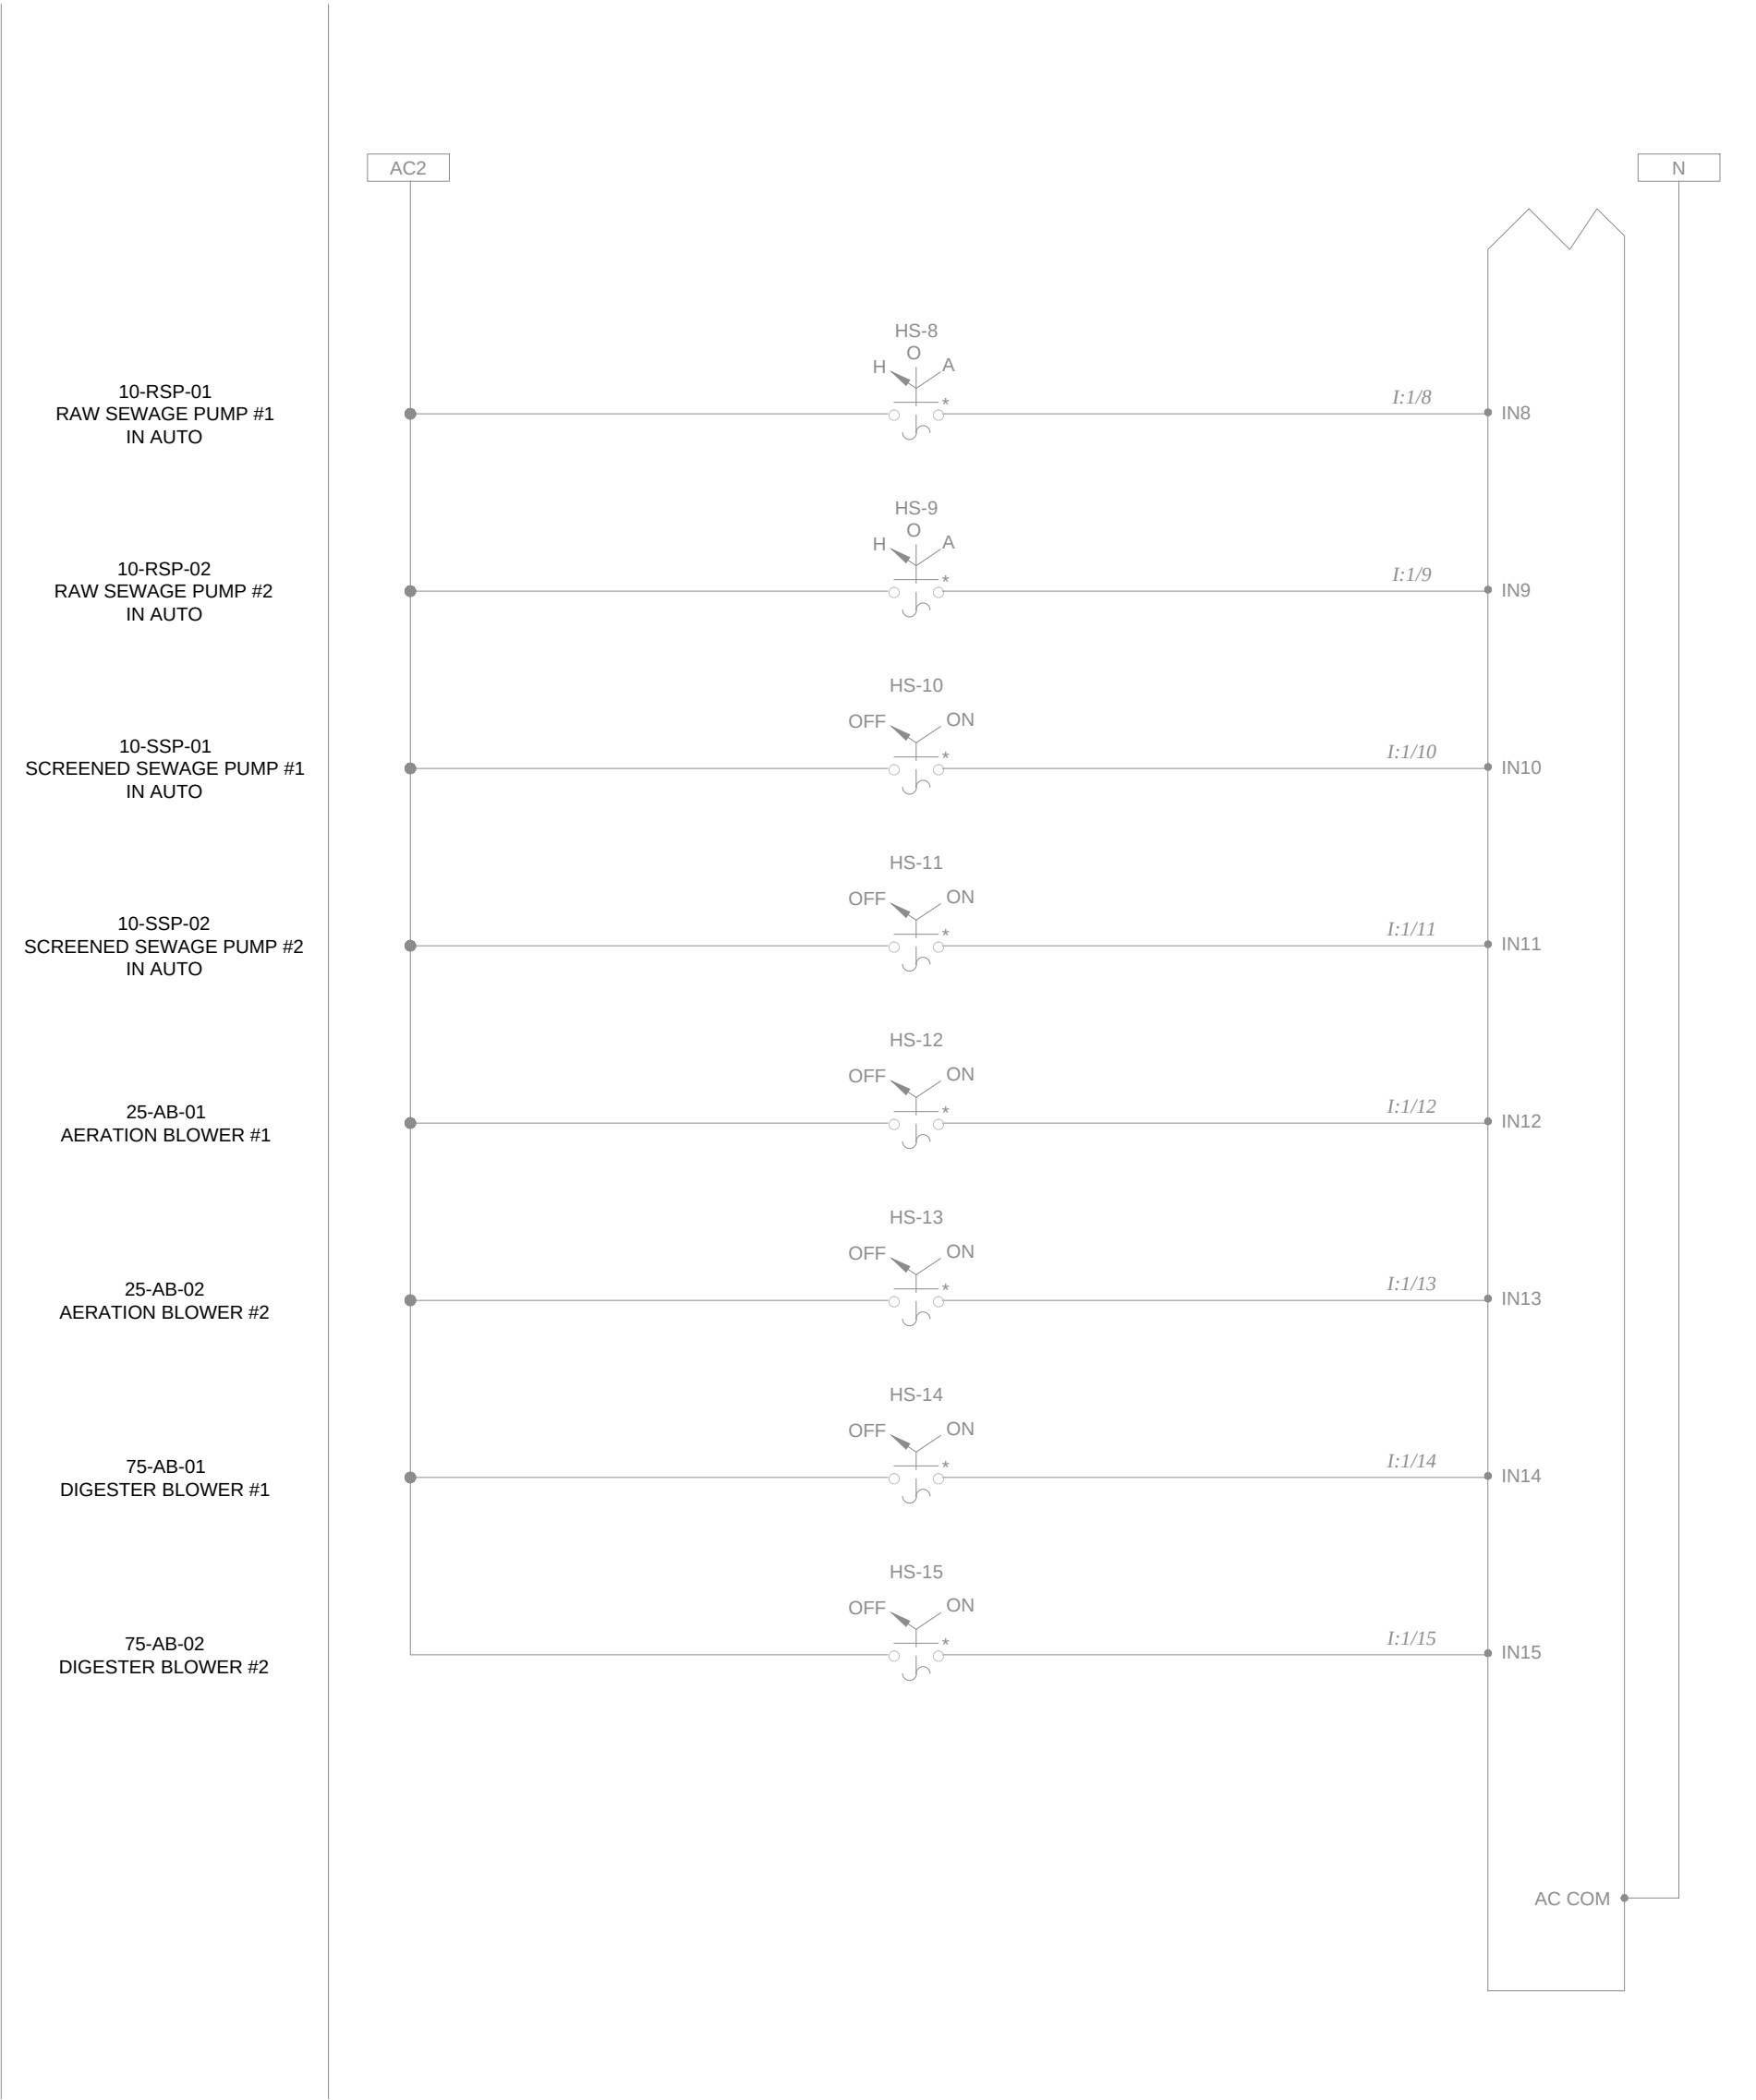


NOT FOR CONSTRUCTION

NOT FOR CONSTRUCTION

NOT FOR CONSTRUCTION

DISCRETE INPUTS SLOT 1

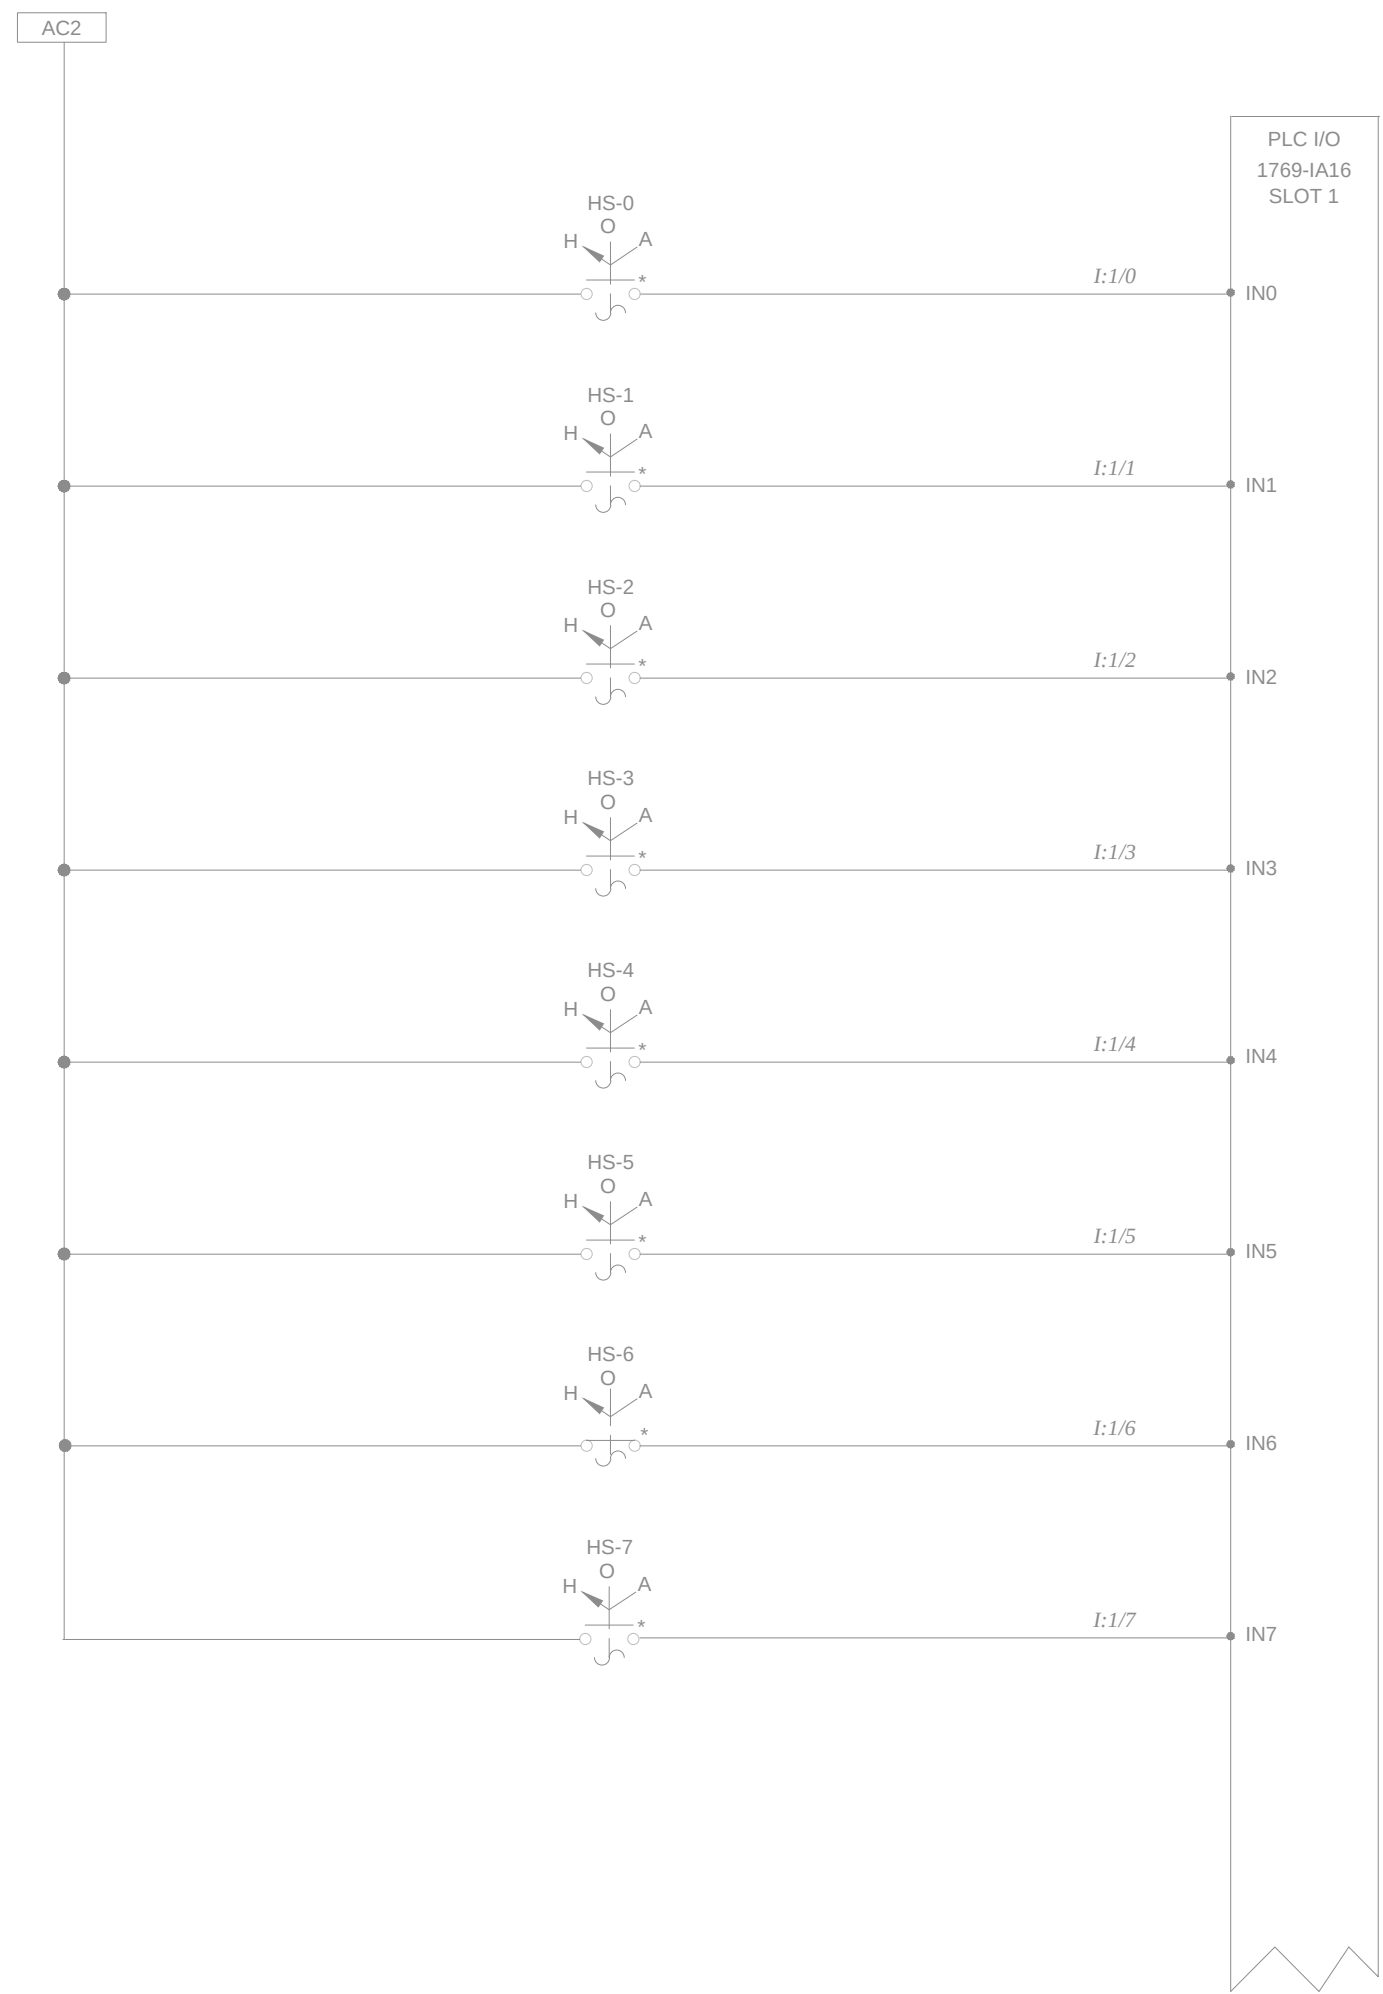

SEWAGE FEED PUMP #1
IN AUTO

SEWAGE FEED PUMP #2
IN AUTO

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

No.	Issue	Date
1	60% REVIEW SUBMISSION	2013-MAR-08
2	ISSUED FOR TENDER	2013-APR-10
3	RELEASED FOR CONSTRUCTION	2013-JUN-27
No.	Revision	Ckd. By Date

PERMIT OF PRACTICE
EXP SERVICES INC.
Signature *[Signature]*
Date 2013/JUN/27
PERMIT NUMBER: P483
NT/NU Association of Professional
Engineers and Geoscientists .

RELEASED FOR CONSTRUCTION

Const. North

Drawn By: TAW
Dwg. Standards Ckd. By: PD
Designed By: DEB
Date Printed
Dwg. Design Ckd. By: JFP

exp Services Inc.
t: +1.613.688.1899 | f: +1.613.225.7330
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA
www.exp.com

- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title

WASTE WATER
TREATMENT PLANT
UPGRADE
PANGNIRTUNG, NU

Dwg. Title

PLC #3 PANEL WIRING
SLOT 1

Project No. OTT-00204430-A0
Dwg. No. E2613-1 Rev. No. 0
Scale NOT TO SCALE
This drawing is not to be scaled