


FILE C:\OTTE\20204430-A0\PLC\WIRING\WIRING-01.DWG

POSTED BY: PANGNIR TUNG

DATE: 2013/07/11/15:30

NEW DISCRETE OUTPUT SLOT 6

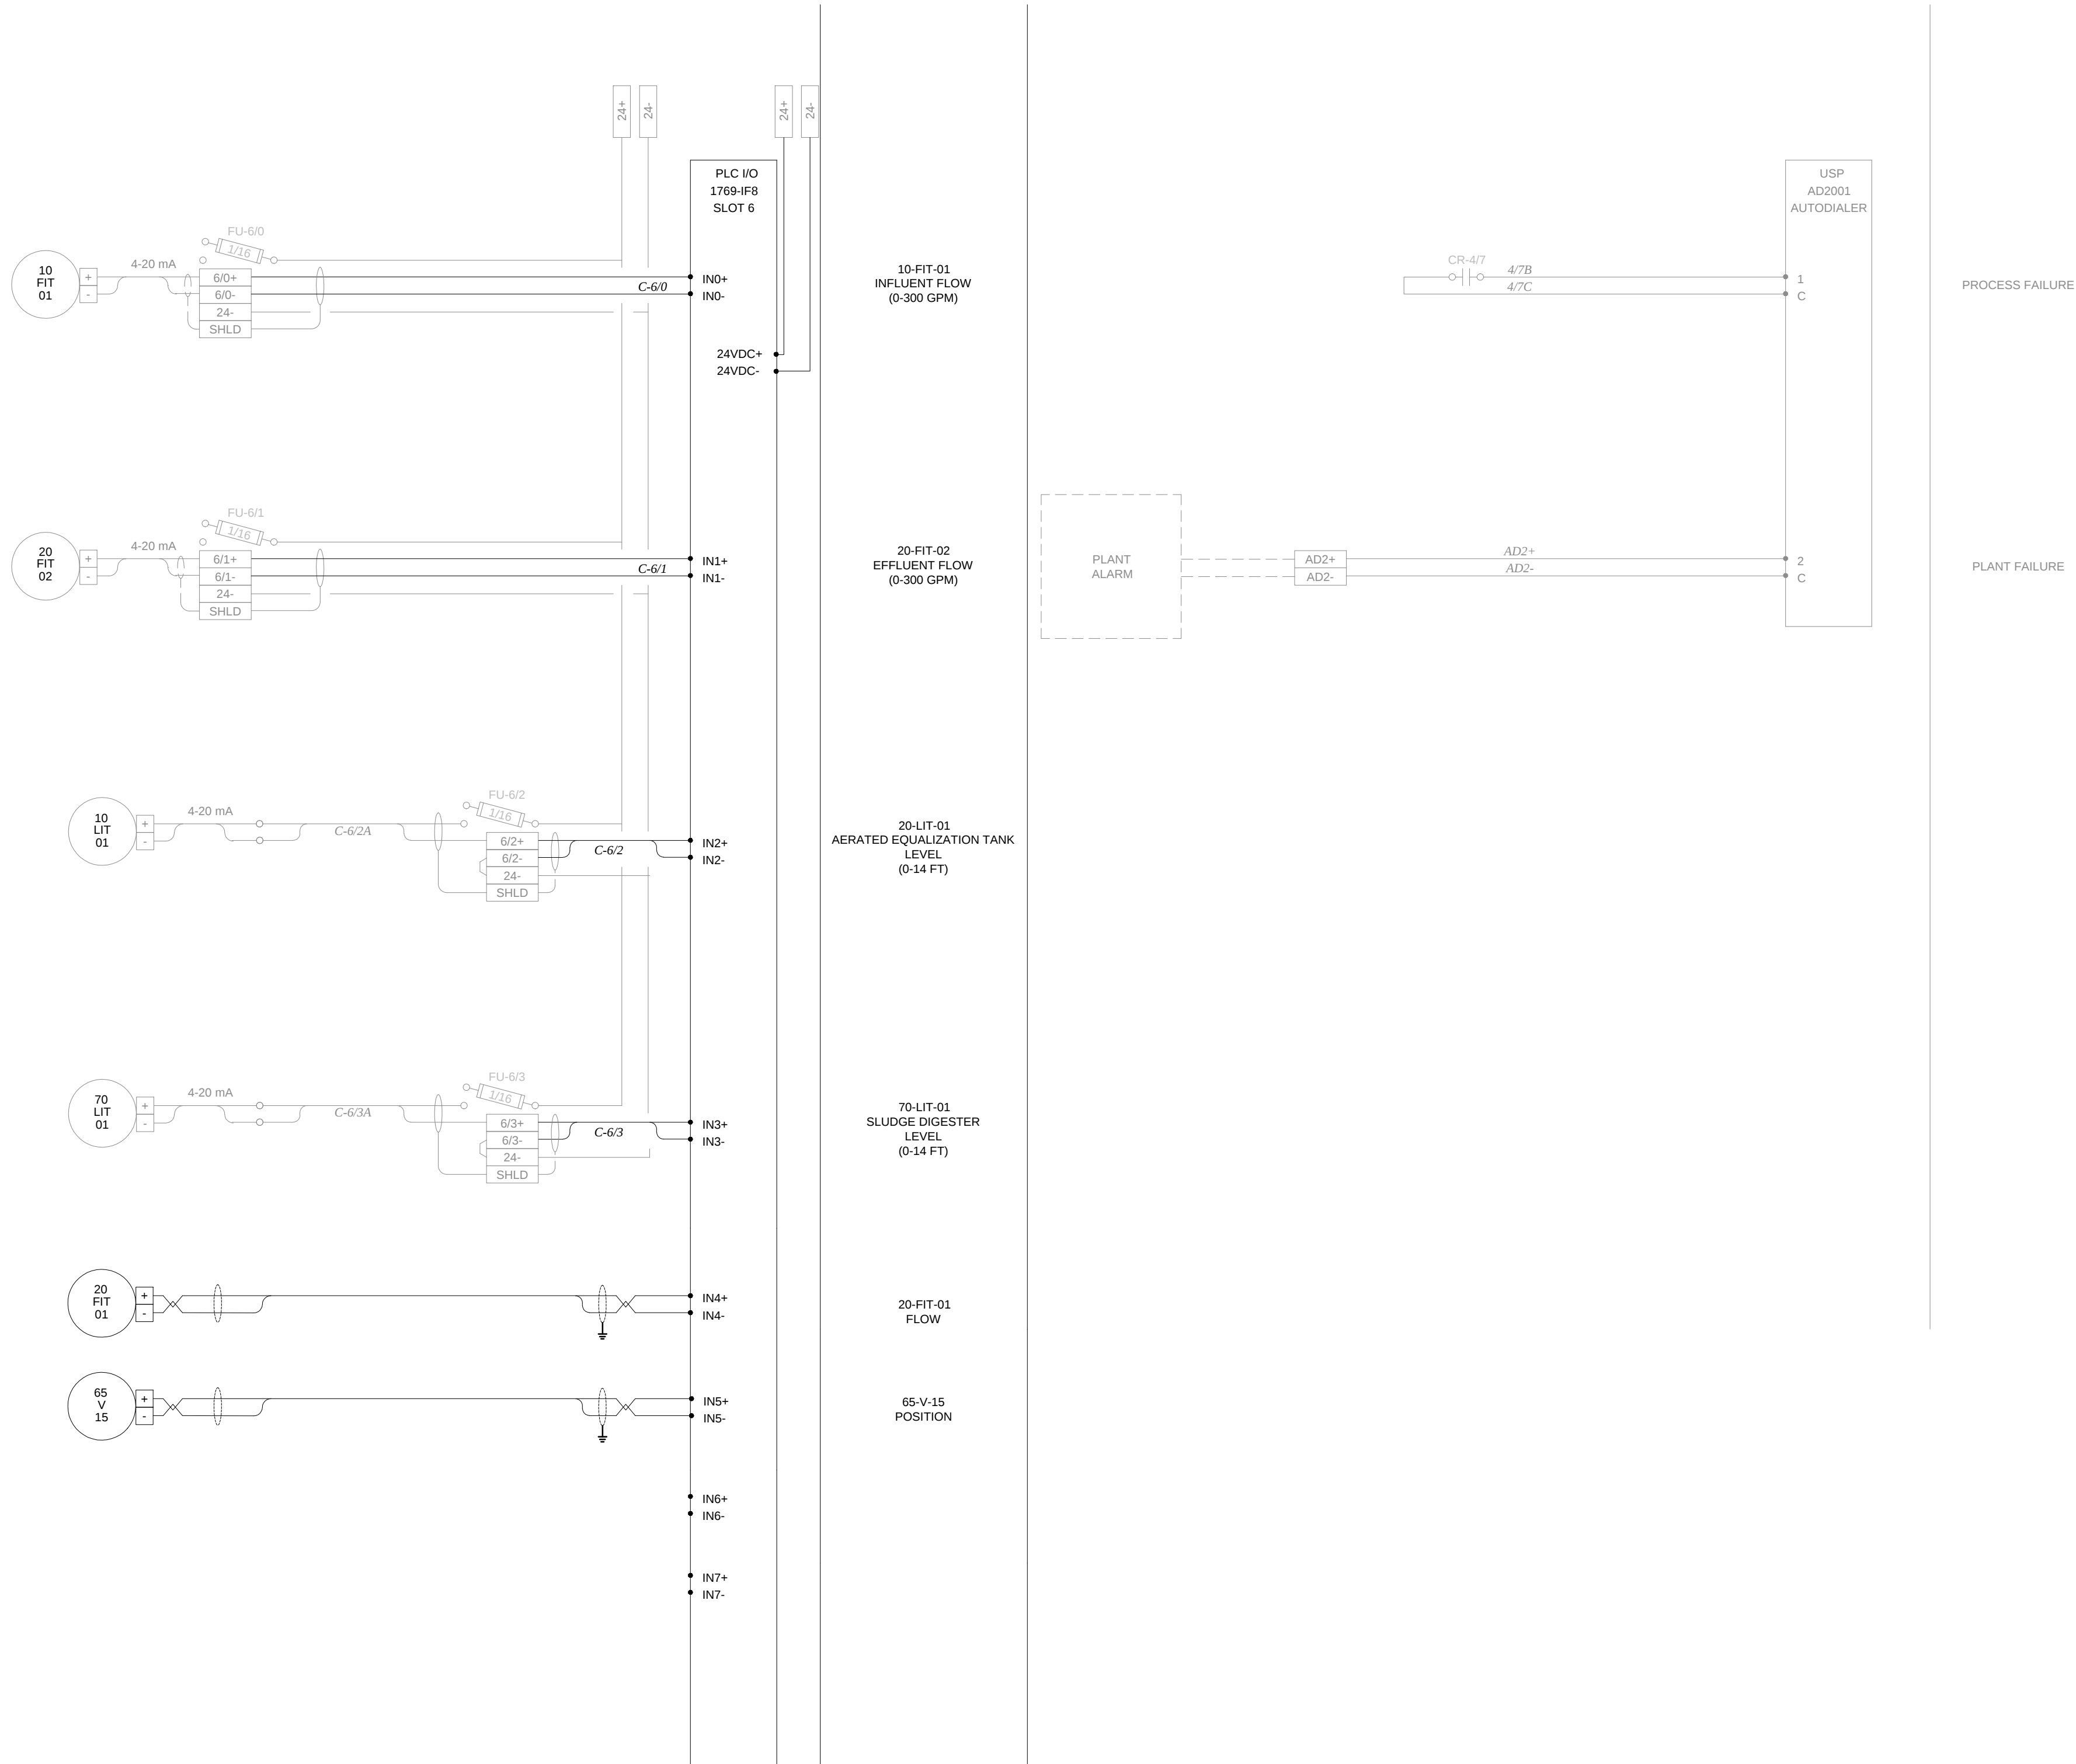

No.	Issue	Date
1	60% REVIEW SUBMISSION	2013-MAR-08
2	ISSUED FOR TENDER	2013-APR-10
3	RELEASED FOR CONSTRUCTION	2013-JUN-27

PERMIT OF PRACTICE
EXP SERVICES INC.

Signature *[Signature]*

Date 2013/JUN/27

PERMIT NUMBER: P483
NT/NU Association of Professional
Engineers and Geoscientists .

RELEASED FOR CONSTRUCTION

Const. North

Drawn By: TAW

Dwg. Standards Ckd. By: PD

Designed By: DEB

Date Printed

Dwg. Design Ckd. By: JFP

exp Services Inc.

t: +1.613.688.1899 | f: +1.613.225.7330
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA

www.exp.com

- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •

• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title

WASTE WATER
TREATMENT PLANT
UPGRADE
PANGNIRTUNG, NU

Dwg. Title

PLC #3 PANEL WIRING
SLOT 6

Project No.

OTT-00204430-A0

Dwg. No.

E2617-1

Rev. No.

0

Scale

NOT TO SCALE
This drawing is not to be scaled