



PLC I/O WIRING

PLC I/O WIRING

PLC I/O WIRING

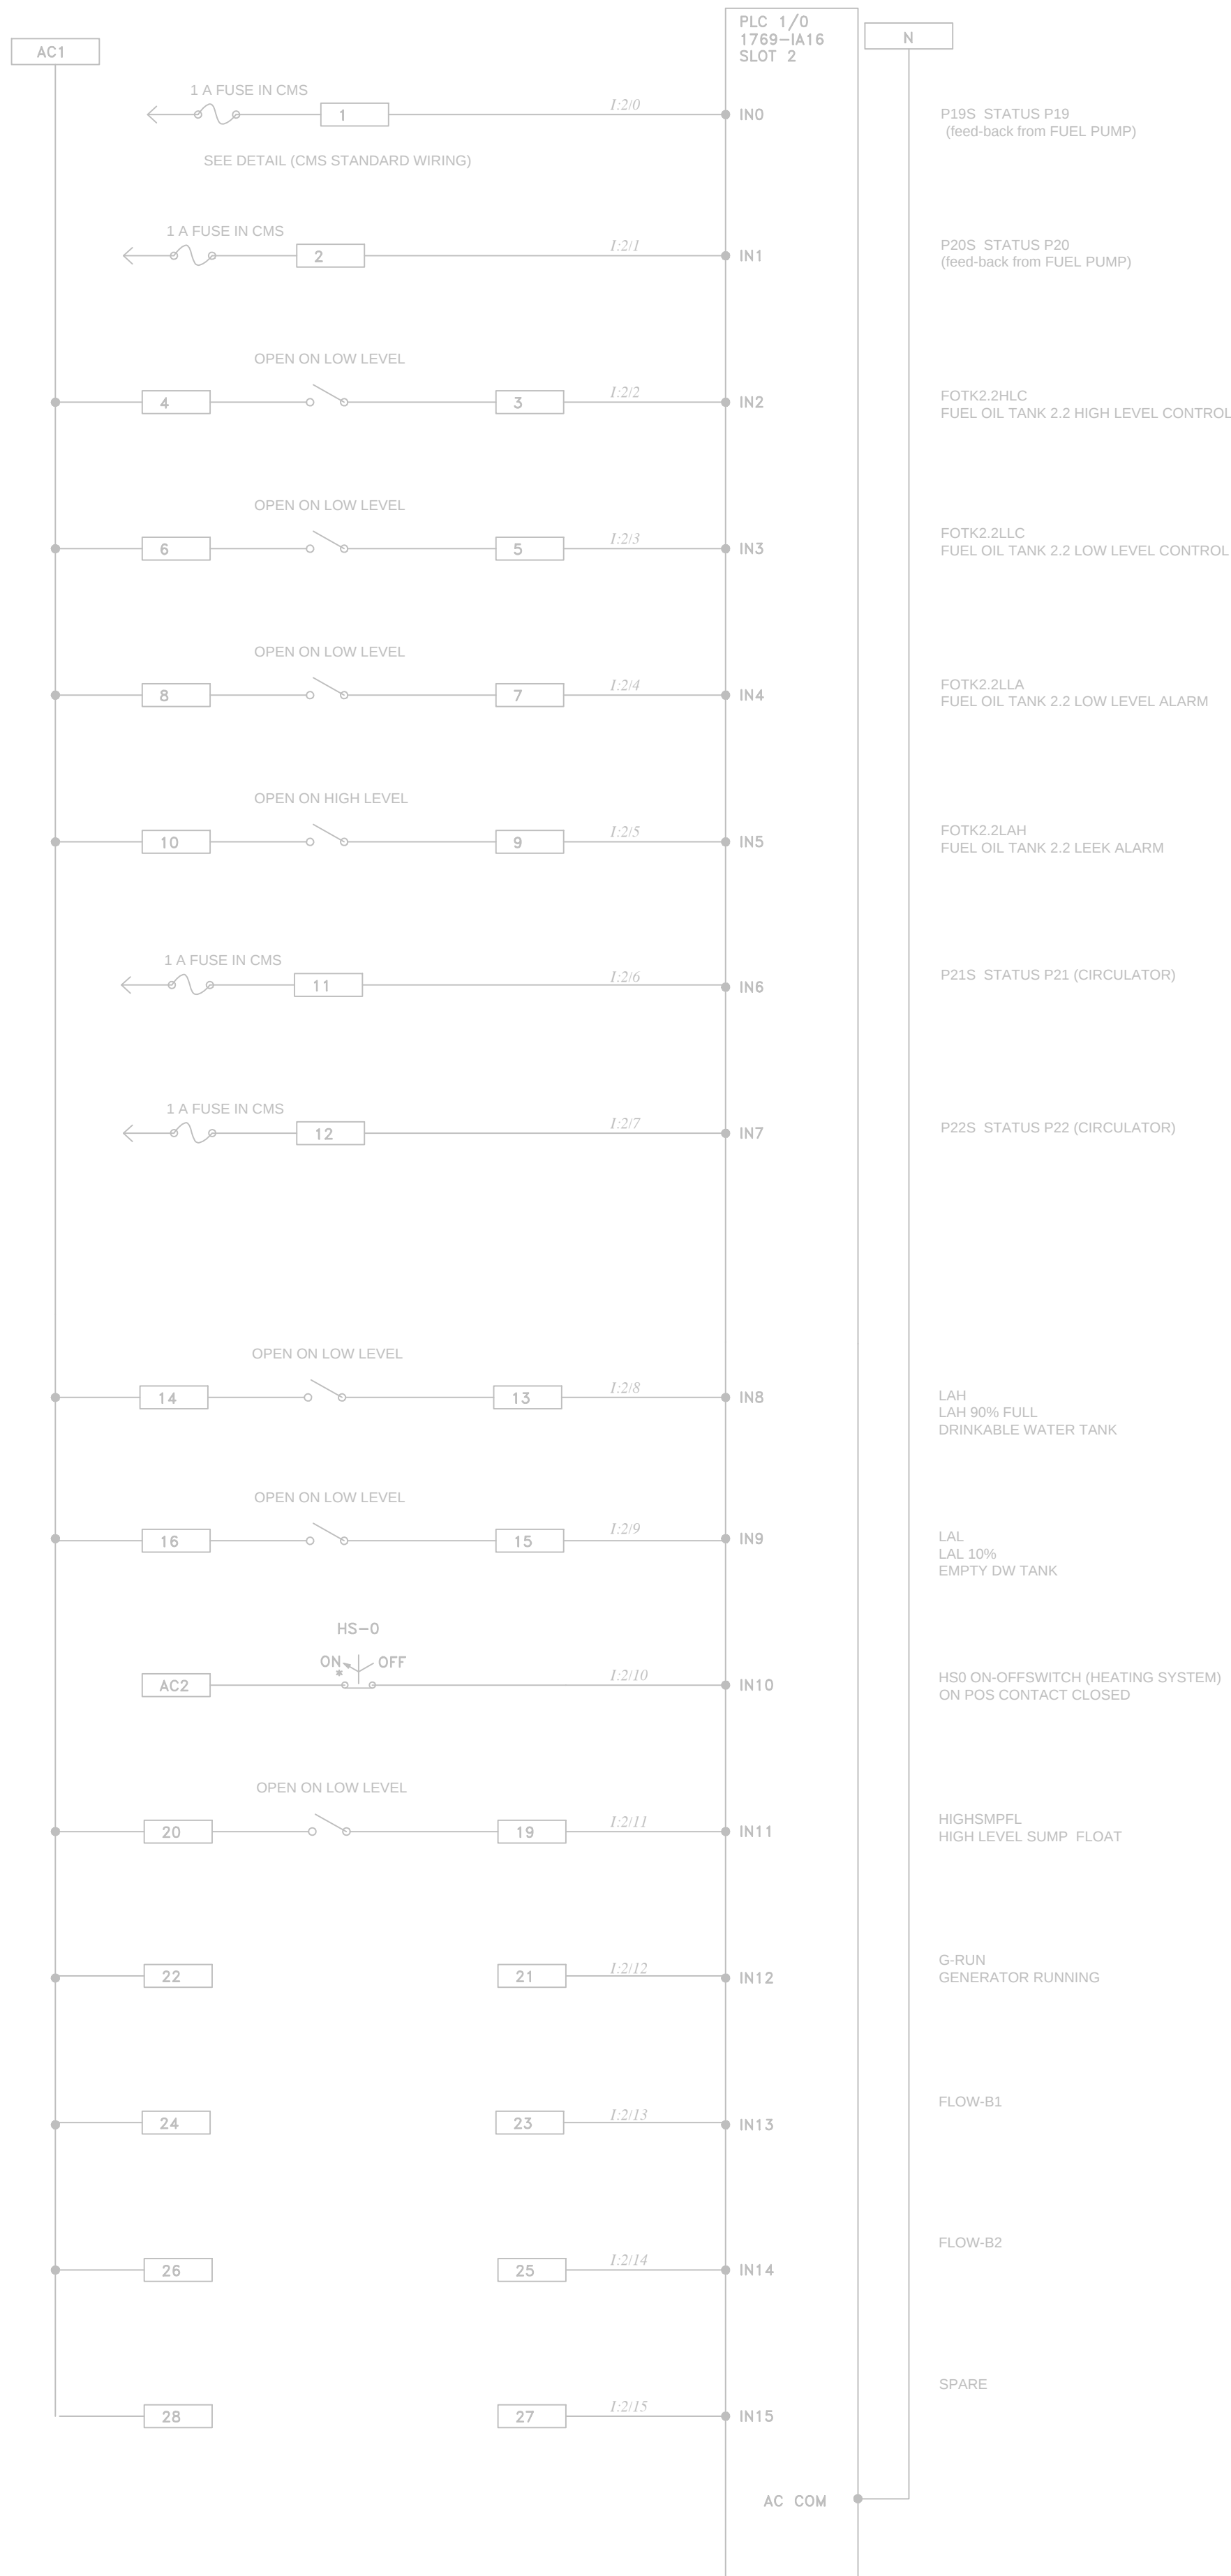

DISCRETE INPUT SLOT 2

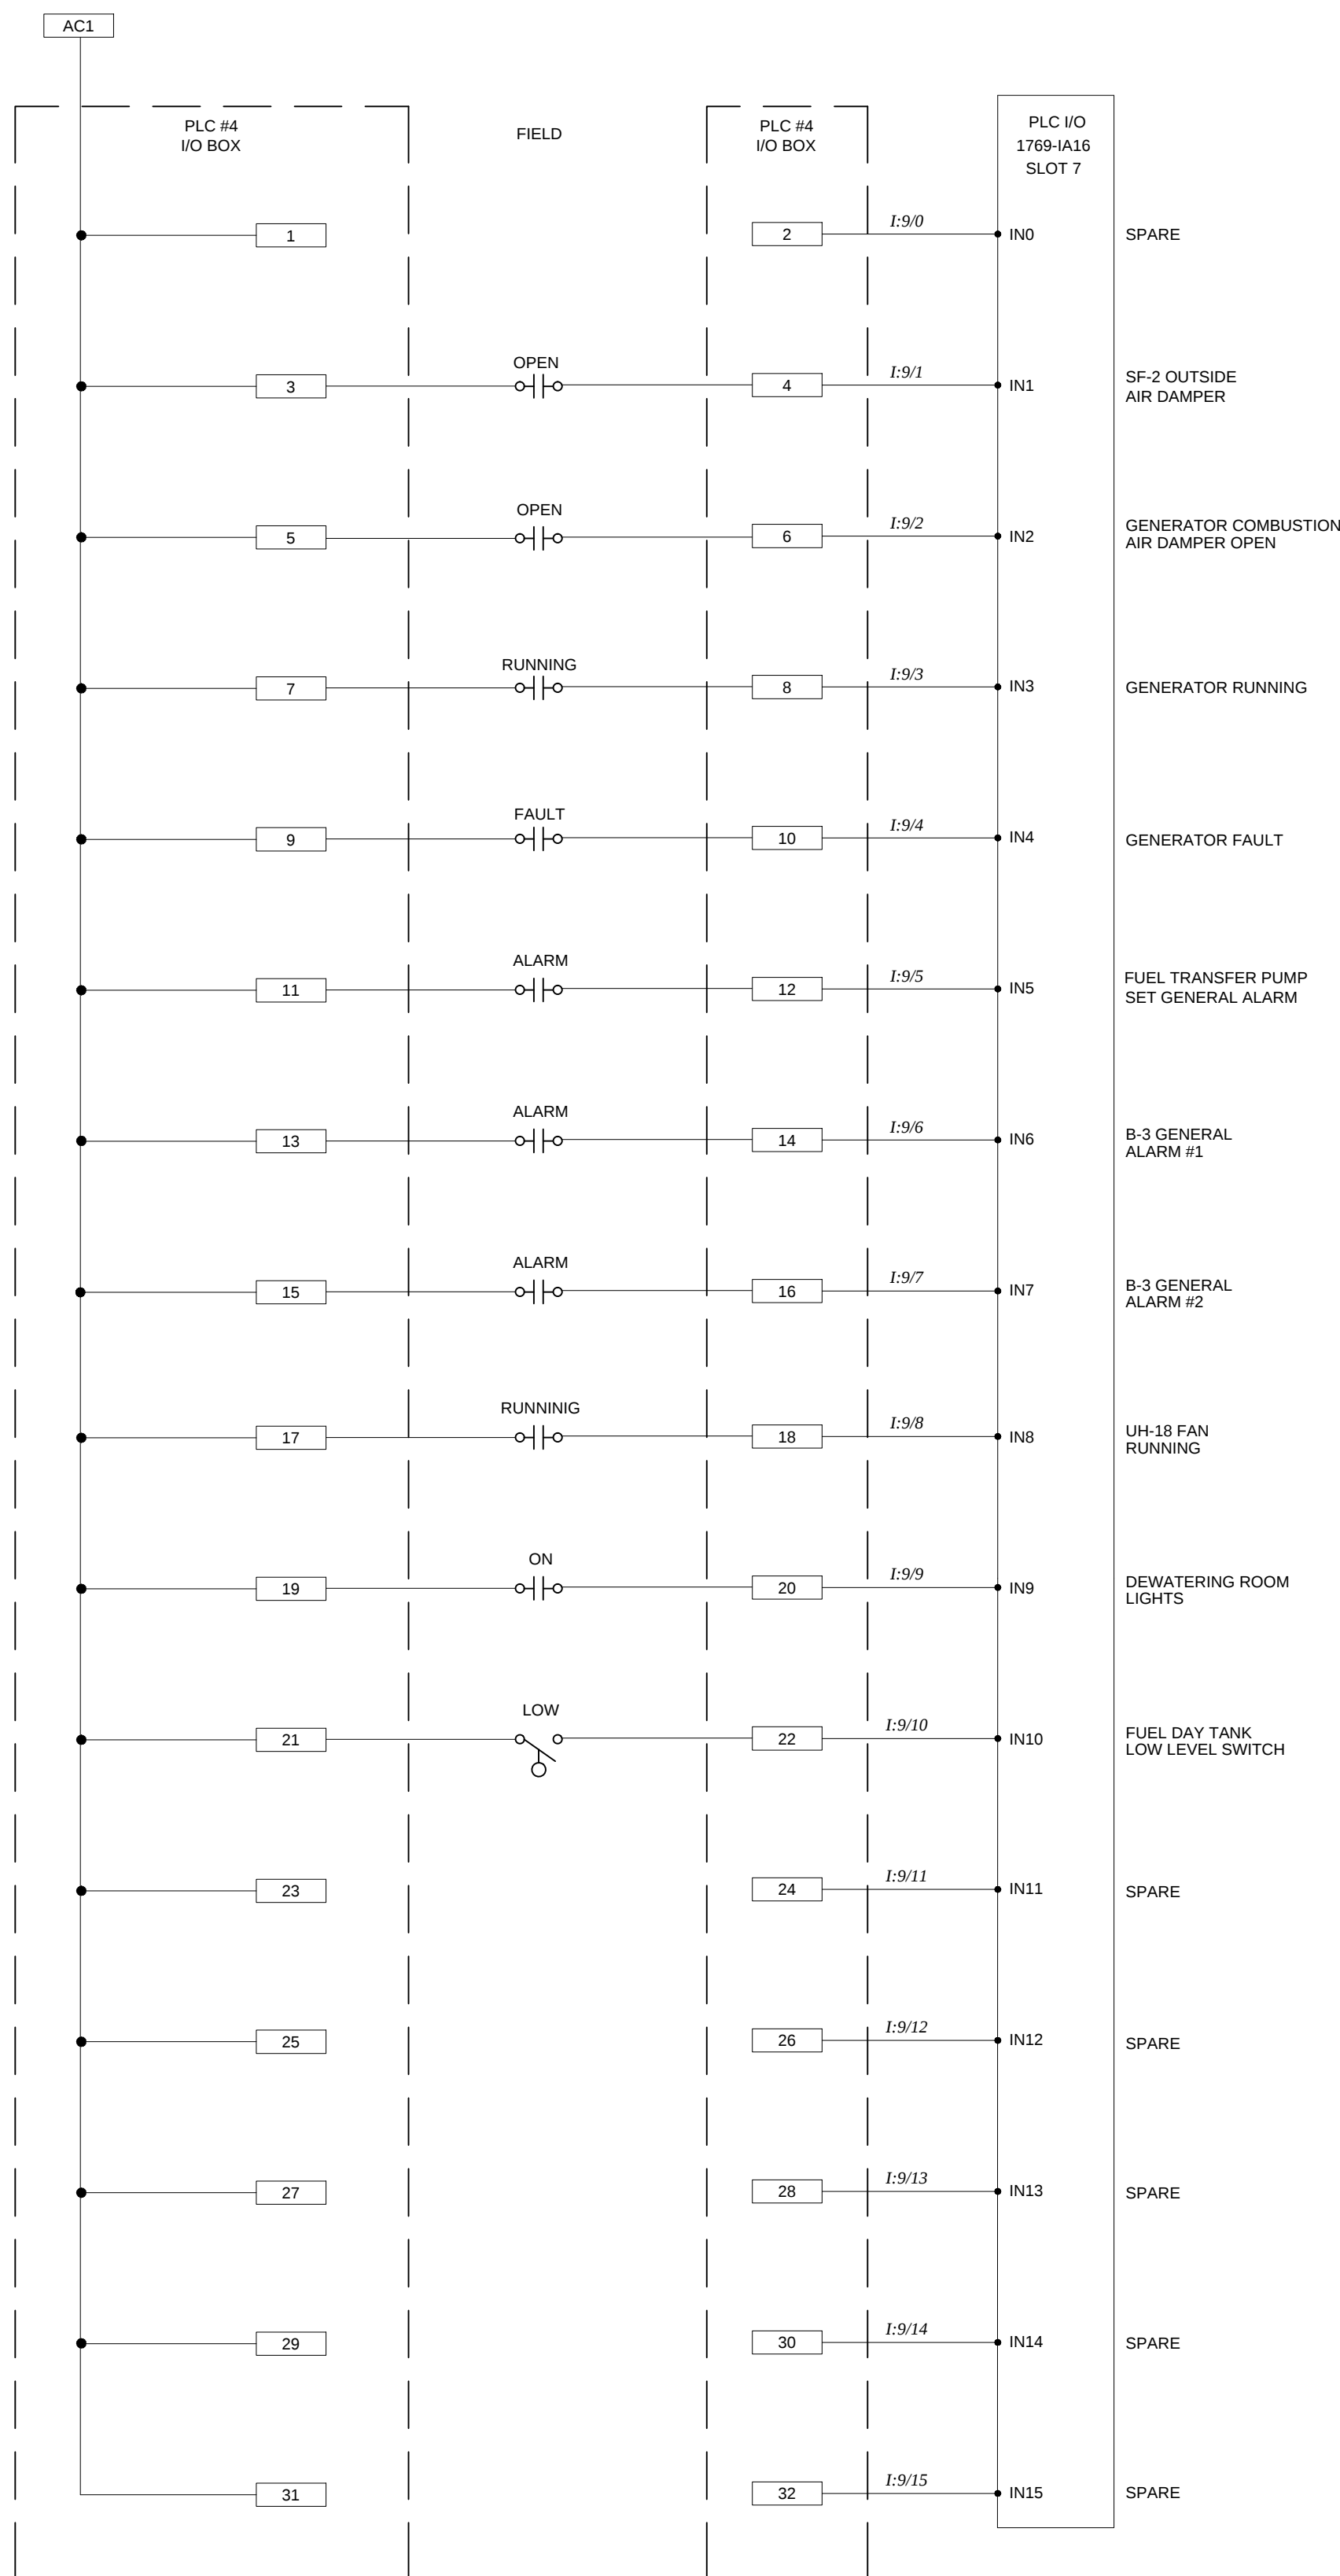

DISCRETE INPUT SLOT 7

No.	Issue	Date
1	60% REVIEW SUBMISSION	2013-MAR-08
2	ISSUED FOR TENDER	2013-APR-10
3	RELEASED FOR CONSTRUCTION	2013-JUN-27



No.	Revision	Ckd. By	Date

PERMIT OF PRACTICE
EXP SERVICES INC.
Signature *[Signature]*
Date 2013/JUN/27
PERMIT NUMBER: P483
NT/NU Association of Professional Engineers and Geoscientists.

RELEASED FOR CONSTRUCTION

	Const. North
	Drawn By: TAW
	Dwg. Standards Ckd. By: PD
	Designed By: DEB
Date Printed	Dwg. Design Ckd. By: JFP

exp Services Inc.
t: +1.613.688.1899 | f: +1.613.225.7330
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA
www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title
WASTE WATER TREATMENT PLANT UPGRADE PANGNIRTUNG, NU

Dwg. Title
PLC #4 PANEL WIRING SLOTS 2 AND 7

Project No.	OTT-00204430-A0	
Dwg. No.	E2631-1	Rev. No. 0
Scale	NOT TO SCALE This drawing is not to be scaled	