


NTS

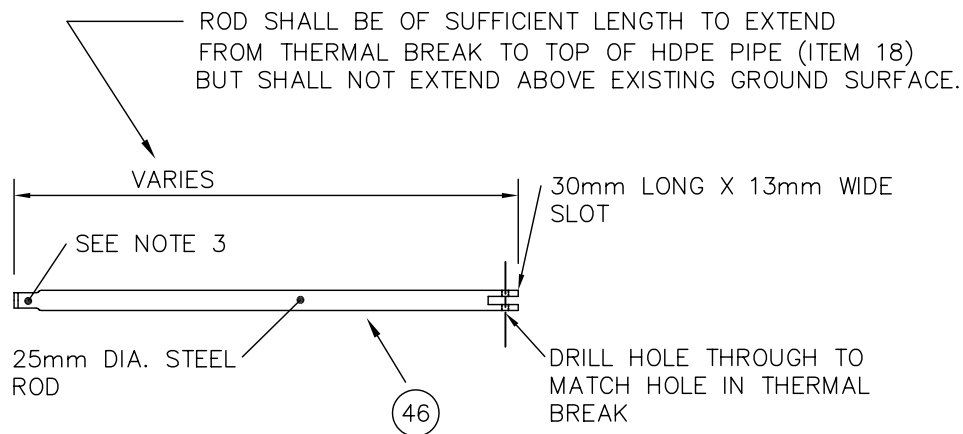

NOTES

ROD SHALL BE FIELD FABRICATED. ZINC RICH PAINT COATED AFTER FABRICATION.

TOP SECTION OF ROD TO BE 32mm LONG X 19mm WIDE X 6mm THICK WITH 5mm LONG TOP BEVEL (SIMILAR TO TOP OF CRANE M^CAVITY W-6221 ROD)

VALVE OPERATING ROD

NTS

GENERAL NOTES:

ALL EXPOSED SURFACES INCLUDING FACTORY COATED SURFACES, OF POLYURETHANE TO BE FIELD COATED WITH MASTIC.

RESOLUTE BAY
NUNAVUT

UTILIDOR REPAIRS
RESOLUTE BAY NUNAVUT



A. D. Williams
Engineering Inc.
Consulting Engineers

#4903-47 Street
P.O. Box 1529
Yellowknife, NT X1A 2P2
(867) 873-2395
(867) 873-2547

Edmonton Office
(780) 424-2393
(780) 425-1520
ADWE NO.:

DESIGN BY:

DFG

DRAWN BY:

DFG

APPROVED BY:

BFG

DATE: **03.07.29**

SCALE: **N.T.S.**

DWG NO:

SK-8

REV NO:

A