


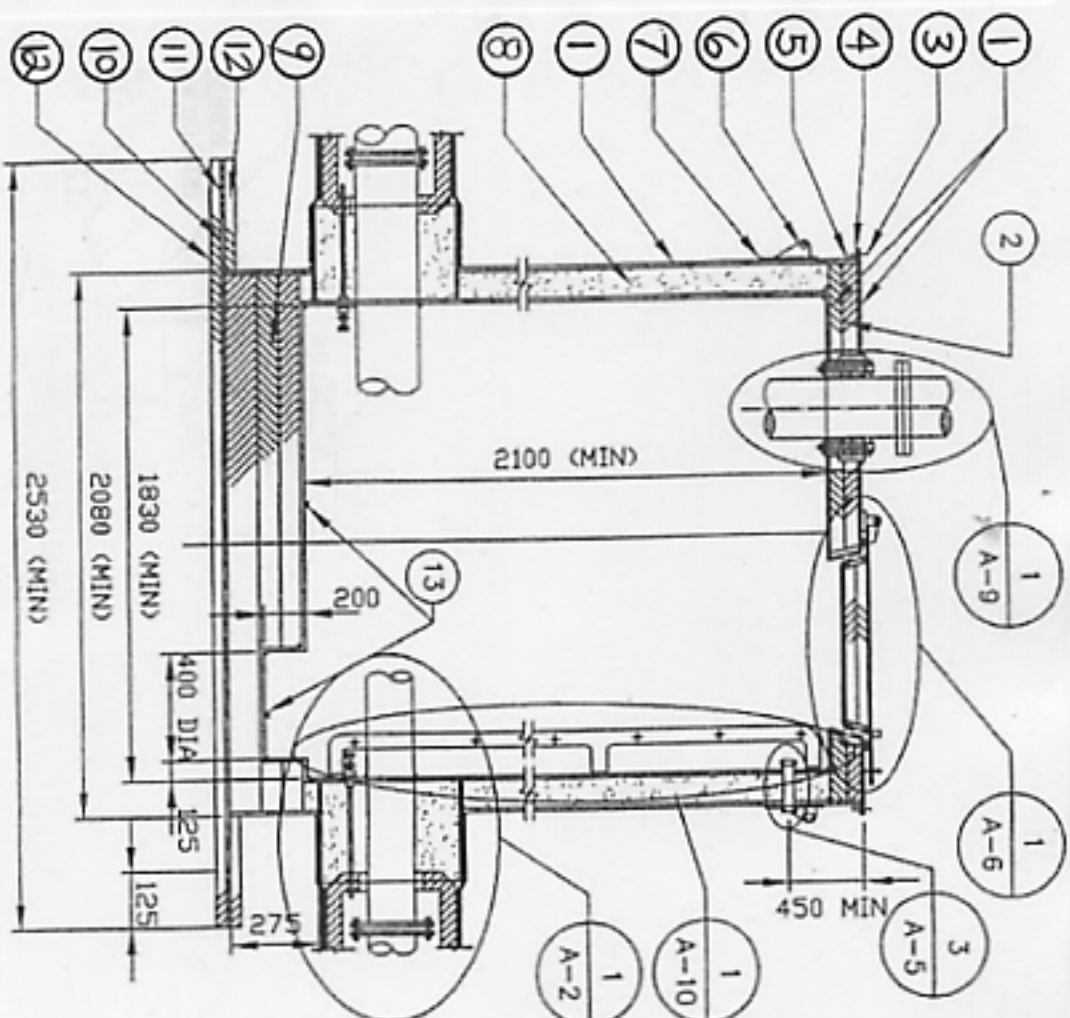

KEY TO NUMBERED PARTS:

- 1 6 THICK STEEL PLATE ACCESS VAULT CONSTRUCTION
- 2 URETHANE SHEET INSULATION CUT TO SIZE
- 3 12 CAO. PLATED STEEL BOLT, NUT, WASHER 3/2 MIN AT EQUAL SPACING
- 4 3 X 5 COMPRESSIBLE NEOPRENE RUBBER GASKET
- 5 10 THICK 50 X 50 MIN. ANGLE WELDED FULL LENGTH
- 6 LIFTING LUGS - TWO PER ACCESS VAULT, 150 X 75 X 12 THICK WITH 38 DIA LIFTING EYE
- 7 REINFORCING PLATE 200 X 200 X 12 CURVED TO EXTERIOR WALL RADIUS
- 8 FORMED IN PLACE INSULATION (URETHANE)
- 9 38 THICK STYROFOAM CUT TO MATCH EXTERIOR WALL RADIUS
- 10 FILLER PIECE - 10 THICK INSULATION
- 11 10 THICK STEEL BASE PLATE
- 12 38 THICK INSULATION
- 13 FROST PLUG

RESOLUTE BAY UTILIDOR

RESOLUTE BAY, MINNAPOLIS

ACCESS VAULT DETAIL

DESIGN BY:

DATE: 05.06.28

DRAWN BY:

SCALE: NTS

APPROVED BY:

REV NO:

0

A. D. Williams
Engineering Inc.
Consulting Engineers
PROJECT NO. 07751-10

4903-47 Street
P.O. Box 1029
Yellowknife, NT, X1A 2P2
Ph. (867) 873-2335
Fax. (867) 873-2547
Education Office
Ph. (780) 424-2333
Fax. (780) 425-1520

FOR ESTIMATING PURPOSES ONLY