



EXP SERVICES INC. 2012

EXP SERVICES INC. 2012

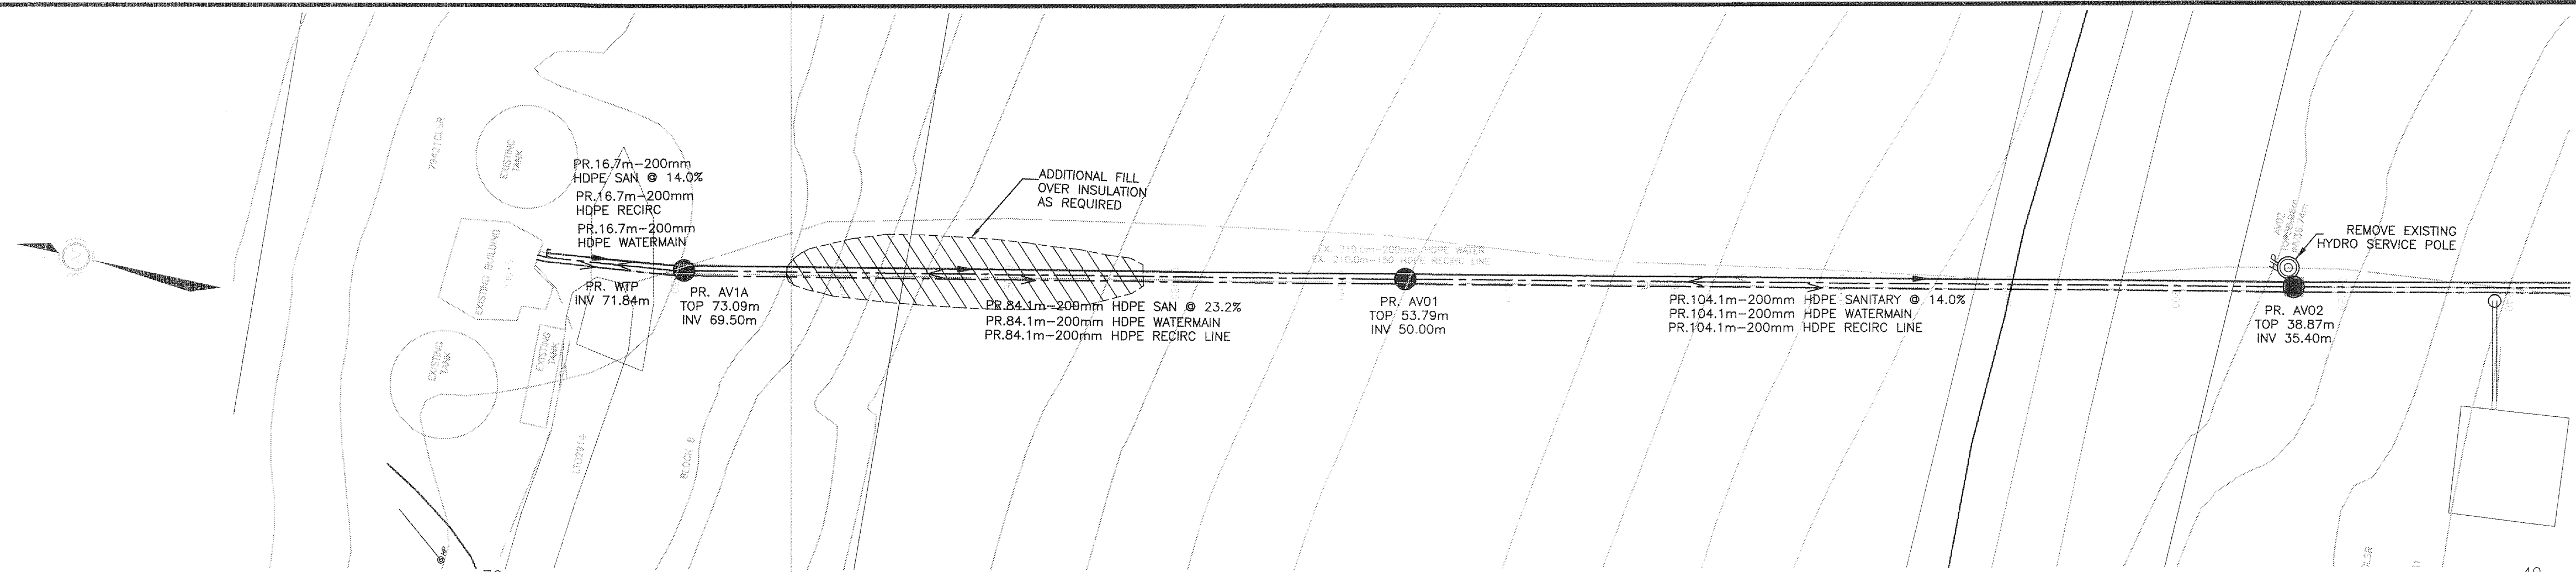

*NOTE: CONTRACTOR TO VERIFY AND MATCH INVERTS AT NEW WATER TREATMENT PLANT

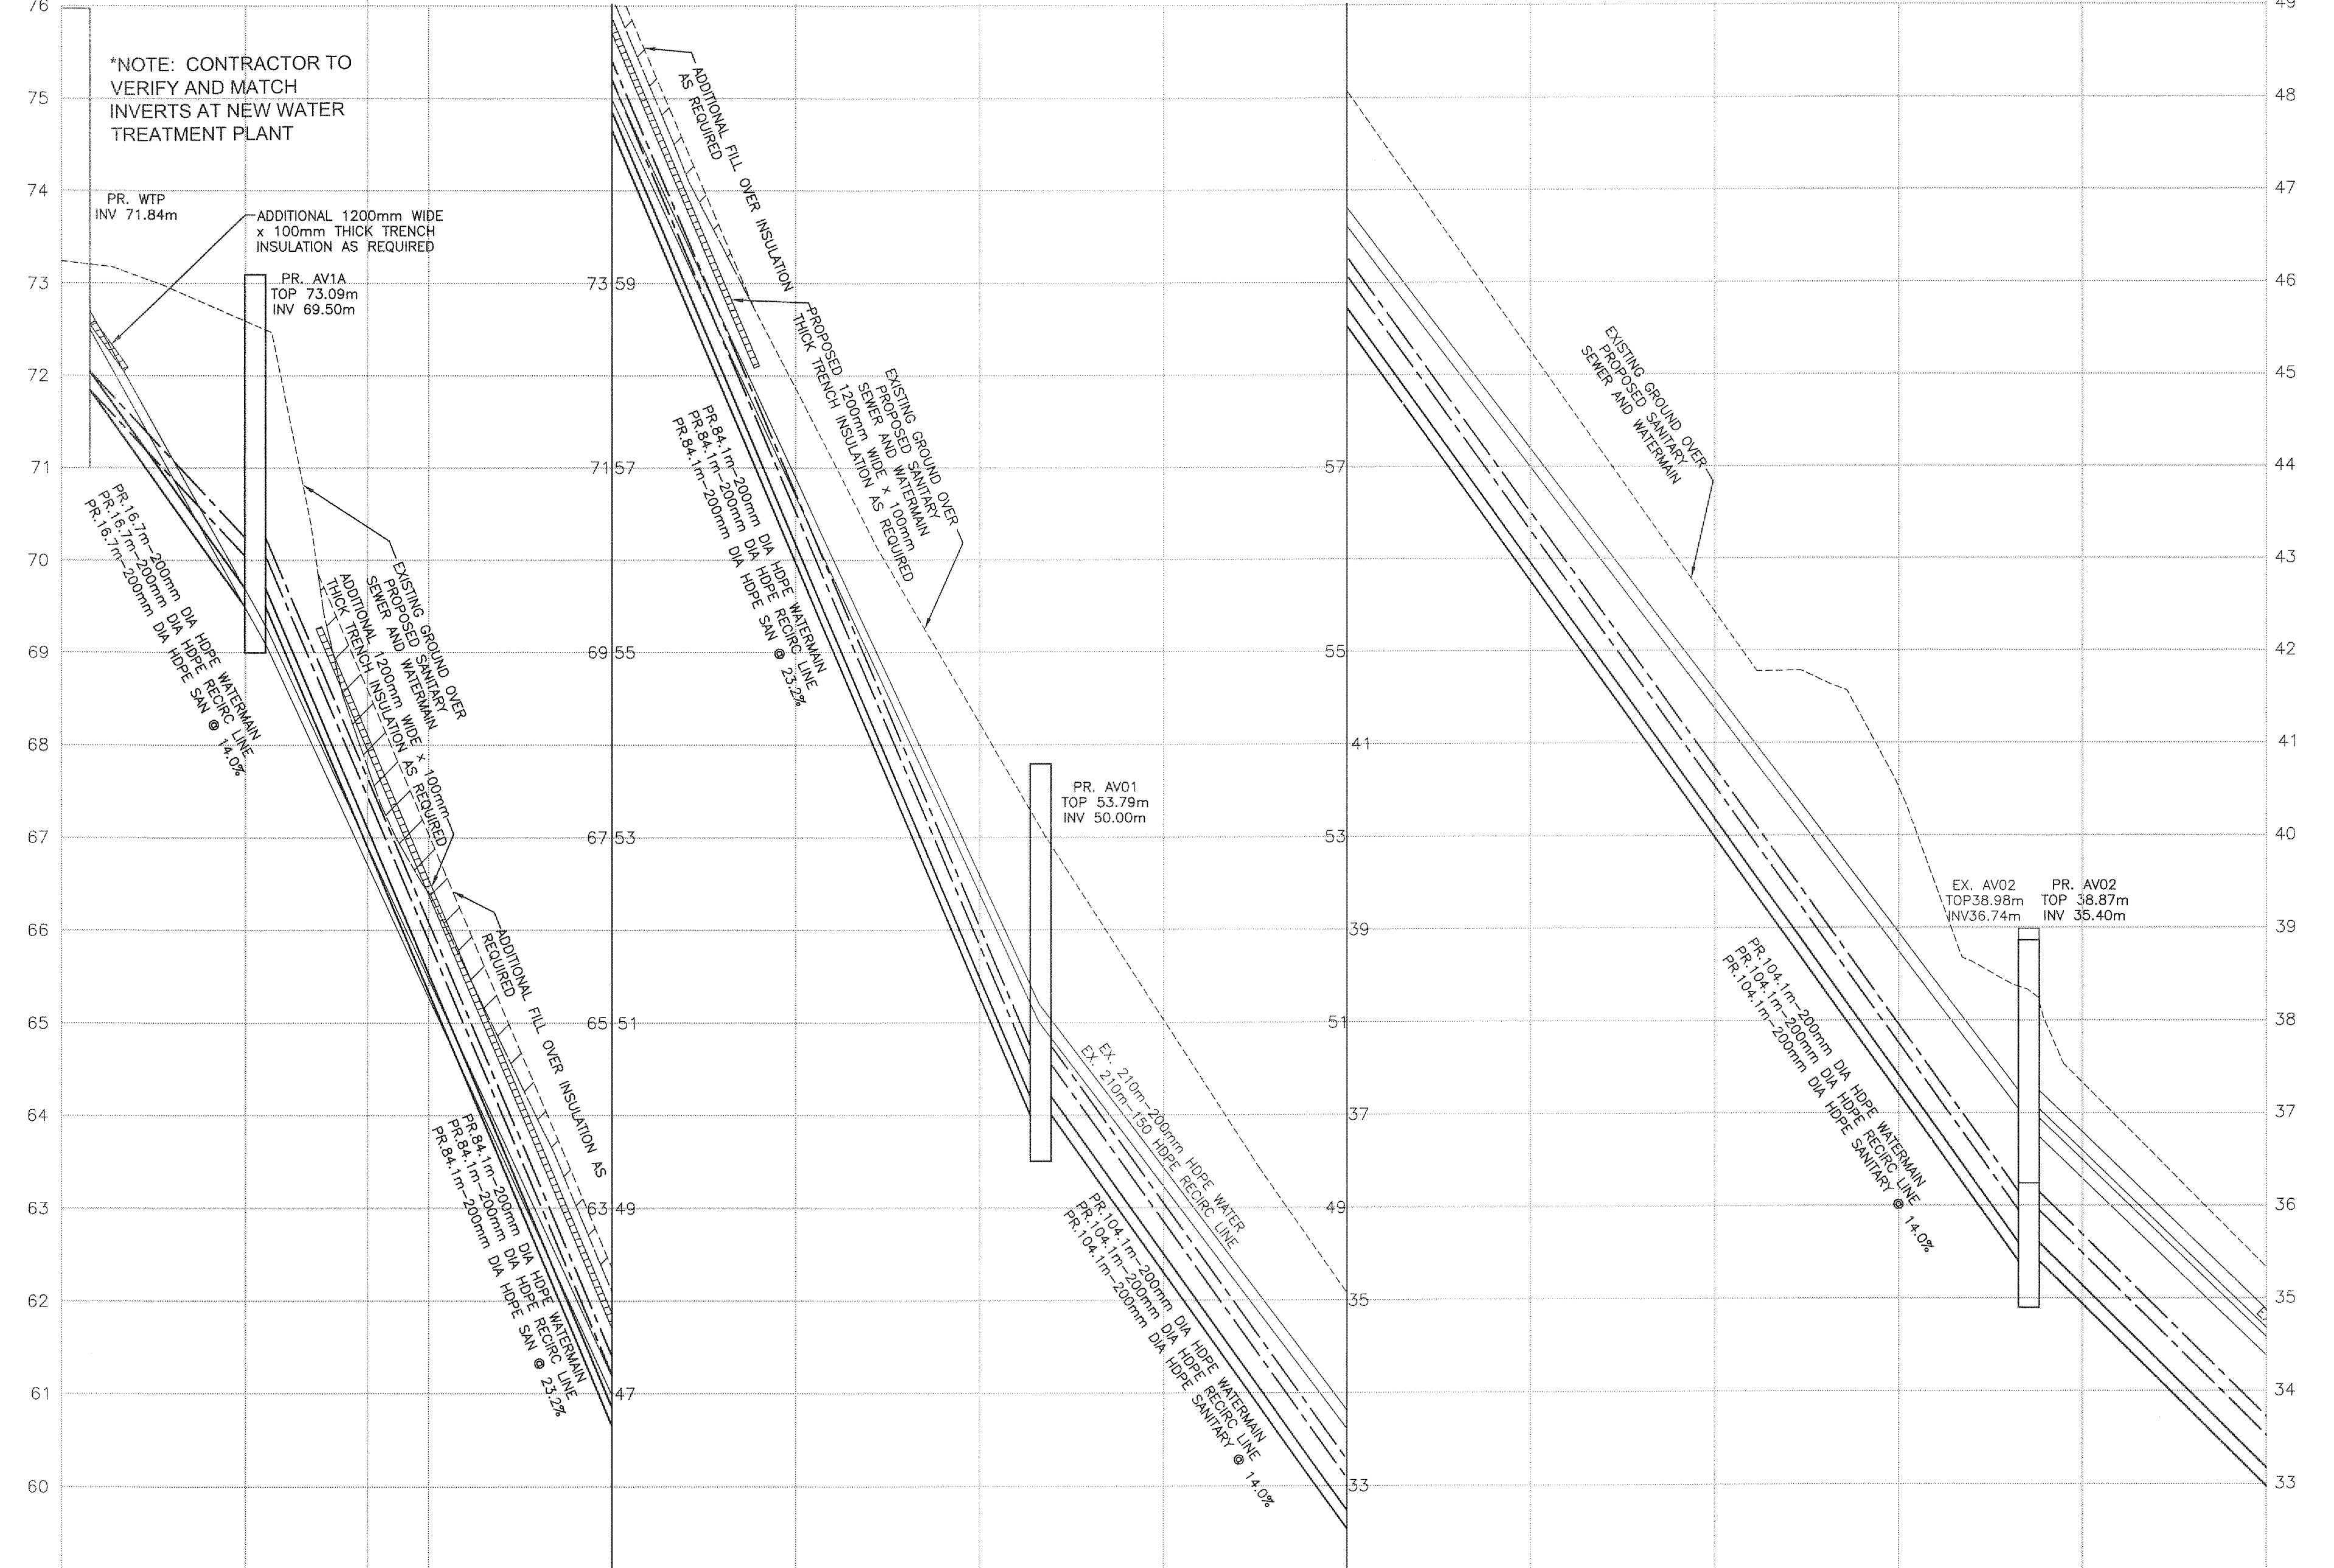

PROPOSED ELEVATION	73.24				66.40	62.09	57.86	54.23	51.03	47.52	43.76	41.50	40.51	37.05	
TOP OF WATERMAIN ELEVATION	72.70	16.7m-200mmØ SERIES 128 HDPE WATERMAIN	70.25	70.25	84.1m-200mmØ SERIES 128 HDPE WATERMAIN	50.75	50.75			104.1m-200mmØ SERIES 128 HDPE WATERMAIN			36.15	36.15	
TOP OF WATER RECIRC ELEVATION	72.70	16.7m-200mmØ SERIES 128 HDPE RECIRC	70.25	70.25	84.1m-200mmØ SERIES 128 HDPE RECIRCULATION	50.75	50.75			104.1m-200mmØ SERIES 128 HDPE RECIRCULATION			36.15	36.15	
SANITARY SEWER INVERT	72.50	16.7m-200mmØ SERIES 128 HDPE SAN ⊙ 18.0%	69.50	69.50	84.1m-200mmØ SERIES 128 HDPE SAN ⊙ 23.2%	50.00	50.00			104.1m-200mmØ SERIES 128 HDPE SAN ⊙ 14.0%			35.40	35.40	
EXISTING ELEVATION	73.24		72.59		66.40	62.09	57.86	54.23	51.03	47.52	43.76	41.50	40.51	37.05	
CHAINAGE	0+000		0+020 +021.74		0+040	0+060	0+080	0+100	0+106.62	0+120	0+140	0+160	0+180	0+200 0+214.17	0+220

No.	Issue	Date
01	ISSUED FOR TENDER	2013-MAR-25
02	REISSUED FOR TENDER	2013-OCT-25



No.	Revision	Ckd. By	Date
00	100% SUBMISSION	SLB	2013-MAR-04

PERMIT OF PRACTICE
EXP SERVICES INC.
Signature: S. Burden
Date: Oct 25/13
PERMIT NUMBER: P483
NT/NU Association of Professional Engineers and Geoscientists

ISSUED FOR TENDER

Const. North
Drawn By: I. CRAWFORD
Dwg. Standards Ckd. By:
Designed By: A. ZARAD
Date Printed: Dwg. Design Ckd. By: S. BURDEN

exp Services Inc.
t: +1.613.688.1899 | f: +1.613.225.7330
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA
www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title
**NEW UTILIDOR DESIGN
RESOLUTE BAY, NU**

Dwg. Title
**PLAN AND PROFILE
SIGNAL HILL TO AV02**

Project No. OTT-00206333-A0
Dwg. No. **C-304** Rev. No. 02
Scale 1:500
This drawing is not to be scaled