
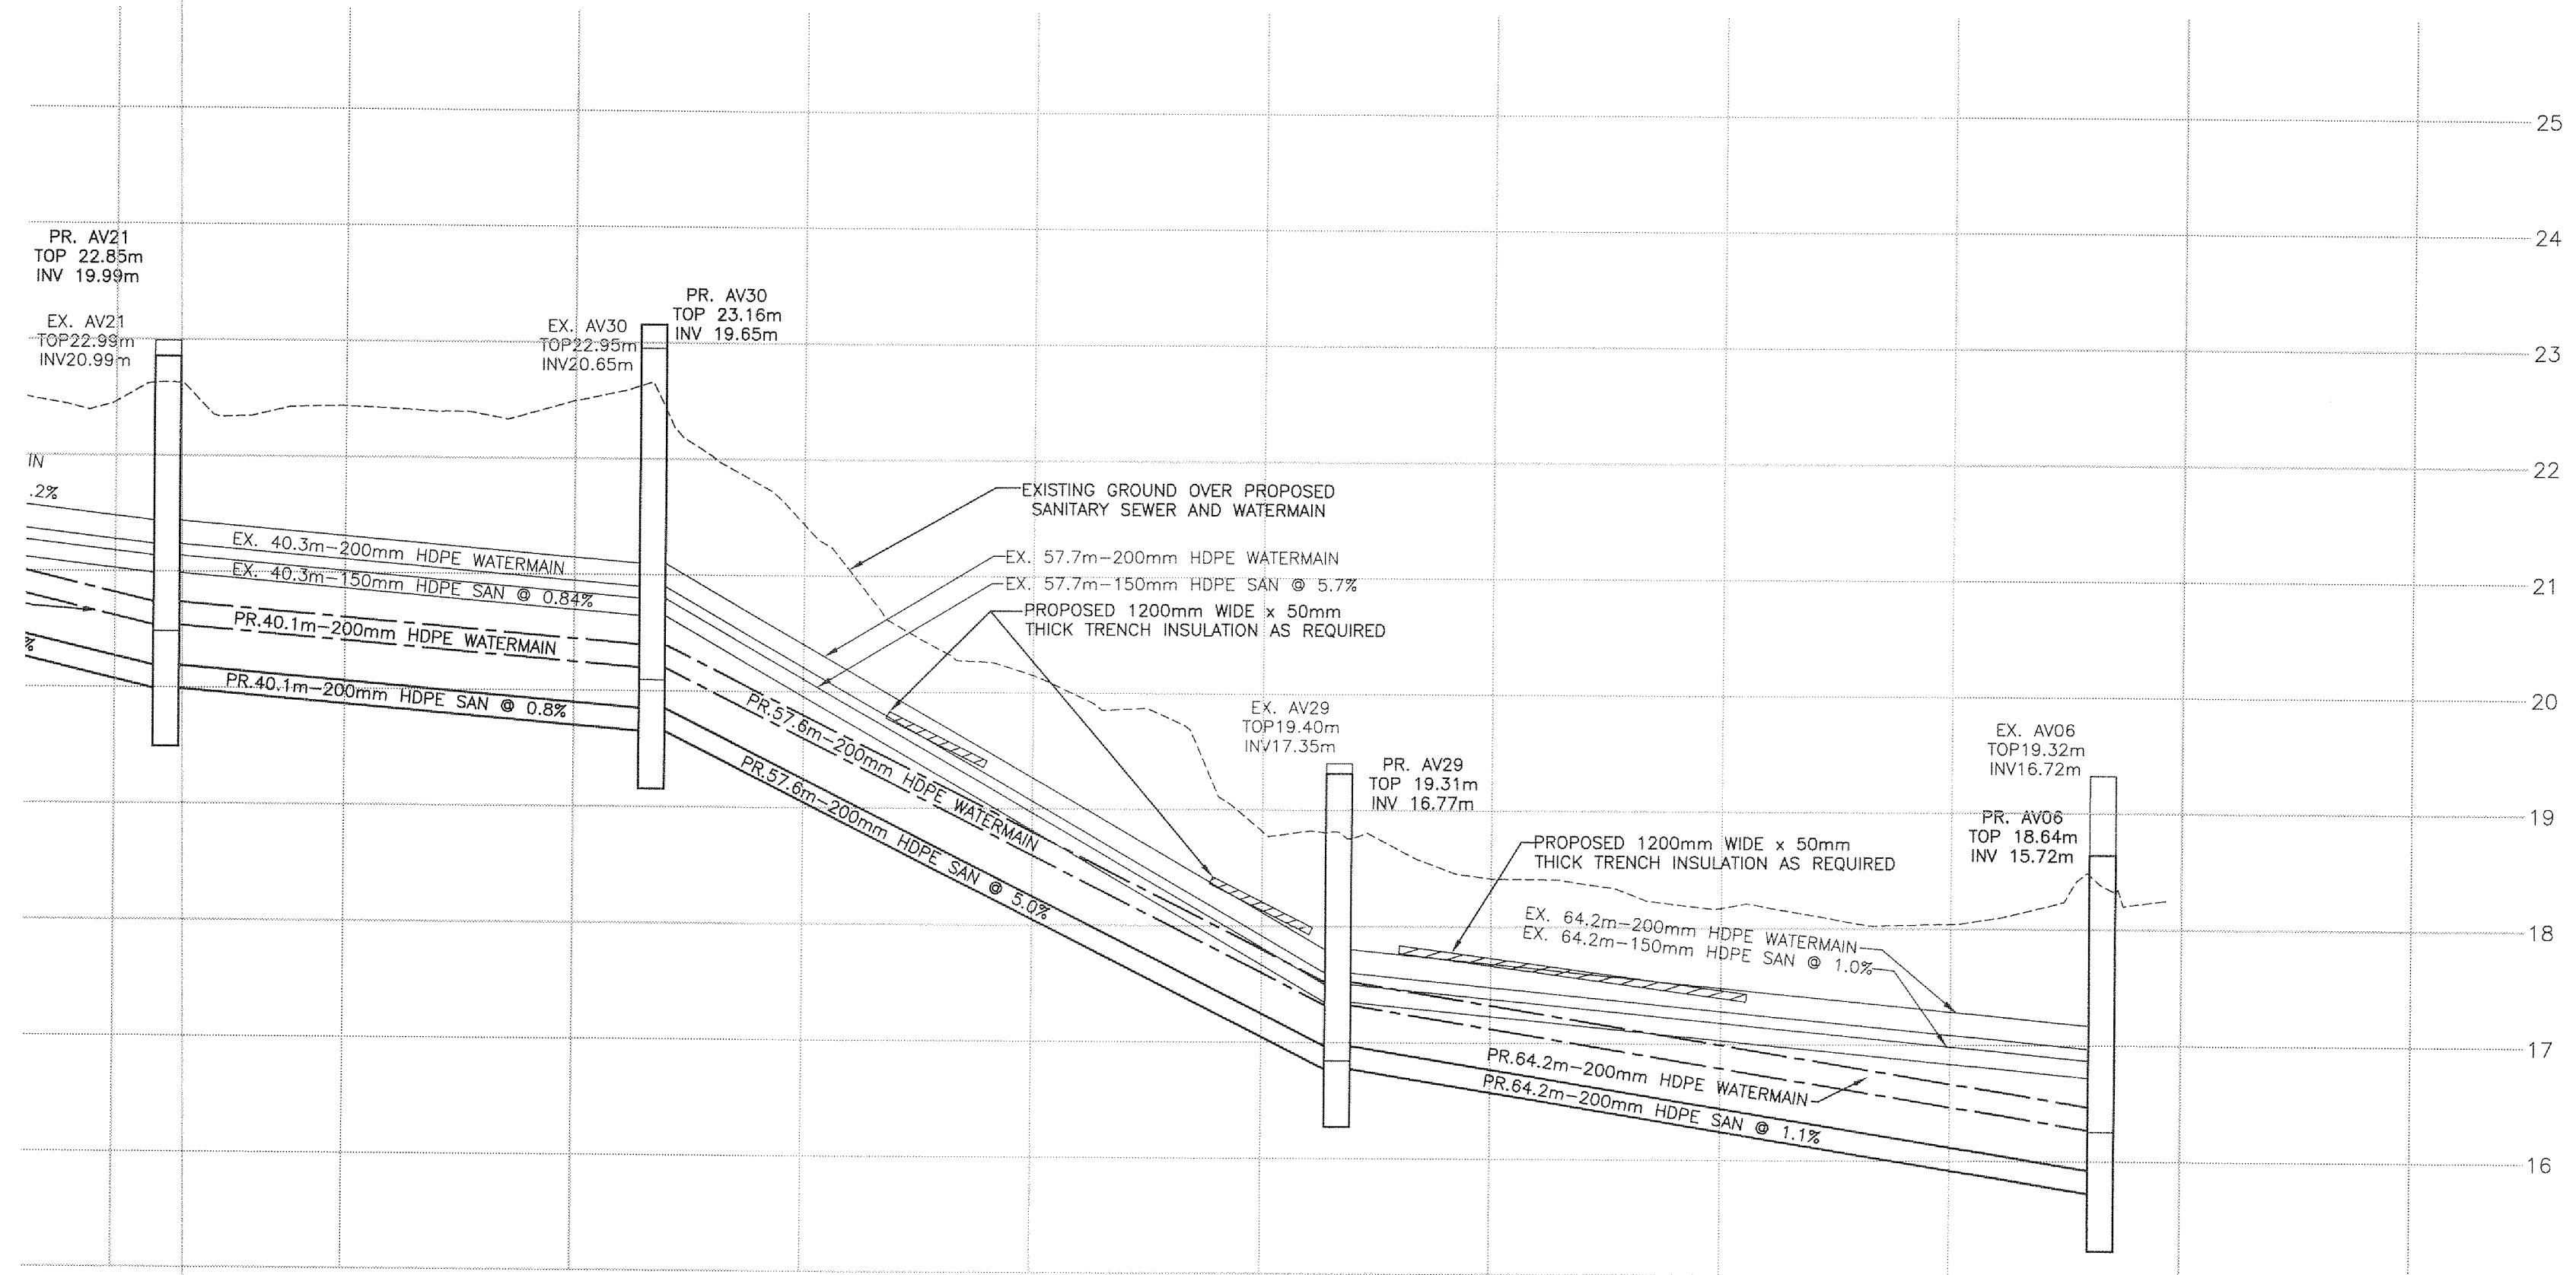


THE PROJECTOR'S SEAL AND SIGNATURE ARE REQUIRED TO BE PLACED IN THE SPACE PROVIDED FOR THE PROJECTOR'S SEAL AND SIGNATURE. THE PROJECTOR'S SEAL AND SIGNATURE ARE REQUIRED TO BE PLACED IN THE SPACE PROVIDED FOR THE PROJECTOR'S SEAL AND SIGNATURE.

PROJECTOR'S SEAL AND SIGNATURE

DATE: 2013-03-25

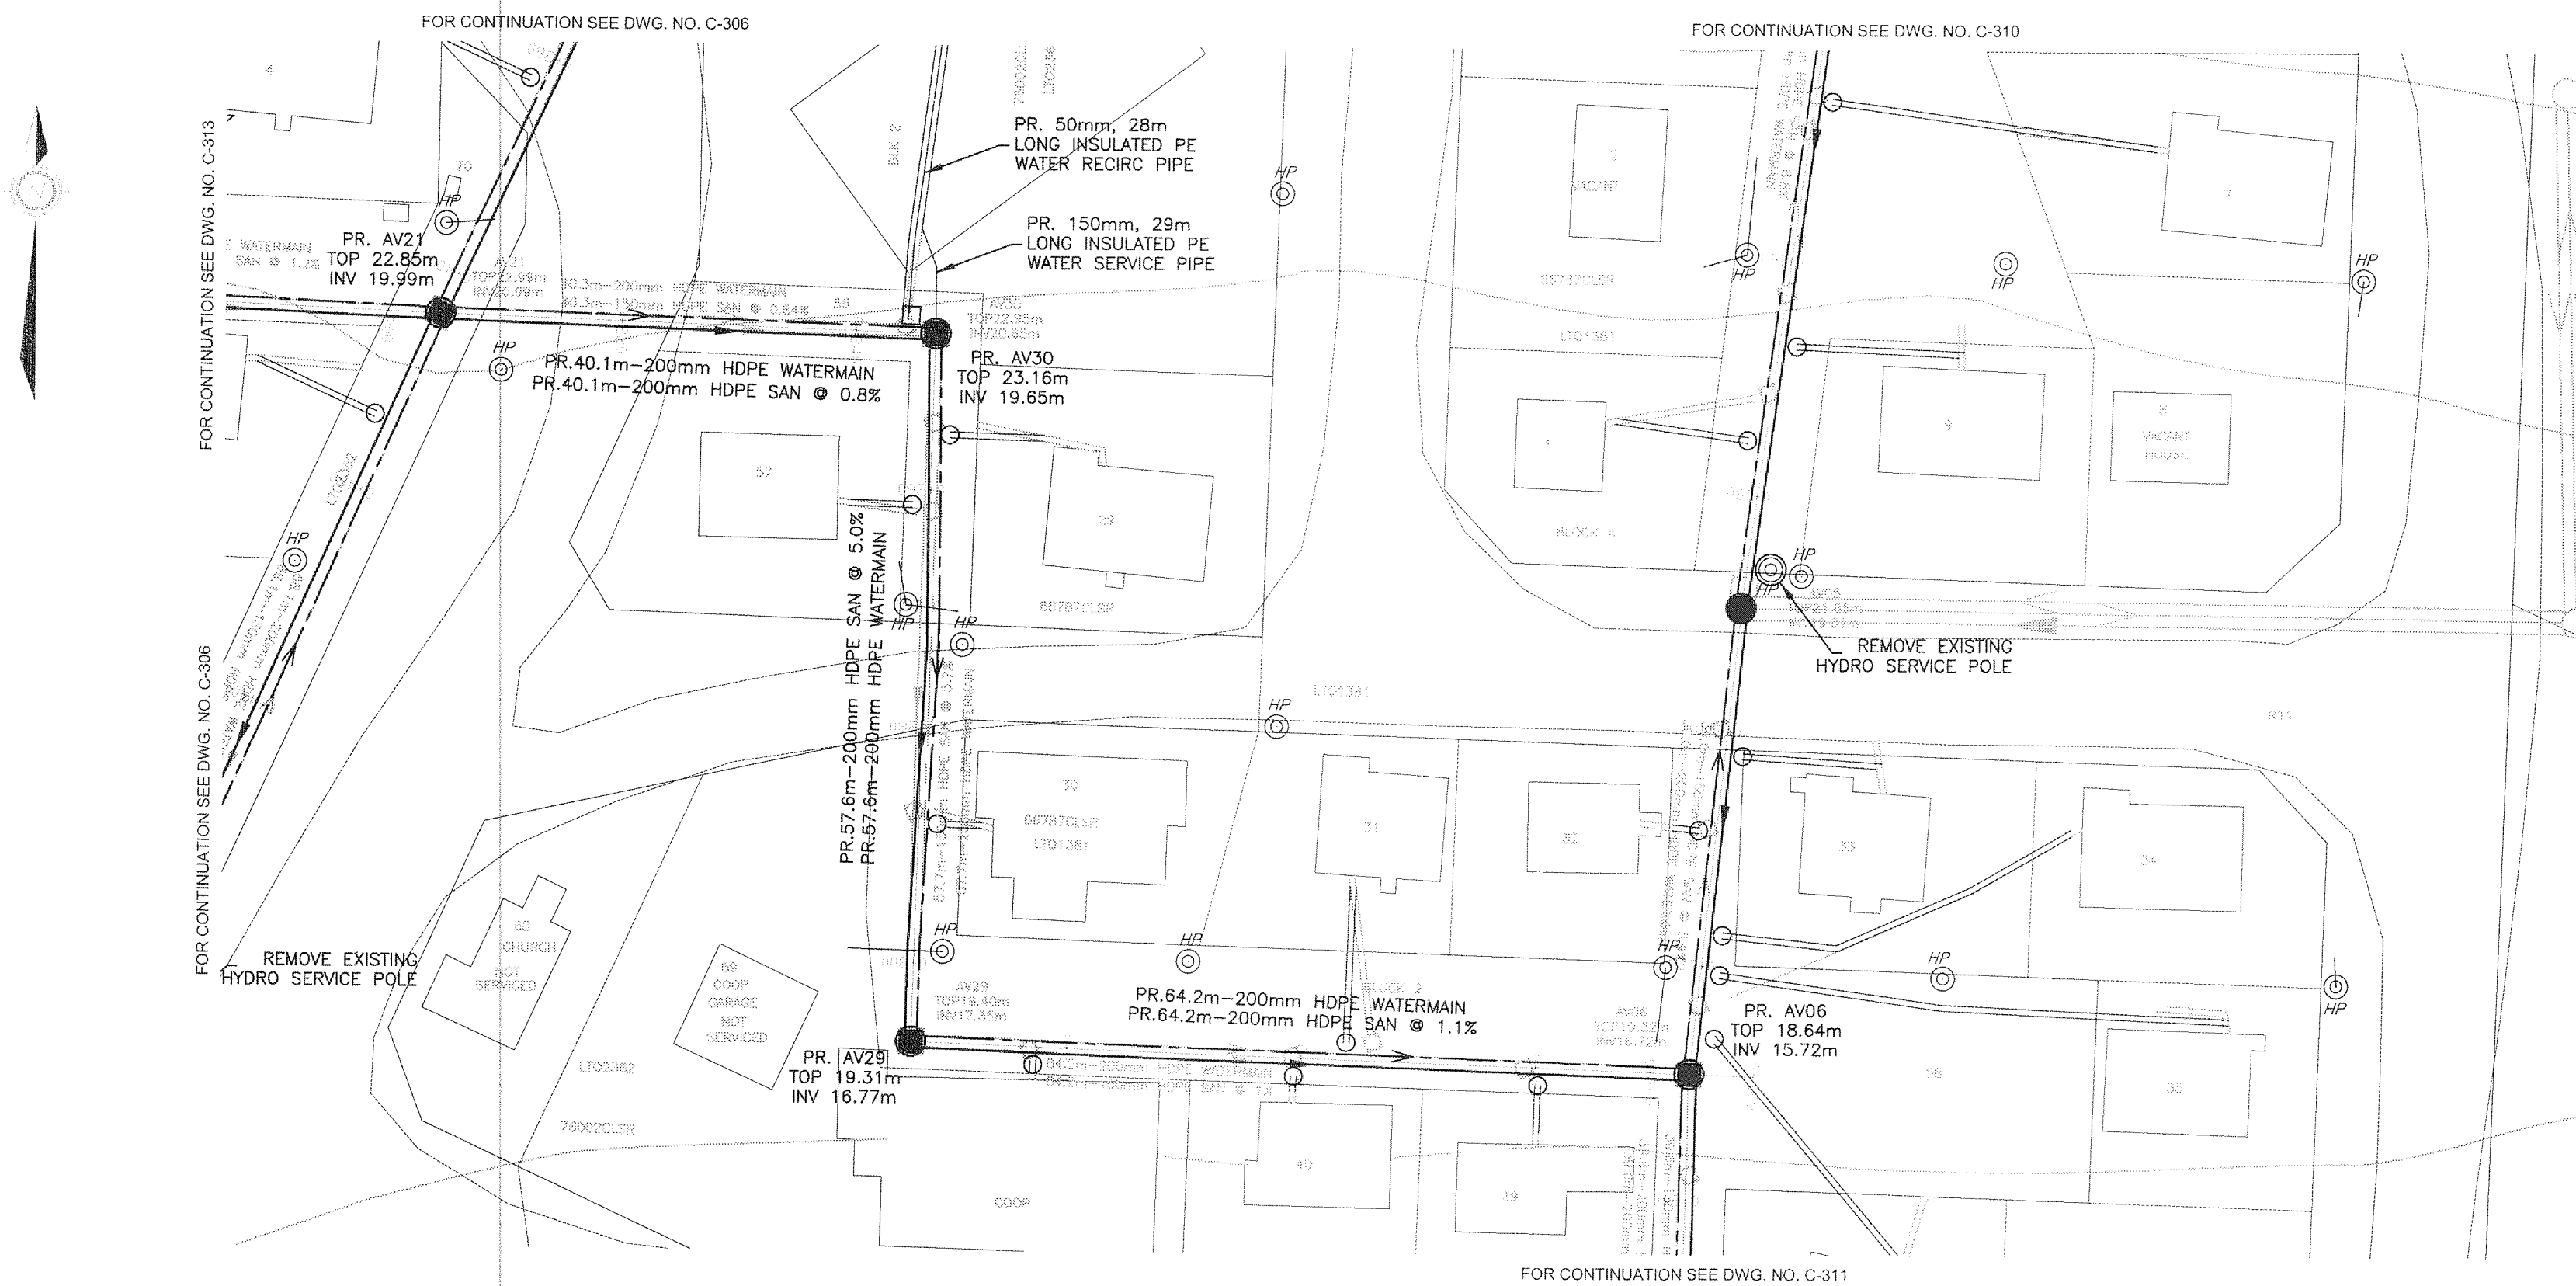

Station	Proposed Elevation	Top of Watermain Elevation	Top of Water Recirc Elevation	Sanitary Sewer Invert	Existing Elevation
0+200	22.46	W 20.74 E 20.74 N 20.74	W 19.99 E 19.99 N 19.99	W 19.99 E 19.99 N 19.99	22.46
0+220	22.43	40.1m-200mm ^Ø SERIES 128 HDPE WATERMAIN	40.1m-200mm ^Ø SERIES 128 HDPE SAN @ 0.8%	40.1m-200mm ^Ø SERIES 128 HDPE SAN @ 0.8%	22.43
0+240	22.50	57.6m-200mm ^Ø SERIES 128 HDPE WATERMAIN	57.6m-200mm ^Ø SERIES 128 HDPE SAN @ 5.0%	57.6m-200mm ^Ø SERIES 128 HDPE SAN @ 5.0%	22.50
0+260	21.44	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.1%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.1%	21.44
0+280	20.15	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	20.15
0+300	18.81	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	18.81
0+320	18.41	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	18.41
0+340	18.17	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	18.17
0+360	18.04	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	18.04
0+373.12	16.47	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	16.47
0+380	16.47	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	16.47
0+400	16.04	64.2m-200mm ^Ø SERIES 128 HDPE WATERMAIN	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	64.2m-200mm ^Ø SERIES 128 HDPE SAN @ 1.0%	16.04
CHAINAGE					

No.	Issue	Date
01	ISSUED FOR TENDER	2013-MAR-25
02	REISSUED FOR TENDER	2013-OCT-25



No.	Revision	Ckd. By	Date
00	100% SUBMISSION	SLB	2013-MAR-04

PERMIT OF PRACTICE
EXP SERVICES INC.
Signature: *S. Burden*
Date: *Oct 25/13*
PERMIT NUMBER: P483
NT/NU Association of Professional
Engineers and Geoscientists

ISSUED FOR TENDER

Const. North
Drawn By: I. CRAWFORD
Dwg. Standards
Ckd. By:
Designed By: A. ZARAD
Dwg. Design
Ckd. By: S. BURDEN

exp Services Inc.
1-1-613-688-1899 / 1-1-613-225-7390
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA
www.exp.com

• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title
NEW UTILIDOR DESIGN
RESOLUTE BAY, NU
Dwg. Title
PLAN AND PROFILE
AV21 TO AV06
Project No.
OTT-00206333-A0
Dwg. No.
C-314
Rev. No.
02
Scale
1:500
This drawing is not to be scaled