



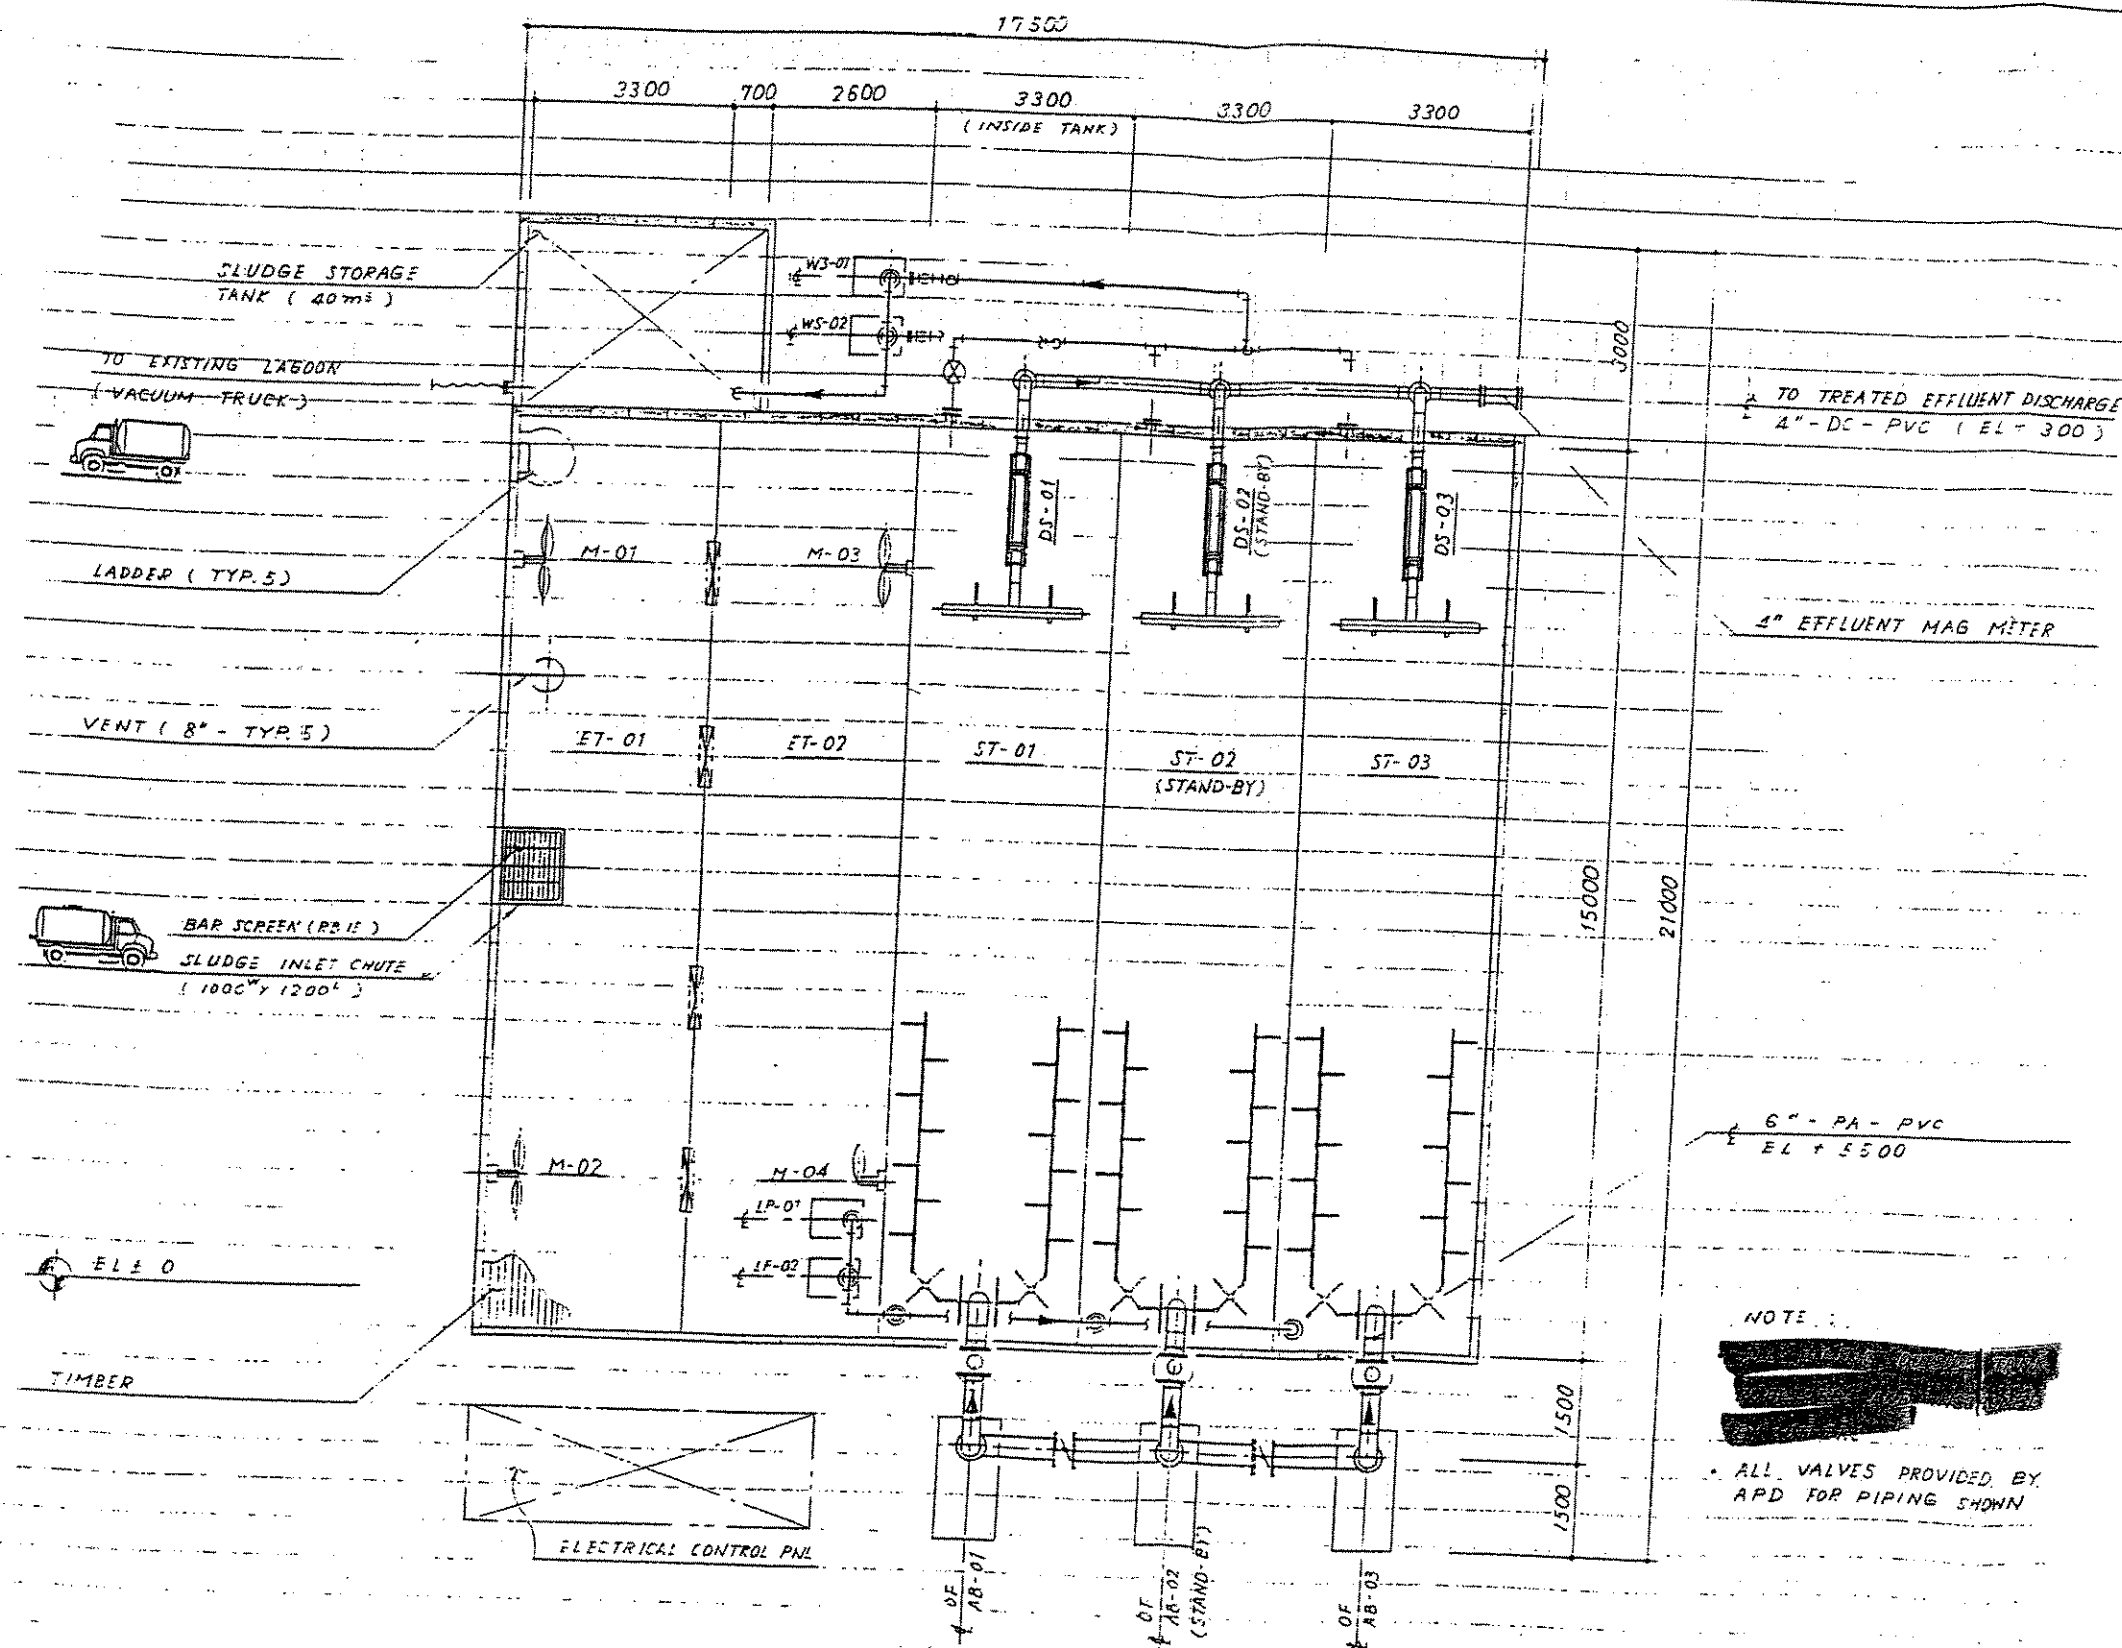

TO TREATED EFFLUENT DISCHARGE
4" - DC - PVC (EL + 300)

4" EFFLUENT MAG METER

6" - PA - PVC
EL + 5500

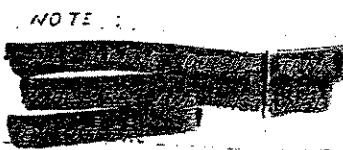

NOTE:
ALL VALVES PROVIDED BY
APD FOR PIPING SHOWN

PROJECT TITLE:	NUMBER	DESCRIPTION	BY	CHK	APP		APD ENGINEERING AND CONSTRUCTORS 103, 5120 - 6 TH STREET N.E. CALGARY AB, T2K 4W5 PH: (403) 230-9257, Fx: (403) 230-9262
ape Dorset WWTP	Apr. 14 th 2003	Proposal					
DRAWING TITLE:							