

Appendix B: NT-NU Spill Report Form

Wastewater Treatment Facility

Hamlet of Clyde River

Chapter 8 – Geothermal Monitoring

To be completed after commissioning



Wastewater Treatment Facility

Hamlet of Clyde River

Chapter 9 – Testing and Certification Data

Hamlet of Clyde River

Chapter 9 – Testing and Certification Data

To be completed after commissioning

Operating Conditions

Inspection Requirements

Warranties

Wastewater Treatment Facility

Hamlet of Clyde River

Chapter 10 – Manufacturing Data and Service Information

Chapter 10 – Manufacturing Data and Service Information

To be completed after commissioning

This chapter includes all manufacturers' service manuals, part lists, operating and maintenance instructions, performance curves, special shop drawings and other applicable data.

Technical Specifications Pump

Technical Specifications Data Logger

Technical Specifications Thermistors

Wastewater Treatment Facility

Hamlet of Clyde River


Chapter 11 – Record Drawings


To be completed after commissioning

New Sewage Lagoon

Rehabilitated Sewage Lagoon

Thermistor Locations

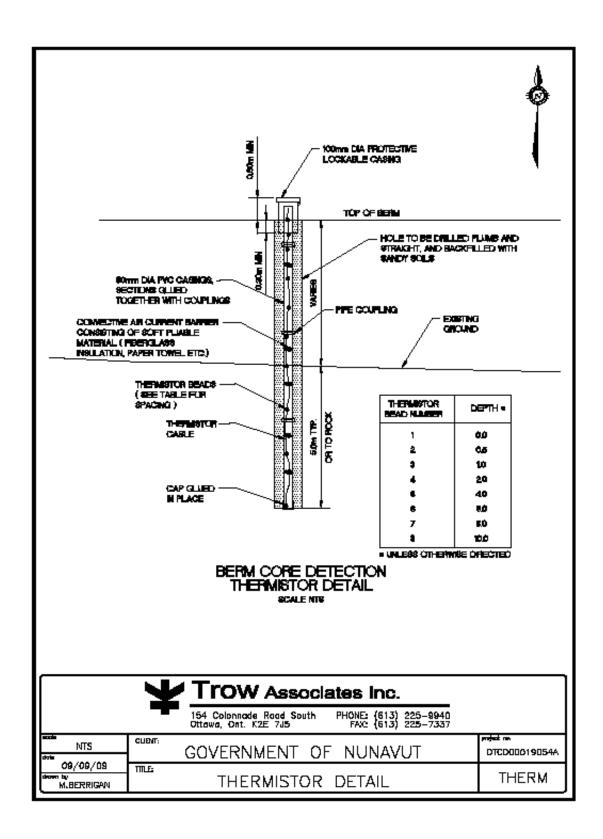

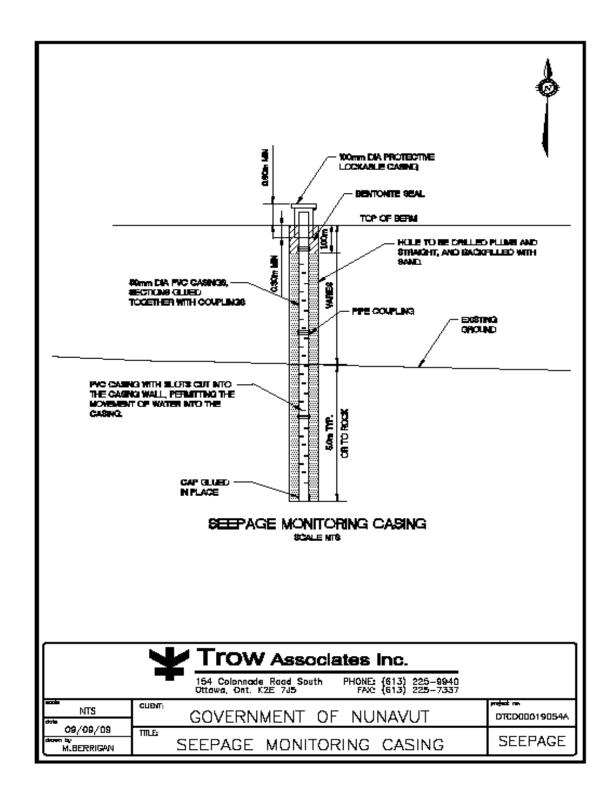

Wastewater Treatment Facility

Hamlet of Clyde River

Chapter 12 – Appendix



