

KEY PLAN



Canada



NEW WATER TREATMENT PLANT

GOVERNMENT OF NUNAVUT
PROJECT NO. 21220-00700-05


GRISE FIORD, NUNAVUT, CANADA

PROJECT NO. 23-5971


2024-NOV-29
ISSUED FOR TENDER
REVISION 0

ISSUED FOR TENDER

DILLON
CONSULTING
GOVERNMENT OF NUNAVUT
PROJECT NO. 21220-00700-05
NEW WATER TREATMENT PLANT
November 2024
Page No. 25/31

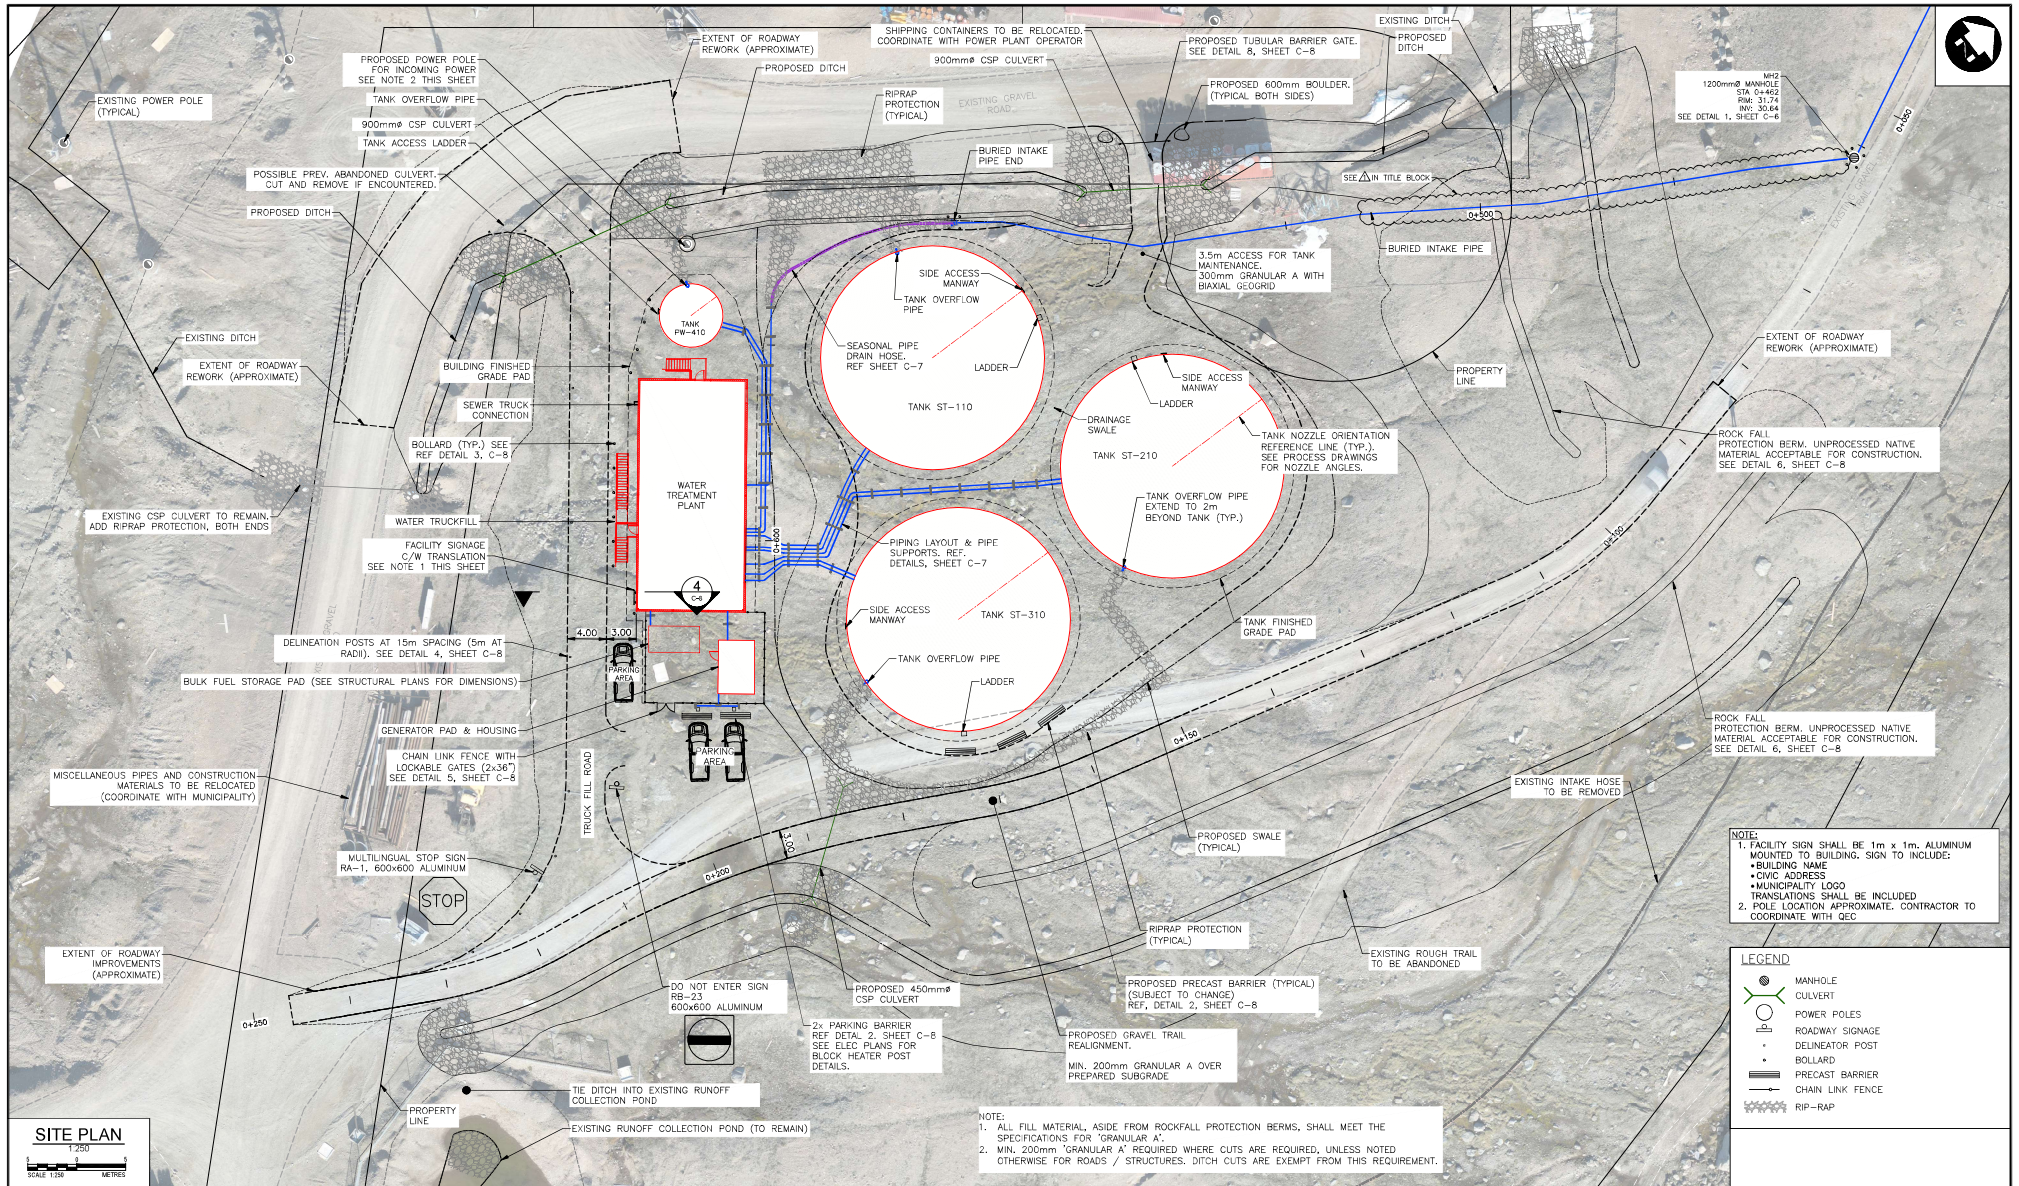


<p>Conditions of Use</p> <p>Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.</p> <p>Do not scale dimensions from drawing.</p> <p>Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.</p>	<div><p>PERMIT TO PRACTICE DILLON CONSULTING LIMITED</p><p>Signature: <i>[Signature]</i></p><p>Date: 2024-11-29</p><p>PERMIT NUMBER: P 010 INTERNAL Association of Professional Engineers and Geoscientists</p></div>	<div><p>2024-11-29</p></div>
---	---	------------------------------

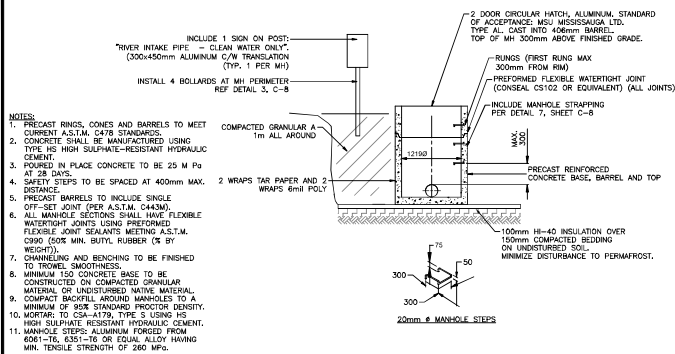


1 TYP. PRECAST MANHOLE INSTALLATION
C-4 1:50



DIMENSIONS SHOWN ARE mm.

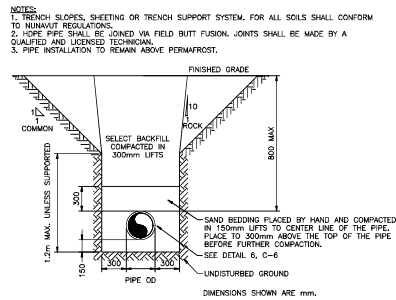


4 TYP. SINGLE PIPE TRENCH DETAIL
C-4 NTS

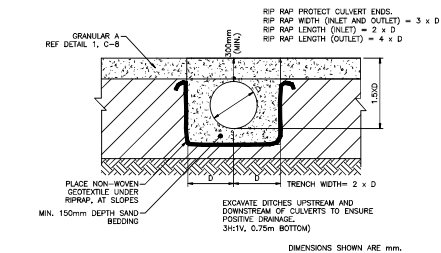


5 CSP CULVERT SECTION DETAIL
C-6 NTS

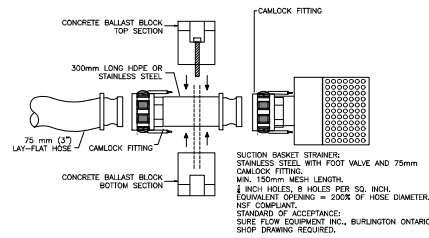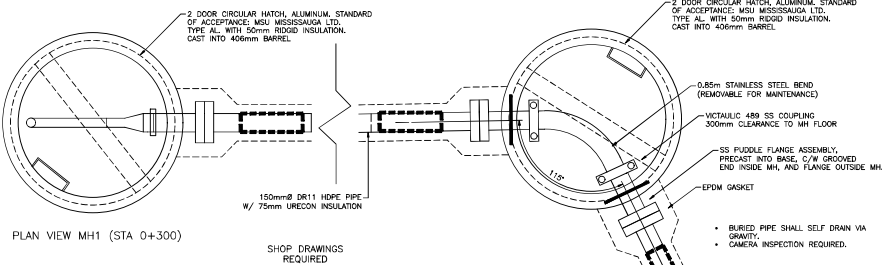

7 RIVER INTAKE
C-6 NTS

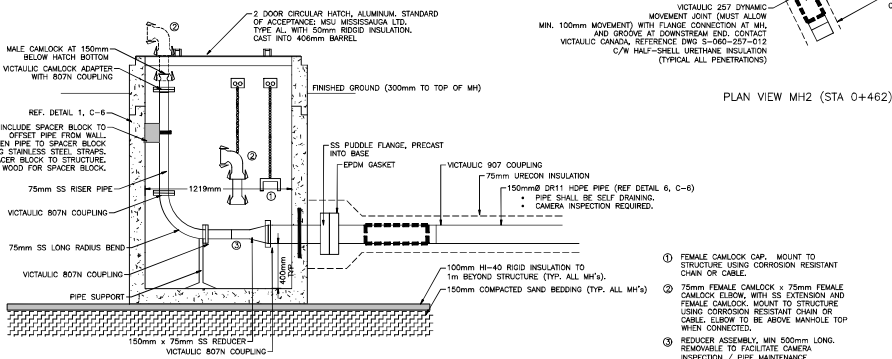


3 MANHOLE DETAIL
C-4 1:20



6 BURIED PIPE DETAIL
C-4 NTS

1. FEMALE CAMLOCK CAP, MOUNT TO STRUCTURE USING CORROSION RESISTANT CHAIN OR CABLE.
2. 75mm FEMALE CAMLOCK x 75mm FEMALE CAMLOCK ELBOW, WITH SS EXTENSION AND FEMALE CAMLOCK, MOUNT TO STRUCTURE USING CORROSION RESISTANT CHAIN OR CABLE. ELBOW TO BE ABOVE MANHOLE TOP WHEN CONNECTED.
3. REDUCER ASSEMBLY, MIN 900mm LONG. REMOVABLE TO FACILITATE CAMERA INSPECTION / PIPE MAINTENANCE.

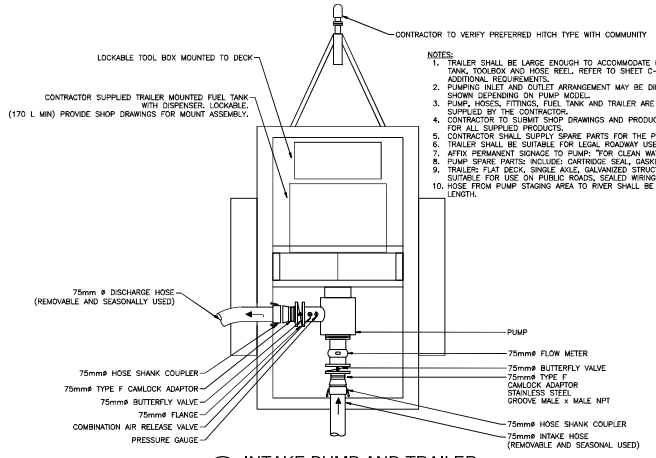

3 INTAKE PUMP AND TRAILER
C-6 1:25

Conditions of Use

Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.

Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.

PERMIT TO PRACTICE
DILLON CONSULTING LIMITED
Signature: *M. Dillon*
Date: 2024-11-09
PERMIT NUMBER: P 010
INTNA Association of Professional Engineers and Technicians



ISSUED FOR TENDER



NO.	REVISION	DATE	BY
1	ISSUED FOR TENDER	2024-09-26	KJ
2	AS INDICATED		

GOVERNMENT OF NUNAVUT 21220-00700-05 GRISE FORD NEW WATER TREATMENT PLANT		PROJECT NO. 23-5971
DETAILS		SHEET NO. C-6