


NOT FOR CONSTRUCTION

NOT FOR CONSTRUCTION

NOT FOR CONSTRUCTION

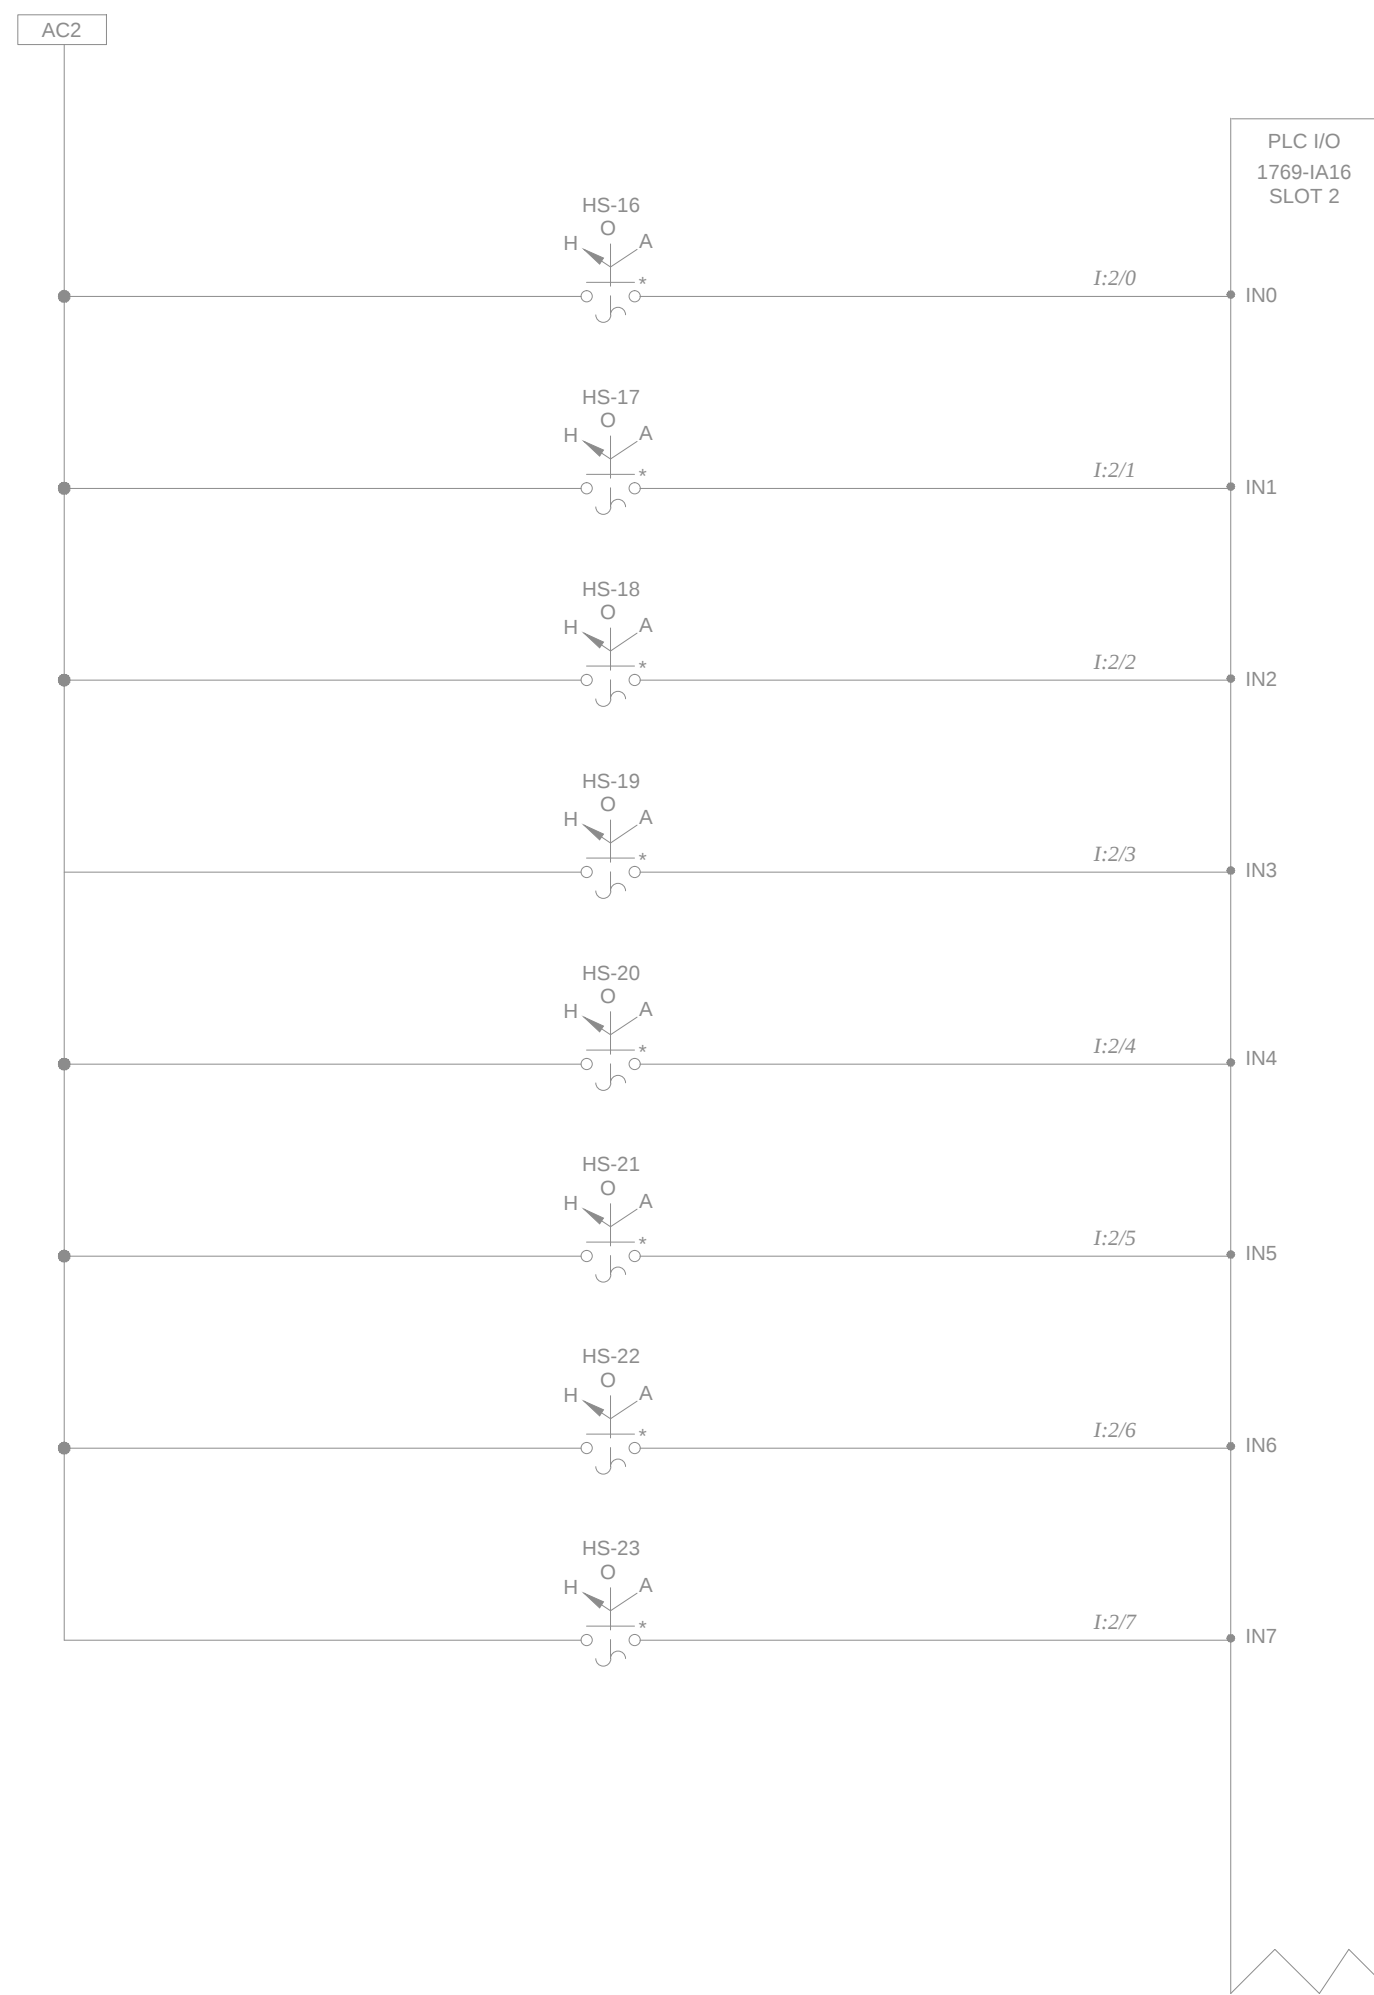

SPARE

SPARE

70-FRP-01  
FILTRATE RETURN PUMP


SPARE

SPARE

SPARE

SPARE

SPARE

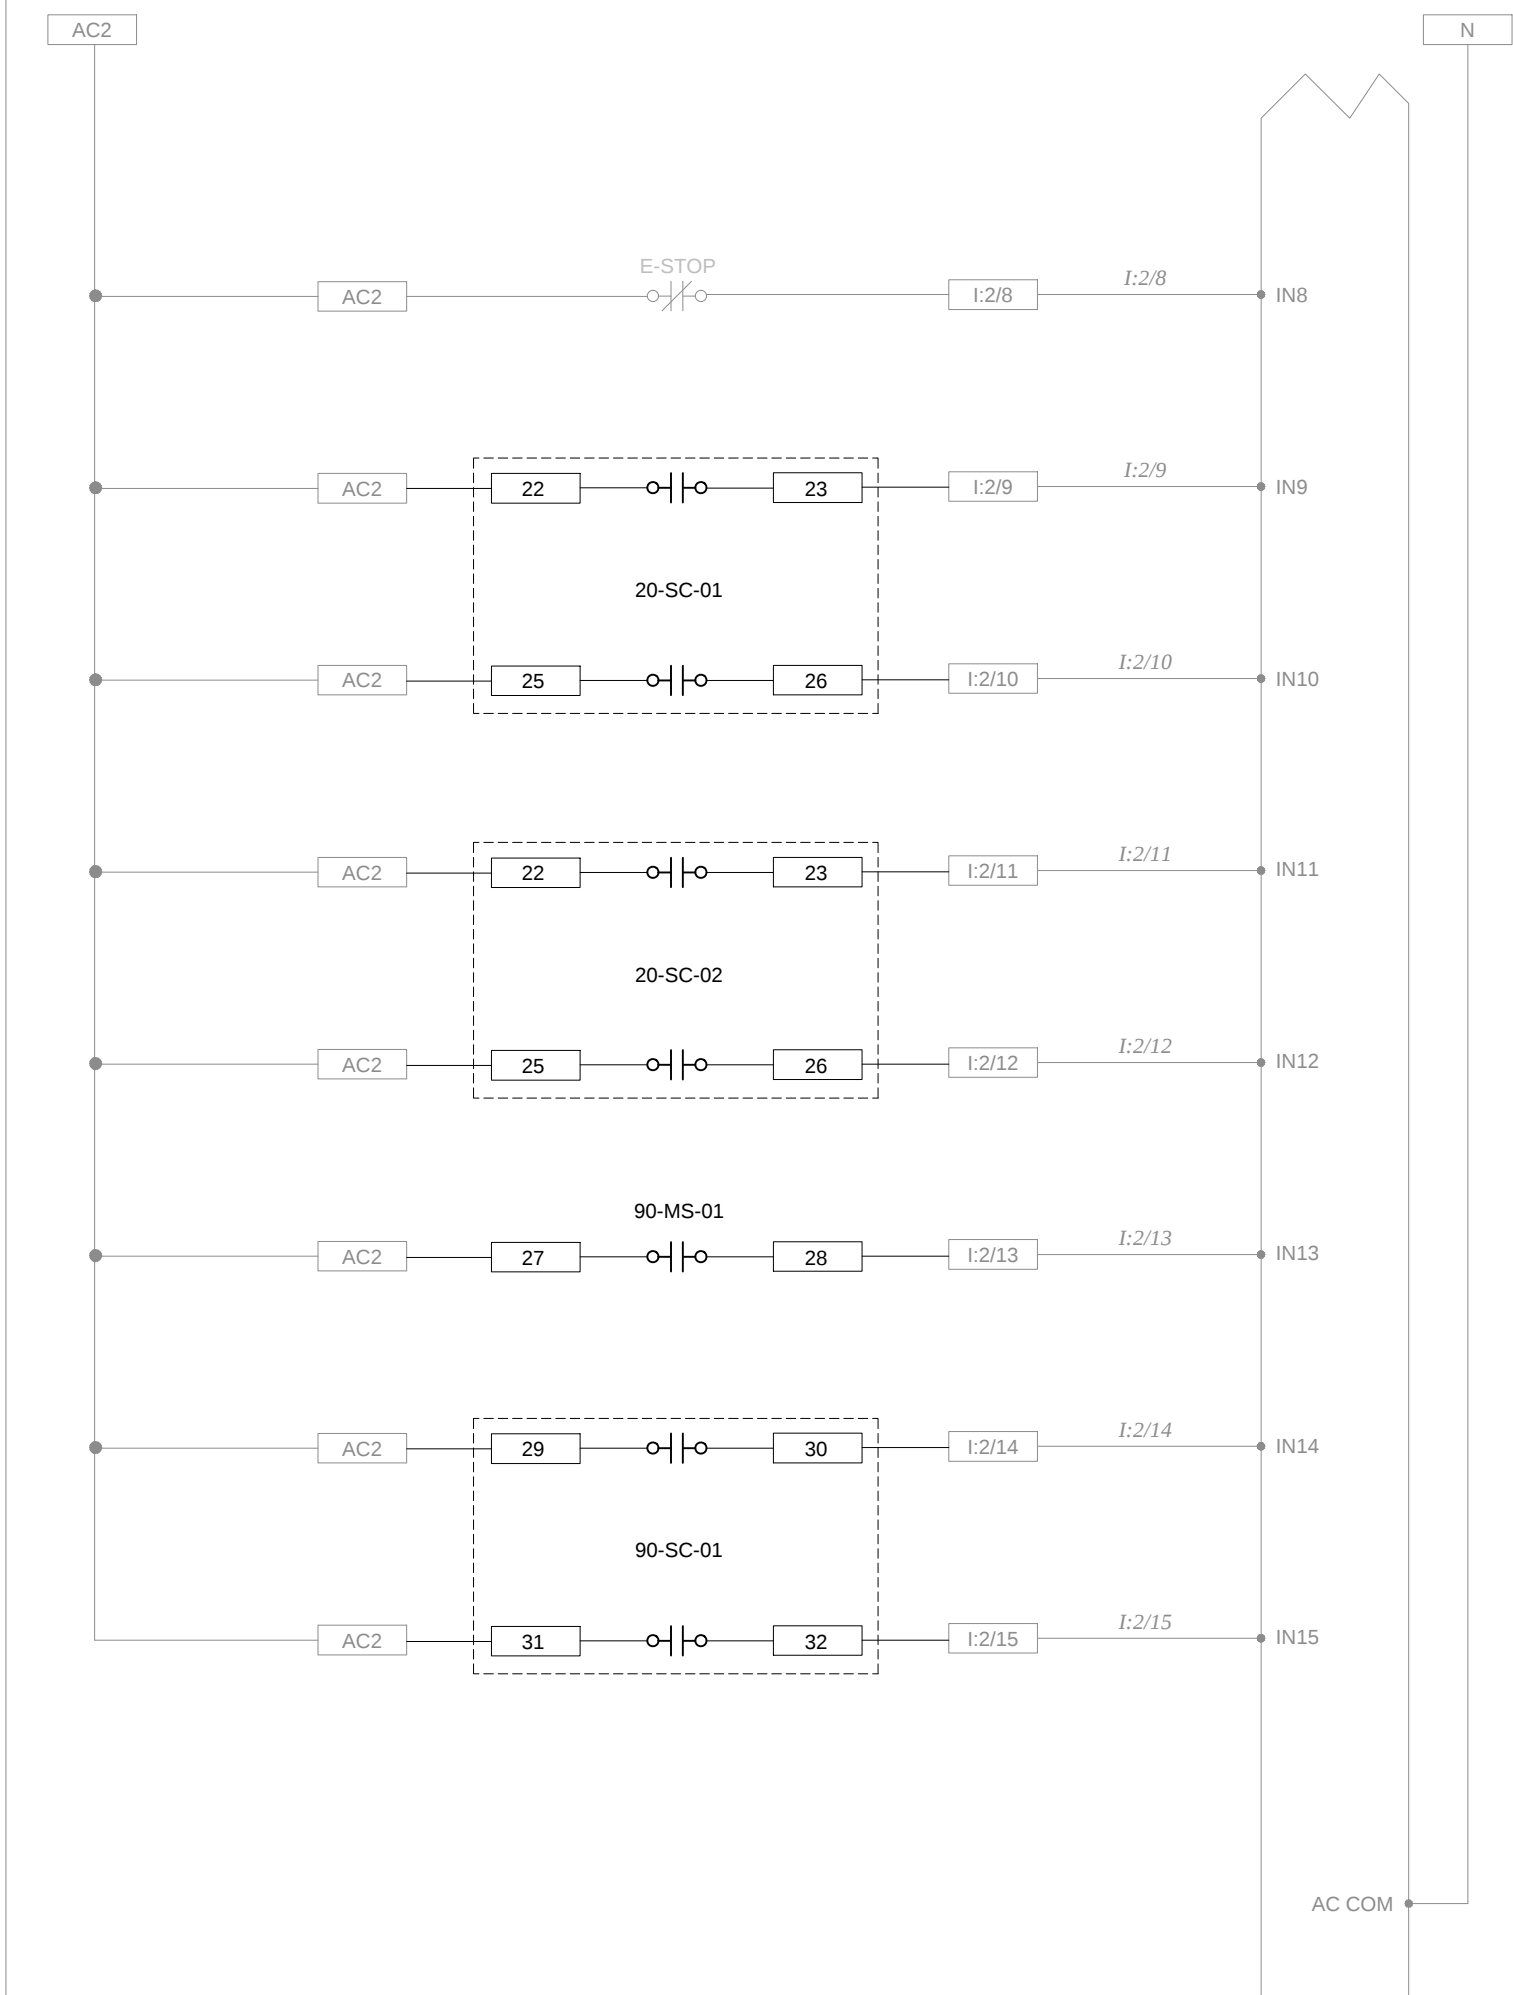

E-STOP

20-SC-01  
RUN STATUS

20-SC-01  
FAULT STATUS

20-SC-02  
RUN STATUS

20-SC-02  
FAULT STATUS

90-MS-01  
RUNNING

90-SC-01  
RUN STATUS

90-SC-01  
FAULT STATUS

| No. | Issue                     | Date        |
|-----|---------------------------|-------------|
| 1   | 60% REVIEW SUBMISSION     | 2013-MAR-08 |
| 2   | ISSUED FOR TENDER         | 2013-APR-10 |
| 3   | RELEASED FOR CONSTRUCTION | 2013-JUN-27 |



| No. | Revision | Ckd. By | Date |
|-----|----------|---------|------|
|     |          |         |      |
|     |          |         |      |
|     |          |         |      |

PERMIT OF PRACTICE  
EXP SERVICES INC.  
Signature *[Signature]*  
Date 2013/JUN/27  
PERMIT NUMBER: P483  
NT/NU Association of Professional  
Engineers and Geoscientists .

RELEASED FOR CONSTRUCTION



|                            |                          |
|----------------------------|--------------------------|
| Const. North               | Drawn By: TAW            |
| Dwg. Standards Ckd. By: PD | Designed By: DEB         |
| Date Printed               | Dwg. Design Ckd. By: JFP |

exp Services Inc.  
t: +1.613.688.1899 | f: +1.613.225.7330  
2650 Queensview Drive, Unit 100  
Ottawa, ON K2B 8H6  
CANADA  
www.exp.com



• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •  
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

|                                                                                   |                                                  |               |
|-----------------------------------------------------------------------------------|--------------------------------------------------|---------------|
| Project Title<br><br>WASTE WATER<br>TREATMENT PLANT<br>UPGRADE<br>PANGNIRTUNG, NU |                                                  |               |
| Dwg. Title<br><br>PLC #3 PANEL WIRING<br>SLOT 2                                   |                                                  |               |
| Project No.                                                                       | OTT-00204430-A0                                  |               |
| Dwg. No.                                                                          | E2614-1                                          | Rev. No.<br>0 |
| Scale                                                                             | NOT TO SCALE<br>This drawing is not to be scaled |               |

DISCRETE INPUT SLOT 2