



2013-06-20 10:00:00 AM


2013-06-20 10:00:00 AM

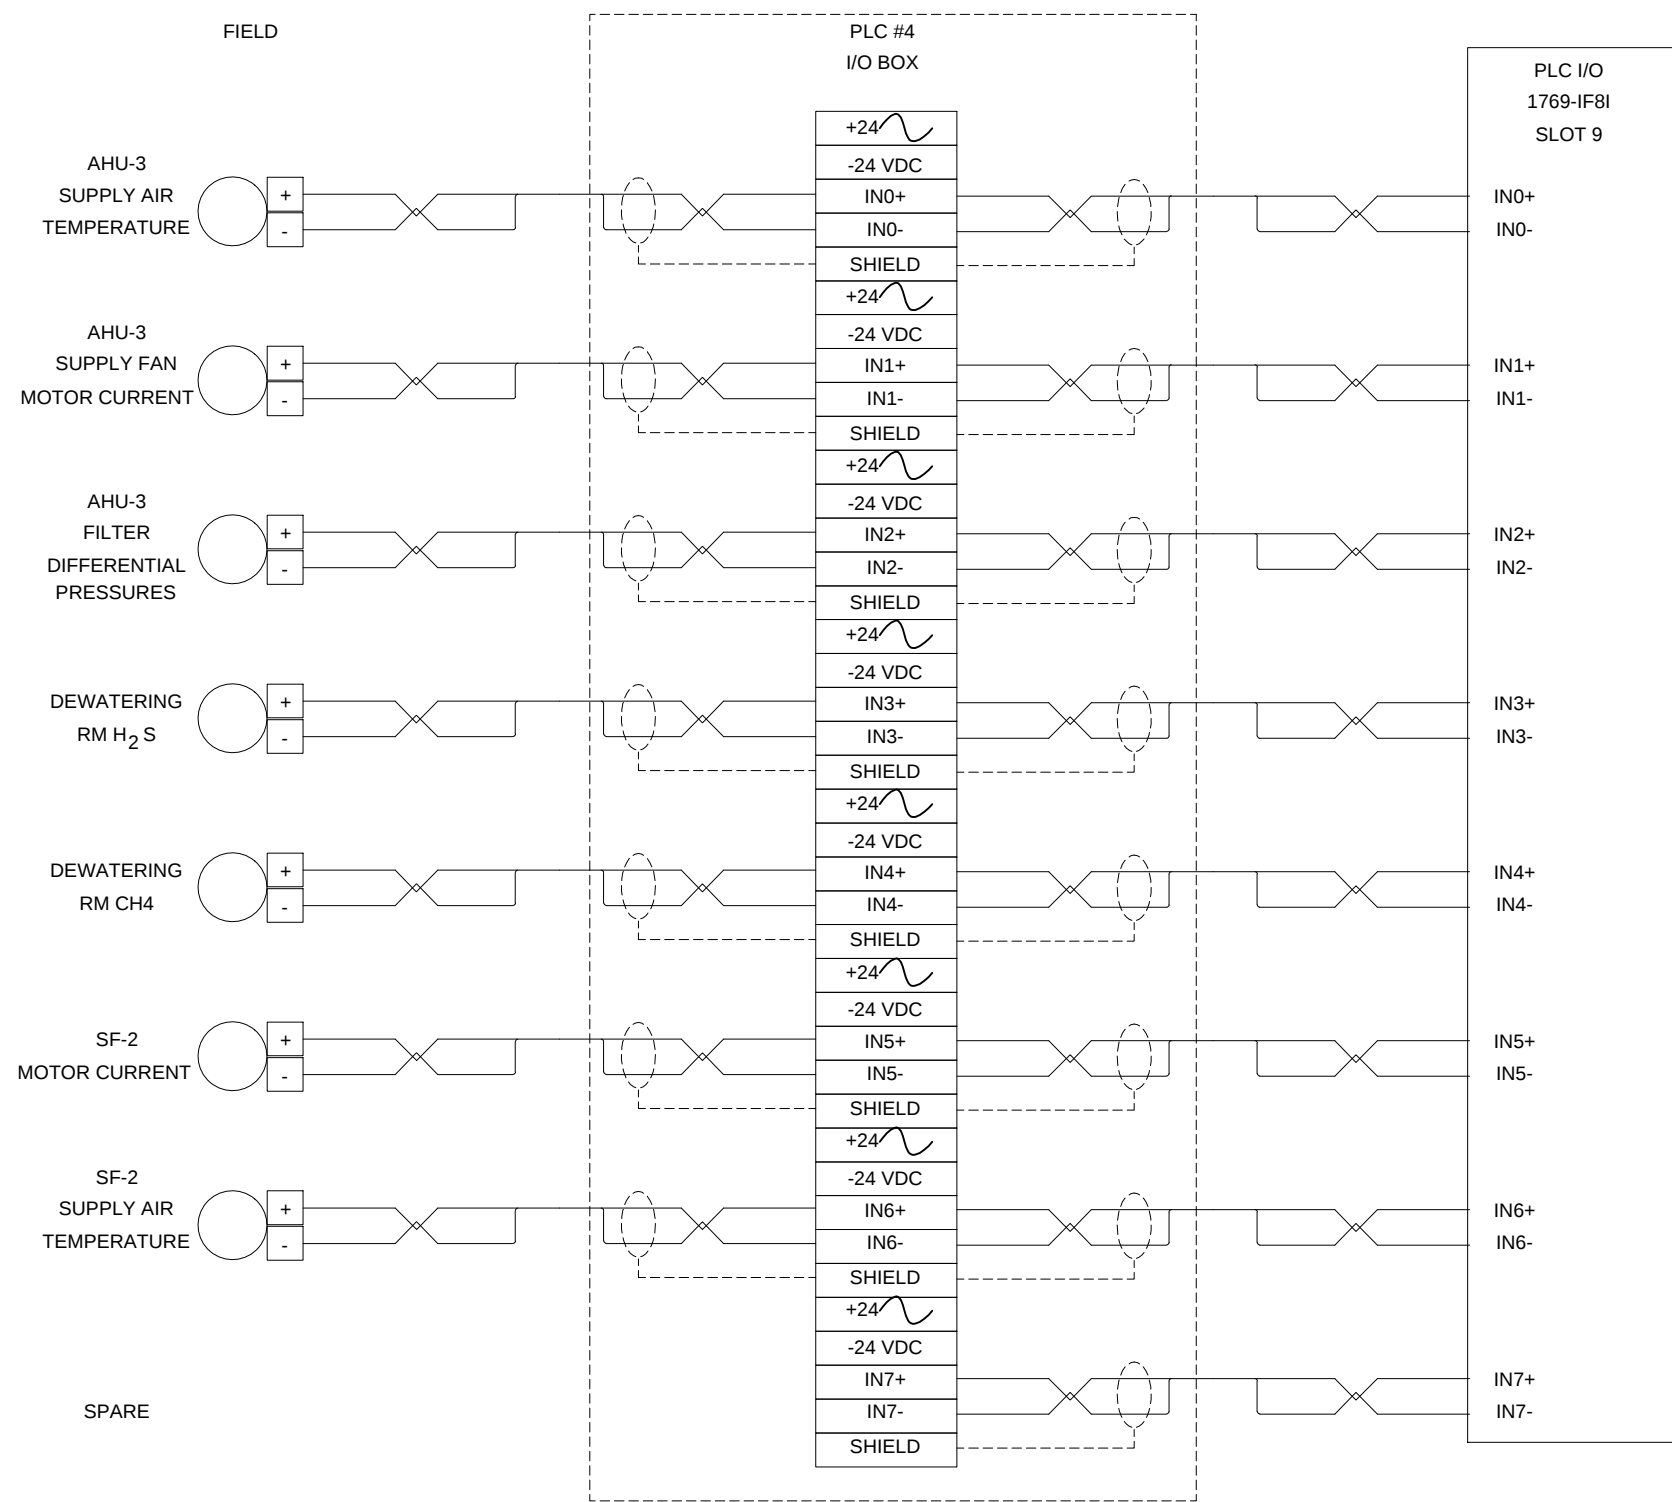


NEW ANALOG INPUT SLOT 9

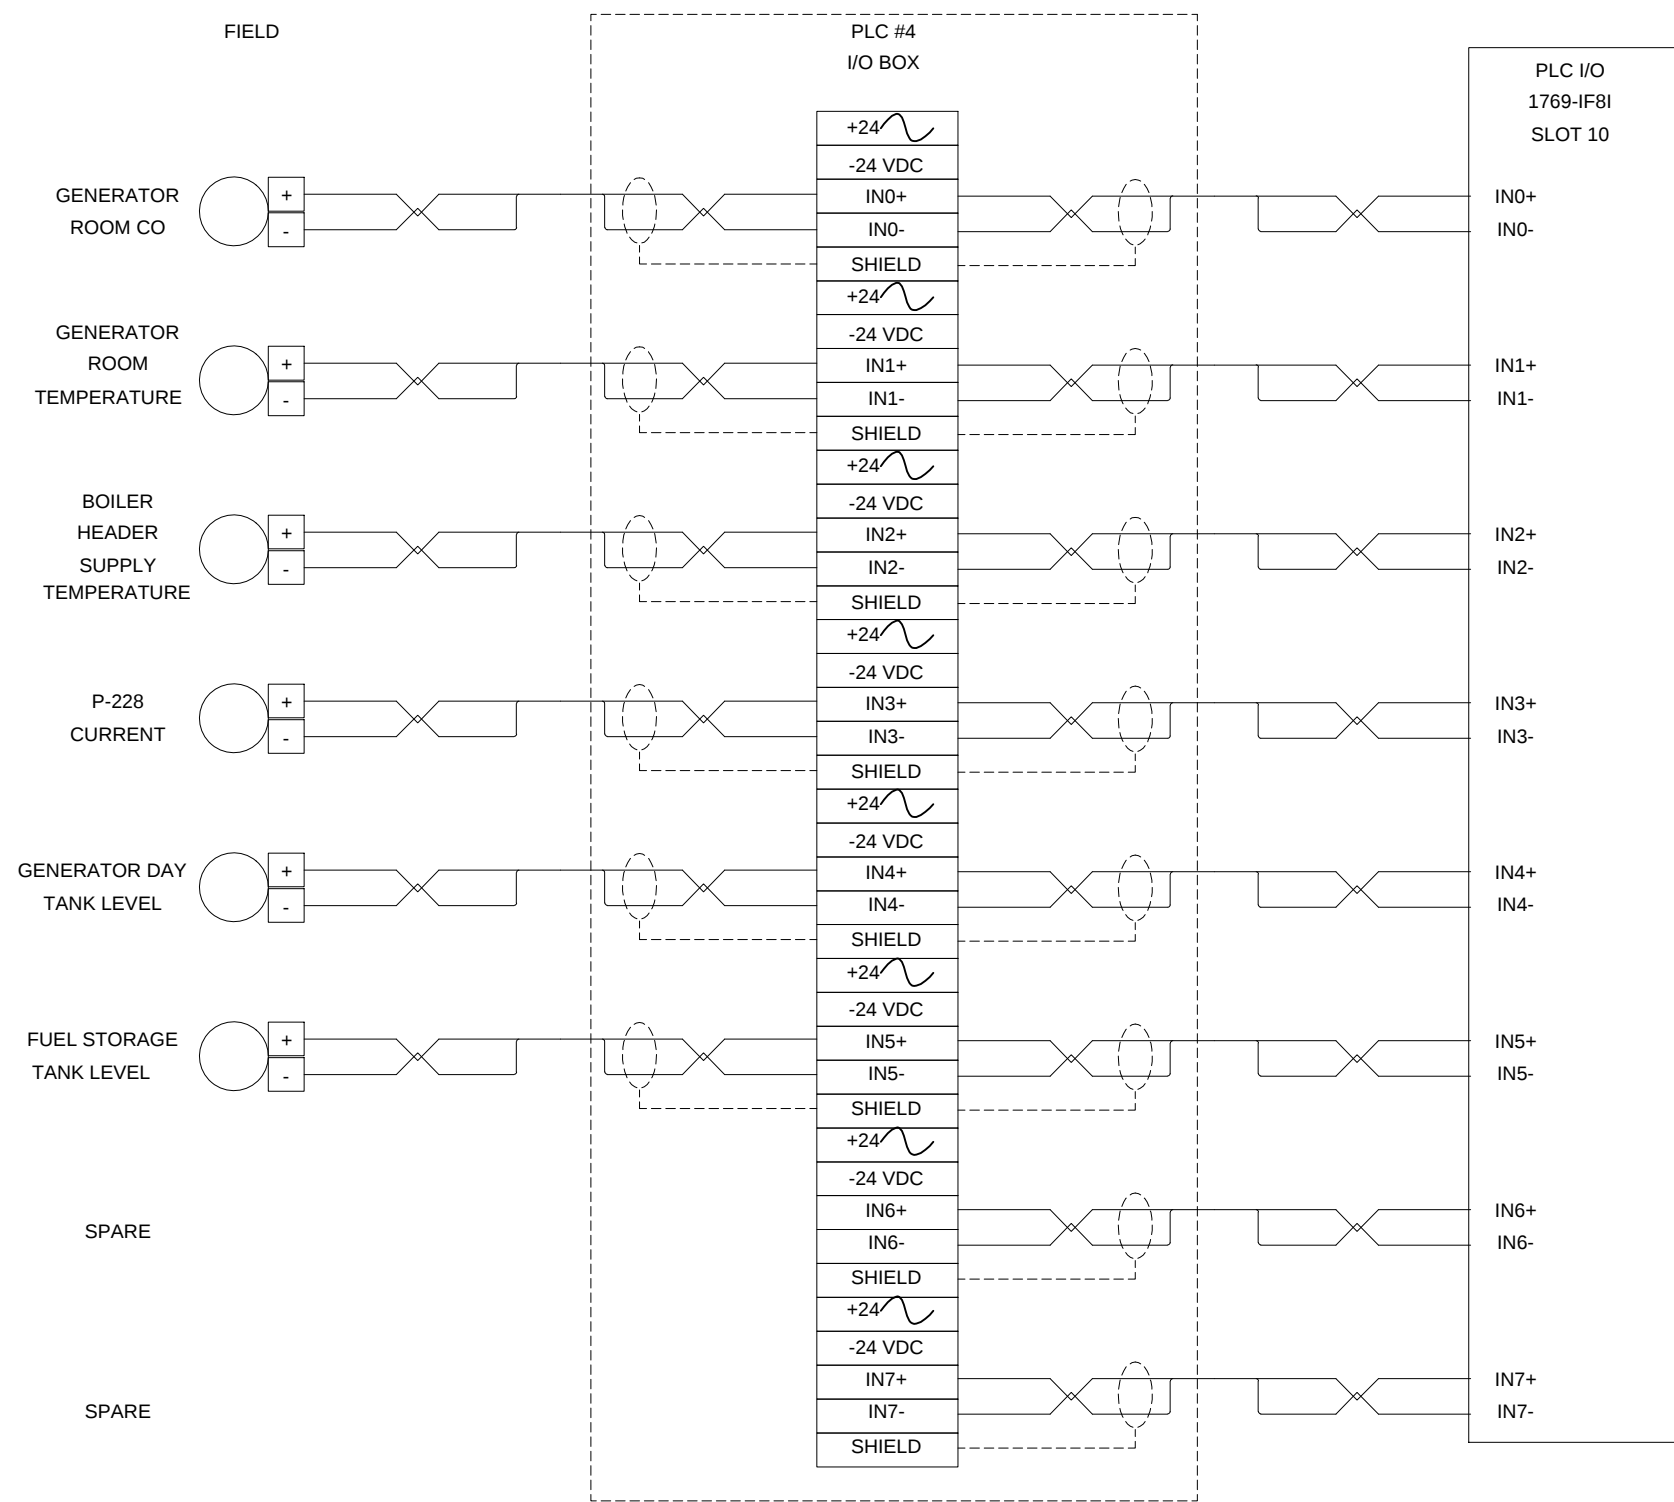

NEW ANALOG INPUT SLOT 10

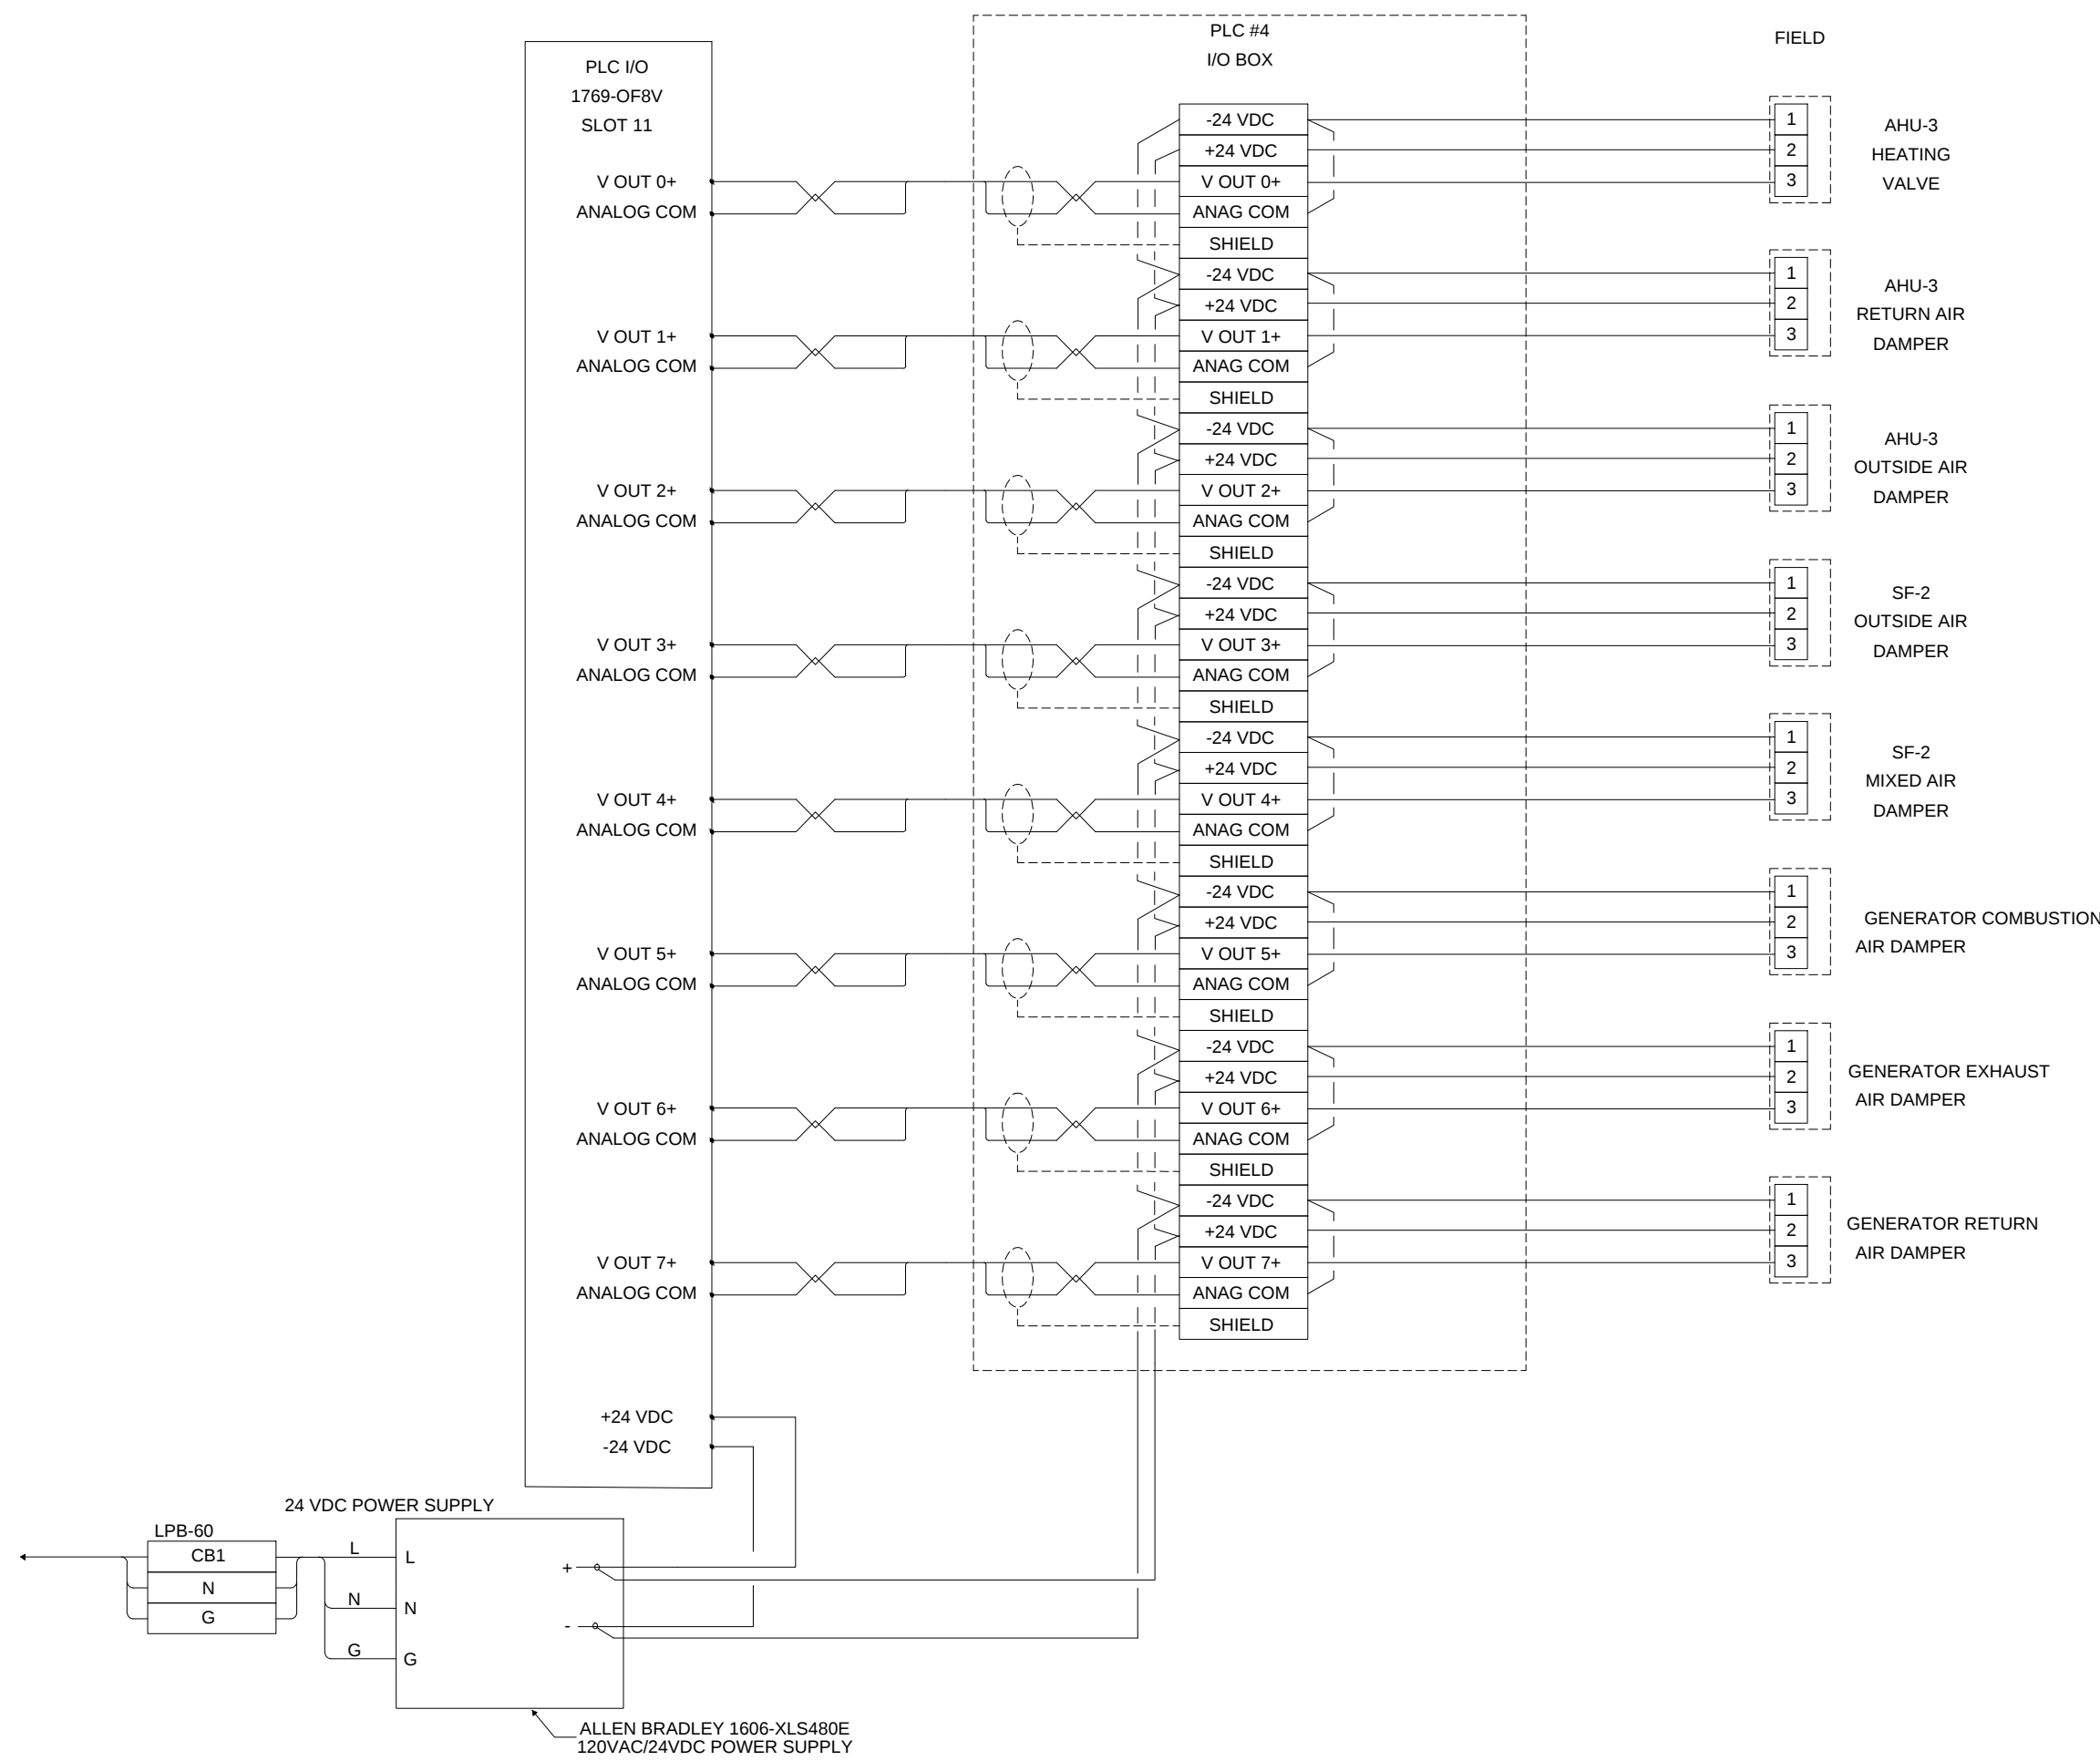

NEW ANALOG OUTPUT SLOT 11

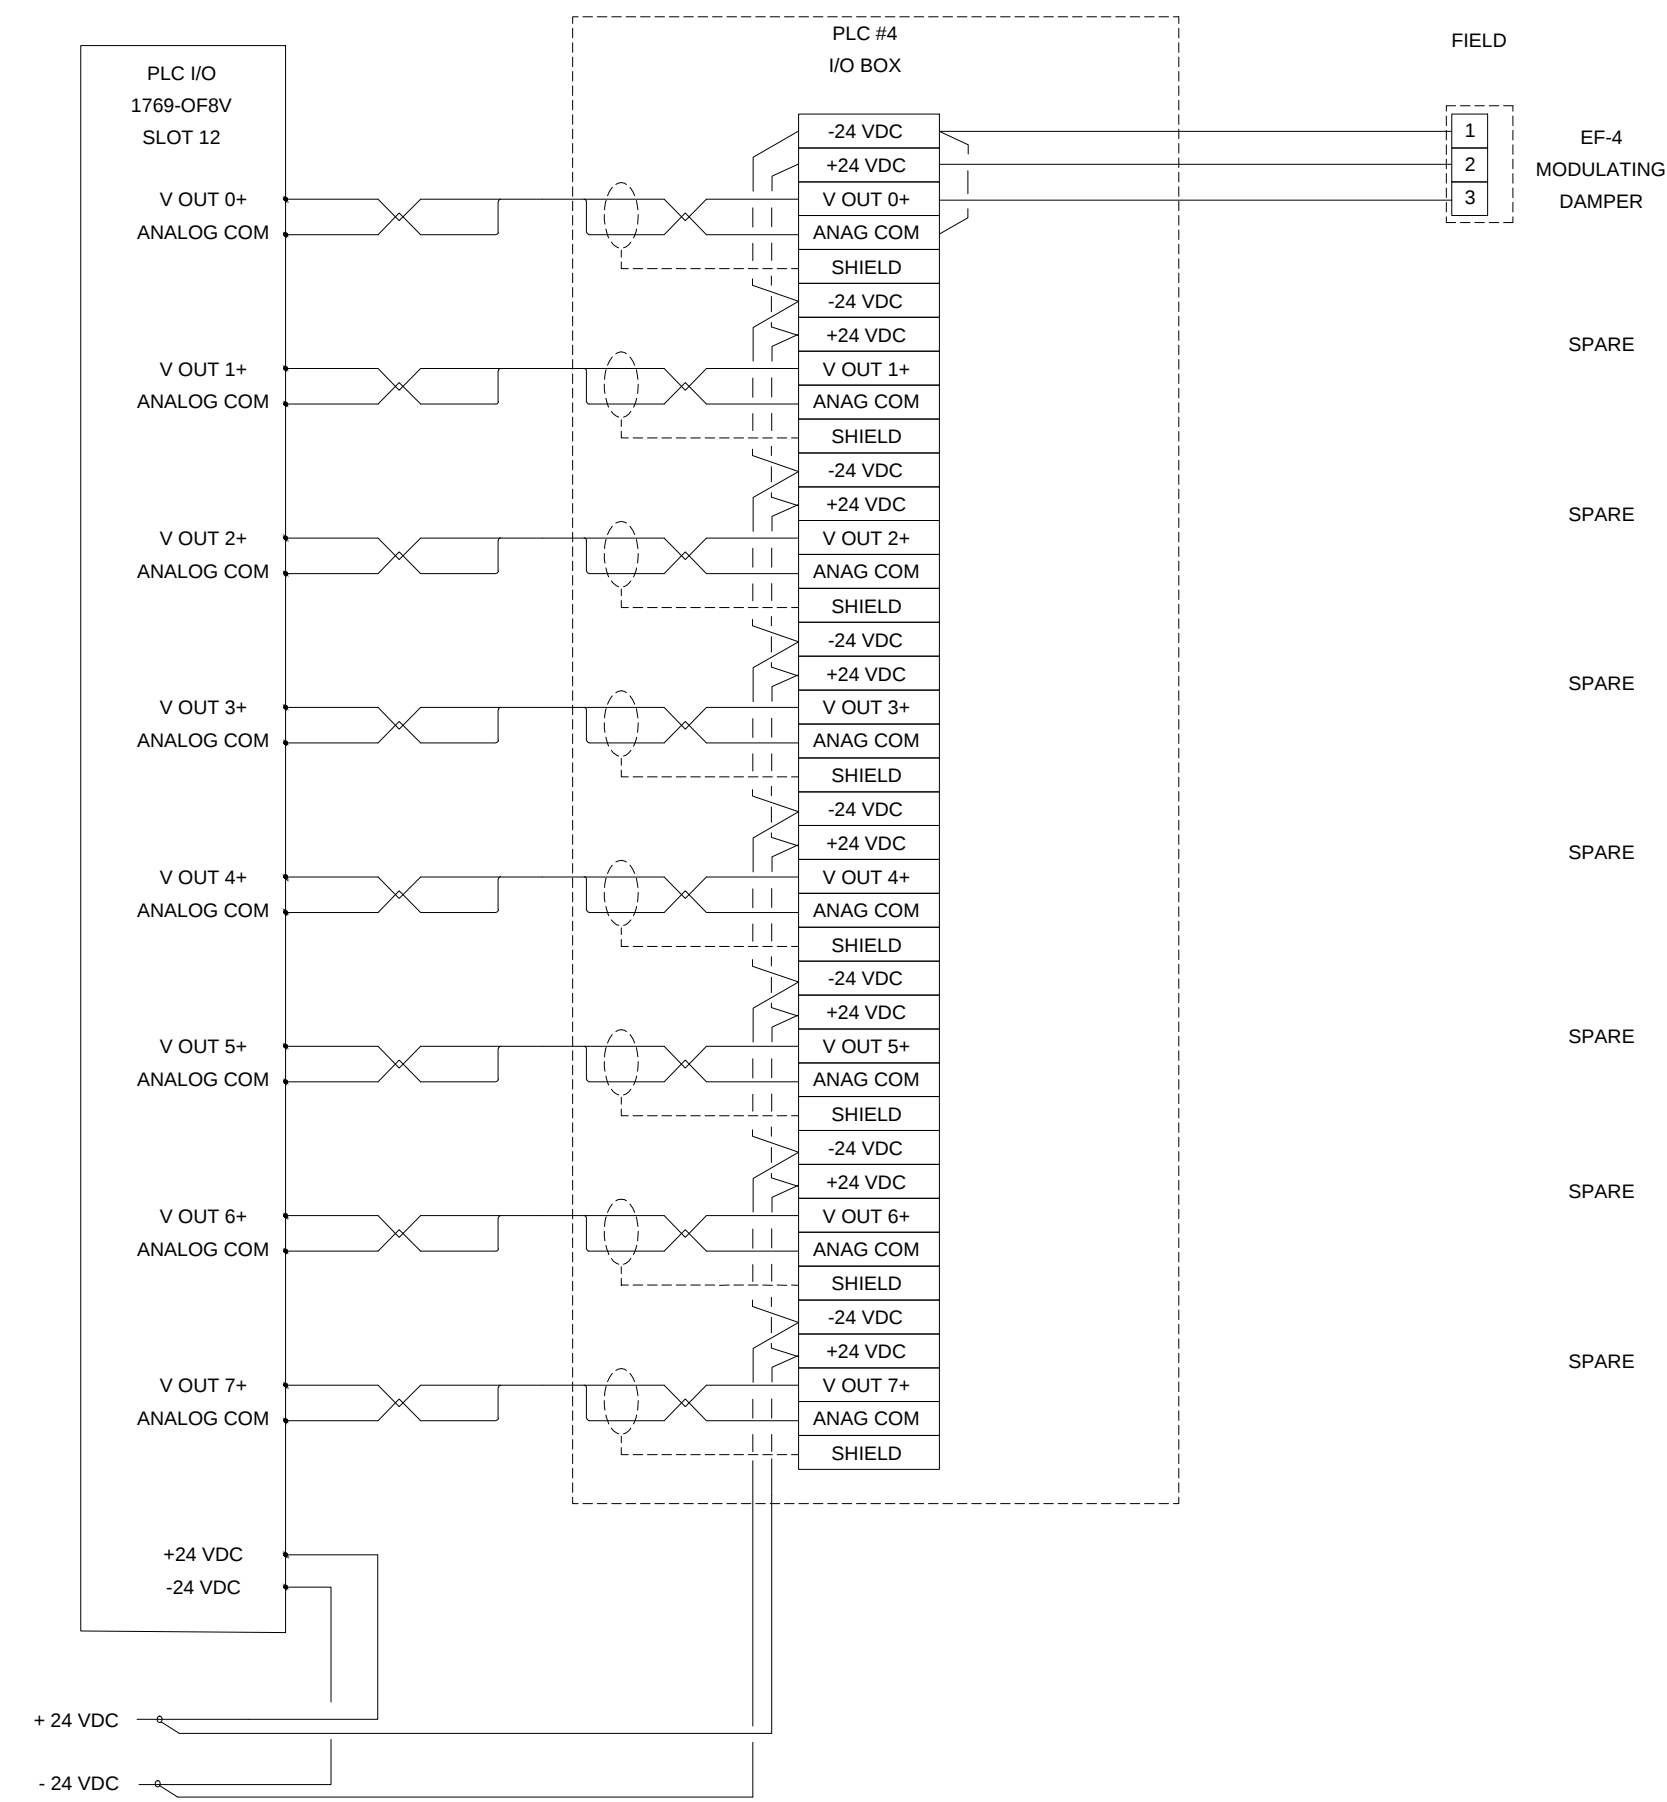

NEW ANALOG OUTPUT SLOT 12

No.	Issue	Date
1	60% REVIEW SUBMISSION	2013-MAR-8
2	ISSUED FOR TENDER	2013-APR-10
3	RELEASED FOR CONSTRUCTION	2013-JUN-27



No.	Revision	Ckd. By	Date

PERMIT OF PRACTICE
EXP SERVICES INC.
Signature: *[Signature]*
Date: 2013/JUN/27
PERMIT NUMBER: P483
NT/NU Association of Professional
Engineers and Geoscientists.

RELEASED FOR CONSTRUCTION

	Const. North
	Drawn By: TAW
	Dwg. Standards Ckd. By: PD
	Designed By: DEB
Date Printed	Dwg. Design Ckd. By: JFP

exp Services Inc.
t: +1.613.688.1899 | f: +1.613.225.7330
2650 Queensview Drive, Unit 100
Ottawa, ON K2B 8H6
CANADA

www.exp.com



• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title
**WASTE WATER
TREATMENT PLANT
UPGRADE
PANGNIRTUNG, NU**

Dwg. Title
**PLC #4 PANEL WIRING
SLOTS 9, 10, 11, 12**

Project No.	OTT-00204430-A0	Rev. No.
Dwg. No.	E2634-1	0

Scale
NOT TO SCALE
This drawing is not to be scaled