

- NOTES:
1. LOW VOLTAGE/NO POWER SIGNALS THE INVERTER TO SWITCH FROM INVERTER TO HYDRO MODE.
 2. INVERTER/BATTERY CHARGER WILL CHARGE THE BATTERIES WHEN THE GENERATOR IS ON. CHARGE SHOULD BE DISCONNECTED WHILE RWP-1/2 IS ON.
 3. GENERATOR SHALL SERVE THE FULL LOAD INCLUDING INVERTER BATTERY CHARGE AT WEEKLY TEST. TEST TIME TO BE ADJUSTABLE (30-240 MIN.)

ORIGINAL SIGNED
BY ENGINEER


NOT TO SCALE:

Conditions of Use

Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.

Do not scale dimensions from drawing.

Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.

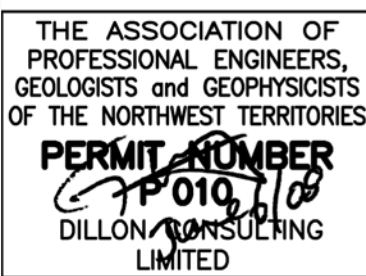

DILLON
CONSULTING

3	ISSUED FOR TENDER	06/06/08	GS
2	ISSUED FOR 100% CLIENT REVIEW	04/03/08	GS
1	ISSUED FOR CLIENT REVIEW	03/15/08	GS
No.	ISSUED FOR	DATE	BY

DESIGN	SAI	REVIEWED BY	GS
DRAWN	JPM	CHECKED BY	GS
DATE	JUNE 2008		
SCALE	NTS		

TALOYOAK WATER TREATMENT PLANT
TALOYOAK, NUNAVUT

ELECTRICAL RISER DIAGRAM

PROJECT NO.
07-8107-2000

SHEET NO.

402