

License No: 3BC-EUR0611

Issued Date: February 6, 2006

Expiry Date: January 30, 2011

Project Name: Eureka Weather Station

Licensee: Environment Canada

Mailing Address: 355 River Road,
Ottawa, ON, K1A 0H3
for Eureka Weather Station, Eureka, NU, X0A 0G0

Name of Company filing Annual Report (if different from Name of Licensee please clarify relationship between the two entities, if applicable):

Environment Canada

General Background Information on the Project (*optional):

Licence Requirements: the licensee must provide the following information in accordance with

Part B ▼

Item 2 ▼

A summary report of water use and waste disposal activities, including, but not limited to: methods of obtaining water; sewage and greywater management; drill waste management; solid and hazardous waste management.

Water Source(s): Station Creek

Water Quantity:

10,000

Quantity Allowable Domestic (cu.m)

2,966

Actual Quantity Used Domestic (cu.m)

0

Quantity Allowable Drilling (cu.m)

0

Total Quantity Used Drilling (cu.m)

Waste Management and/or Disposal

☒ Solid Waste Disposal☒ Sewage☐ Drill Waste☒ Greywater☐ Hazardous☐ Other:**RECEIVED***By Ida Porter at 2:09 pm, Apr 18, 2011*

Additional Details:

Appendix A: Quantity of Raw Water
Appendix B: Quality of Raw Water
Appendix C: Quality of Tap (non-drinking) Water
Appendix D: Quantity of Drinking Water Consumed
Appendix E: Quality of Drinking Water Consumed
Appendix F: Quantity of Waste Water Discharged
Appendix G: Quality of Waste Water Discharged

A list of unauthorized discharges and a summary of follow-up actions taken.

Spill No.: (as reported to the Spill Hot-line)

Date of Spill:

Date of Notification to an Inspector:

Additional Details: (impacts to water, mitigation measures, short/long term monitoring, etc)

There were no unauthorized discharges during 2010.

Revisions to the Spill Contingency Plan

Other: (see additional details)



Additional Details:

The Oil Pollution Emergency Plan was revised and re-submitted to the Nunavut Water Board under separate cover.

Revisions to the Abandonment and Restoration Plan

Other: (see additional details)



Additional Details:

The Abandonment and Restoration Plan was revised and re-submitted to the Nunavut Water Board under separate cover.

Progressive Reclamation Work Undertaken

Additional Details (i.e., work completed and future works proposed)

Reference to part B.2.v of license:

Work completed in 2010

- a. Fuel tanks and associated pipe line were stripped and repainted.
- b. Re supply fuel transfer hose replacements were purchased and shipped to Eureka for future use on a rotational basis.
- c. Geotechnical Study to underpin runway recapitalization, sewage lagoon replacement, and fresh water lagoon recapitalization completed. Final report received and currently under review.
- d. Additional soil sampling conducted to more accurately delineate scope of contaminated sites.
- e. Phases 2 and 3 of Environmental Site Assessments completed. Report received and currently under review.
- f. Application for renewal of Eureka Water Licence was initiated. Awaiting status of renewal process.
- g. Updates to the Summary and Operations Procedures for Drinking Water, Sewage, Solid Waste Disposal, and Waste Treatment Facilities were performed and forwarded to NWB during the Water Licence Renewal Process.

Work planned for 2011

- a. Replacement Mobile Fuel Tank Trailer was purchased and is to arrive on 2011 Sealift.
- b. Study on decommissioning of surplus buildings re-scheduled for 2011.
- c. Rigid Fuel Containment Systems for fuel storage areas and fuel transfer areas are to be purchased in 2011 and sent via Sealift 2011 or 2012
- d. Storage building replacement project to be initiated in 2011. Design concepts and planning schedules to be sent to NWB for review.
- e. Heat recovery system modification project to be continued in 2011. Currently finalizing design details.
- f. Internal review of Geotechnical study and associated recommendations for the water lagoon, sewage lagoon, and runway to be scheduled with all relevant stakeholders in order to establish future path forward.
- g. The process of decanting the sewage lagoon will be modified which will involve floating the pump intake in the effluent, in an effort to reduce the TSS levels within the pumped effluent. The samples will be analyzed for additional parameters as requested by the NWB recommendations.

Results of the Monitoring Program including:

Details attached ▼

Additional Details:

See Appendix H for GPS Co-ordinates of each location where sources of water are utilized

The GPS Co-ordinates (in degrees, minutes and seconds of latitude and longitude) of each location where wastes associated with the licence are deposited;

Details attached ▼

Additional Details:

See Appendix H for GPS Co-ordinates of each location where wastes associated with the licence are deposited.

Results of any additional sampling and/or analysis that was requested by an Inspector

No additional sampling requested by an Inspector or the Board ▼

Additional Details: (date of request, analysis of results, data attached, etc)

Any other details on water use or waste disposal requested by the Board by November 1 of the year being reported.

No additional sampling requested by an Inspector or the Board ▼

Additional Details: (Attached or provided below)

Any responses or follow-up actions on inspection/compliance reports

No inspection and/or compliance report issued by INAC ▼

Additional Details: (Dates of Report, Follow-up by the Licensee)

Any additional comments or information for the Board to consider

--

Date Submitted:

--

Submitted/Prepared by:

--

Contact Information:

Tel:

--

Fax:

--

email:

--

Appendix A
Quantity of Raw Water

**QUANTITIES OF
FRESH WATER OBTAINED**

Eureka 2010

Fresh Water: Fresh Water Lagoon

1. 2 pump capacities: Tsurumi Pumps Model LB2-400 with a 20' head ~ 19.5 gal/min
2. Pump time*: 2 pumps x 12 days x 24 hours x 60 min x 19.5 gal/min
= ~ 675,000gal or ~ 3000m³

*Pumping began on July 16 2010 and ended on September 3, 2010

Intake hose screen has ¼" diameter holes

Pumping took place after initial rush of stream had taken place and the amount of silt/mud had diminished.

Appendix B Quality of Raw Water

EUREKA RAW WATER ANALYSIS 2007-2010

RAW WATER

Lagoon

Parameter	2007	2008	2009	2010	MAC ¹	Guidelines mg/l
						CANADIAN ⁱ OG ² /AO ³
TDS			256	482		
Organic Carbon	61.2	40.8	0.9	<0.5		
Hardness	1300	1330	132	292		
Coliforms, Total		<1.0		<1.0	0/100 ml	
Escherichia coli		<1.0		<1.0	0/100 ml	
Aluminum	<0.030	0.0092	0.964	0.0044		0.2
Antimony			0.0002	<0.0001		
Arsenic			<0.0002	<0.0002		
Barium	0.0781	0.0657	0.0064	0.0190	1	
Beryllium	<0.0001	<0.0001	<0.0001	<0.0001		
Boron	0.233	0.103			5	
Cadmium	0.0003	<0.00005	<0.0001	<0.00005	0.005	
Cesium			<0.0001	<0.0001		
Chromium	0.0003	0.0002	0.0002	<0.0001	0.05	
Cobalt	0.0006	0.0004	<0.0001	<0.0001		
Copper	0.0016	0.022	0.0066	0.0282		<1.0
Iron	0.0536	<0.050	0.151	<0.050		<0.3
Lead	0.0002	<0.0001	<0.0001	<0.0001	0.01	
Lithium			0.0041	0.0094		
Manganese	0.0182	0.0347	0.0051	0.0071		<0.05
Molybdenum	0.0006	0.0006	0.0001	0.0001		
Nickel	0.0035	0.003	0.0006	0.0007		
Rubidium			0.0005	0.0009		
Selenium			<0.0005	0.0006		
Silver	<0.0001	<0.0001	<0.0001	<0.0001		
Strontium	1.34	1.18	0.112	0.288		
Thallium	<0.0001	<0.0001	<0.0001	<0.0001		
Titanium	0.0014	0.001	0.0013	0.0001		
Uranium			0.0002	0.0003	0.02	
Vanadium	0.0003	<0.0001	0.0003	<0.0001		
Zinc	0.01	0.0039	<0.0005	0.0019		<5.0
Silicon	2.51	2.27				
*Bromodichloromethane			<0.005	<0.005	0.016	
*Bromoform			<0.005	<0.005		
*Dibromochloromethane			<0.005	<0.005		
*Trihalomethanes	0.005		<0.005	<0.005	0.1	

*Subcontracted organics are in concentrations less than detectable levels except for those listed immediately above

iGuidelines for Canadian Drinking Water Quality Summary Table, May 2008

http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum_guide-res_recom/chemical-chimiques-eng.php#tbl6

http://www.ccme.ca/assets/pdf/cda_wide_strategy_mwwe_final_e.pdf

iiUS Environmental Protection Agency Drinking Water Standards

<http://www.epa.gov/safewater/contaminants/index.html>

¹Maximum Acceptable Concentration

²Aesthetic Objectives

³Operational Guidance Values

Appendix B

Quality of Raw Water

RAW WATER: WATER LAGOON: 2010



Taiga Environmental Laboratory

4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3

Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:

100186

- FINAL REPORT -

Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:

Hilina Harper _____

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association for Laboratory Accreditation Inc. (CALA) as a testing laboratory for specific tests registered with CALA.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 1 of 11

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT, X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EULAG0510

Taiga Sample ID: 001

Client Project:

Sample Type: Lagoon

Received Date: 06-May-10

Sampling Date: 06-May-10

Sampling Time: 6:30

Location: Lagoon/ReverseOsmosis/Tap

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	482	10	mg/L	11-May-10	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	< 0.5	0.5	mg/L	08-May-10	SM5310:B	
<u>Major Ions</u>						
Hardness	292	0.7	mg/L	07-May-10	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
<u>Organics</u>						
Bromodichloromethane	< 0.005	0.005	mg/L	13-May-10	EPA8260B	
Bromoform	< 0.005	0.005	mg/L	13-May-10	EPA8260B	
Chloroform	< 0.005	0.005	mg/L	13-May-10	EPA8260B	
Dibromochloromethane	< 0.005	0.005	mg/L	13-May-10	EPA8260B	
Trihalomethanes, Total	< 0.005	0.005	mg/L	13-May-10	EPA8260B	

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 2 of 11

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EULAG0510

Taiga Sample ID: 001

Trace Metals, Total

Aluminum	4.4	0.6	µg/L	07-May-10	EPA200.8
Antimony	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Arsenic	< 0.2	0.2	µg/L	07-May-10	EPA200.8
Barium	19.0	0.1	µg/L	07-May-10	EPA200.8
Beryllium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Cadmium	< 0.05	0.05	µg/L	07-May-10	EPA200.8
Cesium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Chromium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Cobalt	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Copper	28.2	0.2	µg/L	07-May-10	EPA200.8
Iron	< 5	5	µg/L	07-May-10	EPA200.8
Lead	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Lithium	9.4	0.2	µg/L	07-May-10	EPA200.8
Manganese	7.1	0.1	µg/L	07-May-10	EPA200.8
Molybdenum	0.1	0.1	µg/L	07-May-10	EPA200.8
Nickel	0.7	0.1	µg/L	07-May-10	EPA200.8
Rubidium	0.9	0.1	µg/L	07-May-10	EPA200.8
Selenium	0.6	0.3	µg/L	07-May-10	EPA200.8
Silver	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Strontium	288	0.1	µg/L	07-May-10	EPA200.8
Thallium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Titanium	0.1	0.1	µg/L	07-May-10	EPA200.8
Uranium	0.3	0.1	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010

Page 3 of 11

Print Date: Friday, May 14, 2010

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EULAG0510

Taiga Sample ID: 001

Vanadium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Zinc	1.9	0.4	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010
Print Date: Friday, May 14, 2010

Page 4 of 11

Appendix B

Quality of Raw Water

RAW WATER: WATER LAGOON: 2009



Taiga Environmental Laboratory

4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3

Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:

290373

- FINAL REPORT -


Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:

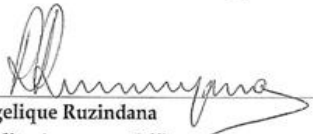
Angelique Ruzindana
Quality Assurance Officer

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 1 of 14

Appendix B Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUFW0709

Taiga Sample ID: 001

Client Project:

Sample Type: Freshwater

Received Date: 09-Jul-09

Sampling Date: 09-Jul-09

Sampling Time: 7:30

Location:

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	256	10	mg/L	15-Jul-09	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	0.9	0.5	mg/L	15-Jul-09	SM5310:B	
<u>Major Ions</u>						
Hardness	132	0.7	mg/L	10-Jul-09	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total			MPN/100mL		SM9223:B	203
Escherichia coli			MPN/100mL		SM9223:B	203
<u>Organics</u>						
Bromodichloromethane	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Bromoform	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Chloroform	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Dibromochloromethane	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Trihalomethanes, Total	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	

Report Date: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 2 of 14

RAW WATER: WATER LAGOON: 2008

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280154

- CERTIFICATE OF ANALYSIS -

Client Sample ID: TOC 07-EU10 Water Lagoon

Taiga Sample ID: 001

Client Project:

Sample Type: Unknown Water

Received Date: 16-Apr-08

Sampling Date: 15-Apr-08

Sampling Time: 7:15

Location: Water Lagoon

Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	40.8	0.5	mg/L	17-Apr-08	SM5310:B	
<u>Major Ions</u>						
Hardness	1330	0.7	mg/L	23-Apr-08	SM2340:B	

ReportDate: Thursday, May 01, 2008
Print Date: Thursday, May 01, 2008

Page 2 of 5

Appendix B Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Water Lagoon

Taiga Sample ID: 003

Client Project:
Sample Type: Unknown Water
Received Date: 10-Apr-08
Sampling Date: 10-Apr-08
Sampling Time: 7:30
Location:
Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifer
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
<u>Trace Metals, Total</u>						
Aluminum	9.2	0.6	µg/L	20-Apr-08	EPA200.8	
Barium	65.7	0.1	µg/L	20-Apr-08	EPA200.8	
Beryllium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Boron	103	0.9	µg/L	20-Apr-08	EPA200.8	
Cadmium	< 0.05	0.05	µg/L	20-Apr-08	EPA200.8	
Chromium	0.2	0.1	µg/L	20-Apr-08	EPA200.8	
Cobalt	0.4	0.1	µg/L	20-Apr-08	EPA200.8	
Copper	22.0	0.3	µg/L	20-Apr-08	EPA200.8	
Iron	< 50	50	µg/L	20-Apr-08	EPA200.8	
Lead	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Manganese	34.7	0.1	µg/L	20-Apr-08	EPA200.8	
Molybdenum	0.6	0.1	µg/L	20-Apr-08	EPA200.8	

Report Date: Wednesday, April 23, 2008
Print Date: Wednesday, April 23, 2008

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Water Lagoon

Taiga Sample ID: 003

Nickel	3.0	0.1	µg/L	20-Apr-08	EPA200.8
Silver	<0.1	0.1	µg/L	20-Apr-08	EPA200.8
Strontium	1180	0.1	µg/L	20-Apr-08	EPA200.8
Thallium	<0.1	0.1	µg/L	20-Apr-08	EPA200.8
Titanium	1.0	0.1	µg/L	20-Apr-08	EPA200.8
Vanadium	<0.1	0.1	µg/L	20-Apr-08	EPA200.8
Zinc	3.9	0.4	µg/L	20-Apr-08	EPA200.8

Subcontracted Metals

Silicon	2.27	0.05	mg/L	17-Apr-08	SM3120B
---------	------	------	------	-----------	---------

Subcontracted Organics

1,1,1,2-Tetrachloroethane	<1	1	ug/L	17-Apr-08	EPA8260
1,1,1-Trichloroethane	<1	1	ug/L	17-Apr-08	EPA8260
1,1,2,2-Tetrachloroethane	<1	1	ug/L	17-Apr-08	EPA8260
1,1,2-Trichloroethane	<1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloroethane	<1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloropropene	<1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichlorobenzene	<1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichloropropane	<1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trichlorobenzene	<1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trimethylbenzene	<1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromo-3-Chloropropane	<1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromoethane	<1	1	ug/L	17-Apr-08	EPA8260
1,2-Dichlorobenzene	<1	1	ug/L	17-Apr-08	EPA8260
1,2-Dichloroethane	<1	1	ug/L	17-Apr-08	EPA8260

ReportDate: Wednesday, April 23, 2008

Print Date: Wednesday, April 23, 2008

Page 13 of 17

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: TOC 07-EU4

Taiga Sample ID: 002

Client Project:
Sample Type: Freshwater
Received Date: 15-May-07
Sampling Date: 15-May-07
Sampling Time: 6:00

Location: Water Lagoon

Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifier
<u>Inorganics - Nutrients</u>							
Organic Carbon, Total	61.2	0.5	mg/L	22-May-07	SM5310:B		
<u>Major Ions</u>							
Hardness	1300	0.7	mg/L	22-May-07	SM2340:B	010602	

Report Date: Sunday, May 27, 2007
Print Date: Sunday, May 27, 2007

Page 6 of 23

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Metal 07-EU7

Taiga Sample ID: 003

Client Project:
Sample Type: Freshwater
Received Date: 15-May-07
Sampling Date: 15-May-07
Sampling Time: 6:00
Location: Water Lagoon
Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifier
<u>Trace Metals, Total</u>							
Aluminum	< 30	30	µg/L	25-May-07	EPA200.8	100107	
Barium	78.1	0.1	µg/L	25-May-07	EPA200.8	100139	
Beryllium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100105	
Boron	233	0.9	µg/L	25-May-07	EPA200.8		
Cadmium	0.3	0.1	µg/L	25-May-07	EPA200.8	100132	
Chromium	0.3	0.3	µg/L	25-May-07	EPA200.8	100110	
Cobalt	0.6	0.1	µg/L	25-May-07	EPA200.8	100114	
Copper	1.6	0.1	µg/L	25-May-07	EPA200.8	100118	
Iron	53.6	50	µg/L	25-May-07	EPA200.8		
Lead	0.2	0.1	µg/L	25-May-07	EPA200.8	100146	
Manganese	18.2	0.1	µg/L	25-May-07	EPA200.8	100112	
Molybdenum	0.6	0.1	µg/L	25-May-07	EPA200.8	100152	
Nickel	3.5	0.1	µg/L	25-May-07	EPA200.8	100117	
Silver	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100131	
Strontium	1340	0.1	µg/L	25-May-07	EPA200.8	100128	

ReportDate: Sunday, May 27, 2007
Print Date: Sunday, May 27, 2007

Appendix B

Quality of Raw Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Metal 07-EU7

Taiga Sample ID: 003

Thallium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100140
Titanium	1.4	0.1	µg/L	25-May-07	EPA200.8	102642
Vanadium	0.3	0.1	µg/L	25-May-07	EPA200.8	100109
Zinc	< 10	10	µg/L	25-May-07	EPA200.8	100120

Subcontracted Metals

Silicon	2.51	0.05	mg/L	22-May-07	EPA200.8	
---------	------	------	------	-----------	----------	--

Appendix C Quality of Tap Water

EUREKA WATER ANALYSIS 2008-2010: TAP WATER

TAP WATER

GUIDELINES (mg/l)

Parameter	2007	2008	2009	2010	CANADIAN ¹		US EPA ²	
					MAC ³	OG ⁴ /AO ⁵	MCL ⁶	MCLG ⁷
TDS			524	1510				
Organic Carbon			1.5	1.8				
Hardness			112	26.7				
Coliforms, Total	<1.0	<1.0	<1.0	<1.0	0/100 ml		100/100ml	0
Escherichia coli	<1.0	<1.0	<1.0	<1.0	0/100 ml			0
Aluminum	0.0053	0.046	0.007			0.2	0.05-0.2	
Antimony		0.0002	<0.0001					
Arsenic		<0.0002	0.0003					
Barium	0.0165	0.0054	0.0027		1		2	2
Beryllium	<0.0001	<0.0001	<0.0001				0.004	
Boron	0.0992				5			
Cadmium	<0.00005	<0.0001	<0.00005		0.005		0.005	0.005
Cesium		<0.0001	<0.0001					
Chromium	0.0003	0.0002	0.0002		0.05		0.1	0.1
Cobalt	0.0001	<0.0001	<0.0001					
Copper	0.134	0.0652	0.371			<1.0		1.3
Iron	<0.050	0.101	0.012			<0.3	0.3	
Lead	0.0012	0.0001	0.0003		0.01		0.015	0
Lithium		0.0037	0.0317					
Manganese	0.0092	0.0036	0.0037			<0.05	0.05	
Molybdenum	0.0008	0.0002	0.0003					
Nickel	0.0015	0.0007	0.0024					
Rubidium		0.0004	0.0019					
Selenium		0.0005	0.0012					
Silver	<0.0001	<0.0001	<0.0001				0.1	
Strontium	0.28	0.0898	0.0393					
Thallium	<0.0001	<0.0001	<0.0001					
Titanium	0.0008	<0.0001	0.0004					
Uranium		0.0003	0.0009					
Vanadium	<0.0001	0.0002	<0.0001					
Zinc	0.109	0.047	0.0656			<5.0	5	
Silicon	0.0024							
Bromodichloromethane		0.01	0.006		0.016			
Bromoform		0.052	0.068					
Dibromochloromethane		0.027	0.026					
Trihalomethanes		0.092	0.101		0.1		0.08	

*Subcontracted organics are in concentrations less than detectable levels except for those listed immediately above

¹Guidelines for Canadian Drinking Water Quality Summary Table, May 2008

http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum_guide-res_recom/chemical-chimiques-eng.php#tbl6

²US Environmental Protection Agency Drinking Water Standards

<http://www.epa.gov/safewater/contaminants/index.html>

³Maximum Acceptable Concentration

⁴Aesthetic Objectives

⁵Operational Guidance Values

⁶Maximum Contaminant Level

⁷Maximum Contaminant Level Goal

Appendix C

Quality of Tap Water

TAP WATER QUALITY 2010



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT, X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUTAP0510

Taiga Sample ID: 003

Client Project:

Sample Type: Tap

Received Date: 06-May-10

Sampling Date: 06-May-10

Sampling Time: 6:30

Location: Lagoon/ReverseOsmosis/Tap

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifer
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	1510	10	mg /L	11-May-10	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	1.8	0.5	mg /L	08-May-10	SM5310:B	
<u>Major Ions</u>						
Hardness	26.7	0.7	mg /L	07-May-10	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
<u>Organics</u>						
Bromodichloromethane	0.006	0.005	mg /L	13-May-10	EPA8260B	
Bromoform	0.068	0.005	mg /L	13-May-10	EPA8260B	
Chloroform	< 0.005	0.005	mg /L	13-May-10	EPA8260B	
Dibromochloromethane	0.026	0.005	mg /L	13-May-10	EPA8260B	
Trihalomethanes, Total	0.101	0.005	mg /L	13-May-10	EPA8260B	

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 8 of 11

Appendix C

Quality of Tap Water



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUTAP0510

Taiga Sample ID: 003

Trace Metals, Total

Aluminum	7.0	0.6	µg/L	07-May-10	EPA200.8
Antimony	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Arsenic	0.3	0.2	µg/L	07-May-10	EPA200.8
Barium	2.7	0.1	µg/L	07-May-10	EPA200.8
Beryllium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Cadmium	< 0.05	0.05	µg/L	07-May-10	EPA200.8
Cesium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Chromium	0.2	0.1	µg/L	07-May-10	EPA200.8
Cobalt	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Copper	371	0.2	µg/L	07-May-10	EPA200.8
Iron	12	5	µg/L	07-May-10	EPA200.8
Lead	0.3	0.1	µg/L	07-May-10	EPA200.8
Lithium	31.7	0.2	µg/L	07-May-10	EPA200.8
Manganese	3.7	0.1	µg/L	07-May-10	EPA200.8
Molybdenum	0.3	0.1	µg/L	07-May-10	EPA200.8
Nickel	2.4	0.1	µg/L	07-May-10	EPA200.8
Rubidium	1.9	0.1	µg/L	07-May-10	EPA200.8
Selenium	1.2	0.3	µg/L	07-May-10	EPA200.8
Silver	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Strontium	39.3	0.1	µg/L	07-May-10	EPA200.8
Thallium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Titanium	0.4	0.1	µg/L	07-May-10	EPA200.8
Uranium	0.9	0.1	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 9 of 11

Appendix C

Quality of Tap Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUTAP0510

Taiga Sample ID: 003

Vanadium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Zinc	65.6	0.4	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010
Print Date: Friday, May 14, 2010

Page 10 of 11

Appendix C

Quality of Tap Water

TAP WATER QUALITY 2009



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUDW0709

Taiga Sample ID: 003

Client Project:
Sample Type: Drinking Water
Received Date: 09-Jul-09
Sampling Date: 09-Jul-09
Sampling Time: 7:30
Location:
Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	524	10	mg/L	15-Jul-09	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	1.5	0.5	mg/L	15-Jul-09	SM5310:B	
<u>Major Ions</u>						
Hardness	112	0.7	mg/L	10-Jul-09	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	09-Jul-09	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	09-Jul-09	SM9223:B	
<u>Organics</u>						
Bromodichloromethane	0.010	0.005	mg/L	13-Jul-09	EPA8260B	
Bromoform	0.052	0.005	mg/L	13-Jul-09	EPA8260B	
Chloroform	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Dibromochloromethane	0.027	0.005	mg/L	13-Jul-09	EPA8260B	
Trihalomethanes, Total	0.092	0.005	mg/L	13-Jul-09	EPA8260B	

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 8 of 14

Appendix C

Quality of Tap Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUDW0709

Taiga Sample ID: 003

Trace Metals, Total

Aluminum	46	5	µg/L	21-Jul-09	EPA200.8
Antimony	0.2	0.1	µg/L	21-Jul-09	EPA200.8
Arsenic	< 0.2	0.2	µg/L	21-Jul-09	EPA200.8
Barium	5.4	0.1	µg/L	21-Jul-09	EPA200.8
Beryllium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cadmium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cesium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Chromium	0.2	0.1	µg/L	21-Jul-09	EPA200.8
Cobalt	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Copper	65.2	0.2	µg/L	21-Jul-09	EPA200.8
Iron	101	5	µg/L	21-Jul-09	EPA200.8
Lead	0.1	0.1	µg/L	21-Jul-09	EPA200.8
Lithium	3.7	0.2	µg/L	21-Jul-09	EPA200.8
Manganese	3.6	0.1	µg/L	21-Jul-09	EPA200.8
Molybdenum	0.2	0.1	µg/L	21-Jul-09	EPA200.8
Nickel	0.7	0.1	µg/L	21-Jul-09	EPA200.8
Rubidium	0.4	0.1	µg/L	21-Jul-09	EPA200.8
Selenium	0.5	0.5	µg/L	21-Jul-09	EPA200.8
Silver	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Strontium	89.8	0.1	µg/L	21-Jul-09	EPA200.8
Thallium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Titanium	0.7	0.1	µg/L	21-Jul-09	EPA200.8
Uranium	0.3	0.1	µg/L	21-Jul-09	EPA200.8

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 9 of 14

Appendix C

Quality of Tap Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Water Tap Wx Office

Taiga Sample ID: 001

Client Project:
Sample Type: Unknown Water
Received Date: 10-Apr-08
Sampling Date: 10-Apr-08
Sampling Time: 7:30
Location:
Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
Microbiology						
Coliforms, Total	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
Trace Metals, Total						
Aluminum	5.3	0.6	µg/L	20-Apr-08	EPA200.8	
Barium	16.5	0.1	µg/L	20-Apr-08	EPA200.8	
Beryllium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Boron	99.2	0.9	µg/L	20-Apr-08	EPA200.8	
Cadmium	< 0.05	0.05	µg/L	20-Apr-08	EPA200.8	
Chromium	0.3	0.1	µg/L	20-Apr-08	EPA200.8	
Cobalt	0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Copper	134	0.3	µg/L	20-Apr-08	EPA200.8	
Iron	< 50	50	µg/L	20-Apr-08	EPA200.8	
Lead	1.2	0.1	µg/L	20-Apr-08	EPA200.8	
Manganese	9.2	0.1	µg/L	20-Apr-08	EPA200.8	

ReportDate: Wednesday, April 23, 2008
Print Date: Wednesday, April 23, 2008

Page 2 of 17

Appendix C

Quality of Tap Water



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: Water Tap Wx Office

Taiga Sample ID: 001

Molybdenum	0.8	0.1	µg/L	20-Apr-08	EPA200.8
Nickel	1.5	0.1	µg/L	20-Apr-08	EPA200.8
Silver	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Strontium	280	0.1	µg/L	20-Apr-08	EPA200.8
Thallium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Titanium	0.8	0.1	µg/L	20-Apr-08	EPA200.8
Vanadium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Zinc	109	0.4	µg/L	20-Apr-08	EPA200.8

Subcontracted Metals

Silicon	2.04	0.05	mg/L	17-Apr-08	SM3120B
---------	------	------	------	-----------	---------

Subcontracted Organics

1,1,1,2-Tetrachloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,1-Trichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,2,2-Tetrachloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,2-Trichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloropropene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichloropropane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trimethylbenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromo-3-Chloropropane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromoethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260


ReportDate: Wednesday, April 23, 2008
Print Date: Wednesday, April 23, 2008

Page 3 of 17

Appendix D Quantity of Drinking Water Consumed

Total Water Consumption

2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	
57.8	43.8	91.7	104.0	104.9	22.0	131.9	126.9	140.9	162.7		Jan
117.5	90.0	60.6	116.7	117.0	137.9	106.3	178.0	194.9	260.0		Feb
113.0	79.2	160.6	121.2	188.2	103.5	222.6	271.4	237.7	302.9		Mar
84.1	186.8	111.7	160.1	63.7	73.6	209.2	236.3	221.5	237.5		Apr
261.8	233.8	280.3	203.7	273.9	322.8	273.8	410.7	328.8	384.5		May
335.3	287.9	432.5	418.2	489.0	495.7	325.6	499.7	438.7	413.7		Jun
438.0	354.8	369.1	427.6	501.8	379.6	319.3	423.3	357.6	340.4		Jul
238.5	160.6	260.3	247.4	236.3	111.3	167.7	163.0	130.0	206.9		Aug
114.5	77.1	59.4	180.3	237.8	77.8	153.9	221.1	197.2	202.0		Sep
103.1	79.6	165.3	70.8	71.5	107.4	142.6	183.1	275.1	216.5		Oct
83.5	94.6	61.5	104.6	71.5	106.4	89.2	103.9	187.0	229.6		Nov
141.5	85.5	149.5	144.2	78.1	108.6	163.6	159.9	141.0	195.3		Dec
2088.6	1773.7	2202.5	2298.8	2433.7	2046.6	2305.7	2977.3	2850.4	3152.0	0.0	Total (cu M)
174.1	147.8	183.5	191.6	202.8	170.6	192.1	248.1	237.5	262.7	#DIV/0!	Monthly Avg

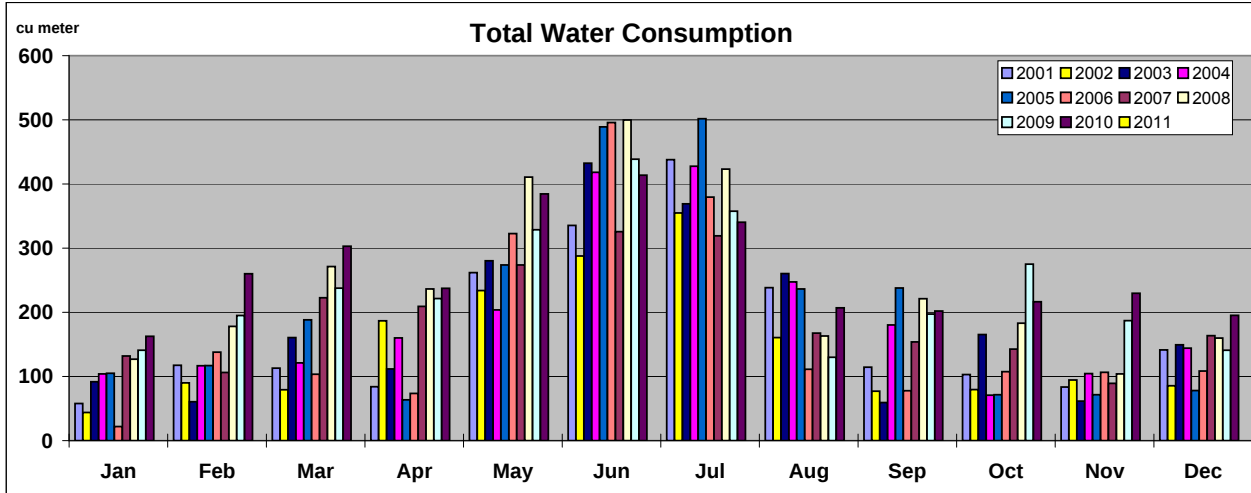

Appendix E Quality of Drinking Water Consumed

EUREKA WATER ANALYSIS 2007-2010: REVERSE OSMOSIS GUIDELINES (mg/l)

Parameter	REVERSE OSMOSIS WATER				CANADIAN ¹		US EPA ²	
	2007	2008	2009	2010	MAC ³	OG ⁴ /AO ⁵	MCL ⁶	MCLG ⁷
TSS			208	<10				
Organic Carbon	<0.5		0.5	<0.5				
Hardness	1.7		11.1	2.1				
Coliforms, Total		<1.0	<1.0	<1.0	0/100 ml		100/100ml	0
Escherichia coli		<1.0	<1.0	<1.0	0/100 ml			0
Aluminum	0.0009	0.0019	0.017	0.0012		0.2	0.05-0.2	
Antimony			<0.0001	<0.0001				
Arsenic			<0.0002	<0.0002				
Barium	<0.0001	0.0027	0.0022	0.0003	1		2	2
Beryllium	<0.0001	<0.0001	<0.0001	<0.0001			0.004	
Boron	0.149	0.0092			5			
Cadmium	<0.00005	<0.00005	<0.00005	0.00009	0.005		0.005	0.005
Cesium			<0.0001	<0.0001				
Chromium	<0.0001	0.001	<0.0001	0.0001	0.05		0.1	0.1
Cobalt	<0.0001	<0.0001	<0.0001	<0.0001				
Copper	0.0101	0.0297	0.0133	0.0096		<1.0		1.3
Iron	<0.050	<0.050	0.01	<0.050		<0.3	0.3	
Lead	0.0003	0.0057	0.0001	0.0007	0.01		0.015	0
Lithium			0.0009	0.0006				
Manganese	<0.0001	0.0001	0.0005	0.0002		<0.05	0.05	
Molybdenum	<0.0001	0.0003	<0.0001	0.0002				
Nickel	0.0034	0.0013	0.0016	0.0005				
Rubidium			<0.0001	<0.0001				
Selenium			0.0003	<0.0003				
Silver	<0.0001	0.0001	<0.0001	<0.0001			0.1	
Strontium	0.0004	0.0007	0.0072	0.0022				
Thallium	<0.0001	<0.0001	<0.0001	<0.0001				
Titanium	<0.0001	<0.0001	0.0003	0.0001				
Uranium			<0.0001	<0.0001				
Vanadium	<0.0001	<0.0001	<0.0001	0.0001				
Zinc	0.413	0.819	0.0588	0.07		<5.0	5	
Silicon	0.00007							
*Bromodichloromethane			<0.005	<0.005	0.016			
Bromoform			<0.005	0.01				
Dibromochloromethane			<0.005	0.008				
Trihalomethanes			<0.005	0.024	0.1		0.08	

*Subcontracted organics are in concentrations less than detectable levels except for those listed immediately above

¹Guidelines for Canadian Drinking Water Quality Summary Table, May 2008

http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum_guide-res_recom/chemical-chimiques-eng.php#tbl6

²US Environmental Protection Agency Drinking Water Standards

<http://www.epa.gov/safewater/contaminants/index.html>

³Maximum Acceptable Concentration

⁴Aesthetic Objectives

⁵Operational Guidance Values

⁶Maximum Contaminant Level

⁷Maximum Contaminant Level Goal

Appendix E
Quality of Drinking Water Consumed

REVERSE OSMOSIS WATER QUALITY 2010



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EURO0510

Taiga Sample ID: 002

Client Project:

Sample Type: Reverse Osmosis

Received Date: 06-May-10

Sampling Date: 06-May-10

Sampling Time: 6:30

Location: Lagoon/ReverseOsmosis/Tap

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	< 10	10	mg /L	11-May-10	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	< 0.5	0.5	mg /L	08-May-10	SM5310:B	
<u>Major Ions</u>						
Hardness	2.1	0.7	mg /L	07-May-10	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	06-May-10	SM9223:B	
<u>Organics</u>						
Bromodichloromethane	< 0.005	0.005	mg /L	13-May-10	EPA8260B	
Bromoform	0.010	0.005	mg /L	13-May-10	EPA8260B	
Chloroform	< 0.005	0.005	mg /L	13-May-10	EPA8260B	
Dibromochloromethane	0.008	0.005	mg /L	13-May-10	EPA8260B	
Trihalomethanes, Total	0.024	0.005	mg /L	13-May-10	EPA8260B	

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 5 of 11

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EURO0510

Taiga Sample ID: 002

Trace Metals, Total

Aluminum	1.2	0.6	µg/L	07-May-10	EPA200.8
Antimony	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Arsenic	< 0.2	0.2	µg/L	07-May-10	EPA200.8
Barium	0.3	0.1	µg/L	07-May-10	EPA200.8
Beryllium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Cadmium	0.09	0.05	µg/L	07-May-10	EPA200.8
Cesium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Chromium	0.1	0.1	µg/L	07-May-10	EPA200.8
Cobalt	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Copper	9.6	0.2	µg/L	07-May-10	EPA200.8
Iron	< 5	5	µg/L	07-May-10	EPA200.8
Lead	0.7	0.1	µg/L	07-May-10	EPA200.8
Lithium	0.6	0.2	µg/L	07-May-10	EPA200.8
Manganese	0.2	0.1	µg/L	07-May-10	EPA200.8
Molybdenum	0.2	0.1	µg/L	07-May-10	EPA200.8
Nickel	0.5	0.1	µg/L	07-May-10	EPA200.8
Rubidium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Selenium	< 0.3	0.3	µg/L	07-May-10	EPA200.8
Silver	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Strontium	2.2	0.1	µg/L	07-May-10	EPA200.8
Thallium	< 0.1	0.1	µg/L	07-May-10	EPA200.8
Titanium	0.1	0.1	µg/L	07-May-10	EPA200.8
Uranium	< 0.1	0.1	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010

Print Date: Friday, May 14, 2010

Page 6 of 11

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100186

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EURO0510

Taiga Sample ID: 002

Vanadium	0.1	0.1	µg/L	07-May-10	EPA200.8
Zinc	70.0	0.4	µg/L	07-May-10	EPA200.8

Report Date: Friday, May 14, 2010
Print Date: Friday, May 14, 2010

Page 7 of 11

Appendix E
Quality of Drinking Water Consumed

REVERSE OSMOSIS WATER QUALITY 2009



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- FINAL REPORT -

Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:


Angelique Ruzindana
Quality Assurance Officer

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 1 of 8

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUOW0709

Taiga Sample ID: 002

Client Project:
Sample Type: Freshwater
Received Date: 09-Jul-09
Sampling Date: 09-Jul-09
Sampling Time: 7:30

Location:

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Solids, Total Dissolved	208	10	mg/L	15-Jul-09	SM2540:C	
<u>Inorganics - Nutrients</u>						
Organic Carbon, Total	0.5	0.5	mg/L	15-Jul-09	SM5310:B	
<u>Major Ions</u>						
Hardness	11.1	0.7	mg/L	10-Jul-09	SM2340:B	
<u>Microbiology</u>						
Coliforms, Total	< 1.0	1.0	MPN/100mL	09-Jul-09	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	09-Jul-09	SM9223:B	
<u>Organics</u>						
Bromodichloromethane	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Bromoform	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Chloroform	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Dibromochloromethane	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	
Trihalomethanes, Total	< 0.005	0.005	mg/L	13-Jul-09	EPA8260B	

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 5 of 14

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUOW0709

Taiga Sample ID: 002

Trace Metals, Total

Aluminum	17.0	0.6	µg/L	21-Jul-09	EPA200.8
Antimony	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Arsenic	< 0.2	0.2	µg/L	21-Jul-09	EPA200.8
Barium	2.2	0.1	µg/L	21-Jul-09	EPA200.8
Beryllium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cadmium	< 0.05	0.05	µg/L	21-Jul-09	EPA200.8
Cesium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Chromium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cobalt	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Copper	13.3	0.2	µg/L	21-Jul-09	EPA200.8
Iron	10	5	µg/L	21-Jul-09	EPA200.8
Lead	0.1	0.1	µg/L	21-Jul-09	EPA200.8
Lithium	0.9	0.2	µg/L	21-Jul-09	EPA200.8
Manganese	0.5	0.1	µg/L	21-Jul-09	EPA200.8
Molybdenum	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Nickel	1.6	0.1	µg/L	21-Jul-09	EPA200.8
Rubidium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Selenium	< 0.3	0.3	µg/L	21-Jul-09	EPA200.8
Silver	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Strontium	7.2	0.1	µg/L	21-Jul-09	EPA200.8
Thallium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Titanium	0.3	0.1	µg/L	21-Jul-09	EPA200.8
Uranium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 6 of 14

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290373

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUOW0709

Taiga Sample ID: 002

Vanadium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Zinc	55.8	0.4	µg/L	21-Jul-09	EPA200.8

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 7 of 14

Appendix E
Quality of Drinking Water Consumed

REVERSE OSMOSIS WATER QUALITY 2008



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- FINAL REPORT -

Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:



Helene Harper
A/Laboratory Manager

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

ReportDate: Wednesday, April 23, 2008
Print Date: Wednesday, April 23, 2008

Page 1 of 17

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: R.O. Tap Wx Office

Taiga Sample ID: 002

Client Project:
Sample Type: Unknown Water
Received Date: 10-Apr-08
Sampling Date: 10-Apr-08
Sampling Time: 7:30

Location:

Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
Microbiology						
Coliforms, Total	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
Escherichia coli	< 1.0	1.0	MPN/100mL	10-Apr-08	SM9223:B	
Trace Metals, Total						
Aluminum	1.9	0.6	µg/L	20-Apr-08	EPA200.8	
Barium	2.7	0.1	µg/L	20-Apr-08	EPA200.8	
Beryllium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Boron	92.0	0.9	µg/L	20-Apr-08	EPA200.8	
Cadmium	< 0.05	0.05	µg/L	20-Apr-08	EPA200.8	
Chromium	1.0	0.1	µg/L	20-Apr-08	EPA200.8	
Cobalt	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Copper	29.7	0.3	µg/L	20-Apr-08	EPA200.8	
Iron	< 50	50	µg/L	20-Apr-08	EPA200.8	
Lead	5.7	0.1	µg/L	20-Apr-08	EPA200.8	
Manganese	0.1	0.1	µg/L	20-Apr-08	EPA200.8	
Molybdenum	0.3	0.1	µg/L	20-Apr-08	EPA200.8	

ReportDate: Wednesday, April 23, 2008
Print Date: Wednesday, April 23, 2008

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280148

- CERTIFICATE OF ANALYSIS -

Client Sample ID: R.O. Tap Wx Office

Taiga Sample ID: 002

Nickel	1.3	0.1	µg/L	20-Apr-08	EPA200.8
Silver	0.1	0.1	µg/L	20-Apr-08	EPA200.8
Strontium	0.7	0.1	µg/L	20-Apr-08	EPA200.8
Thallium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Titanium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Vanadium	< 0.1	0.1	µg/L	20-Apr-08	EPA200.8
Zinc	819	0.4	µg/L	20-Apr-08	EPA200.8

Subcontracted Metals

Silicon	< 0.05	0.05	mg/L	17-Apr-08	SM3120B
---------	--------	------	------	-----------	---------

Subcontracted Organics

1,1,1,2-Tetrachloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,1-Trichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,2,2-Tetrachloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1,2-Trichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,1-Dichloropropene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,3-Trichloropropane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2,4-Trimethylbenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromo-3-Chloropropane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dibromoethane	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dichlorobenzene	< 1	1	ug/L	17-Apr-08	EPA8260
1,2-Dichloroethane	< 1	1	ug/L	17-Apr-08	EPA8260

ReportDate: Wednesday, April 23, 2008

Print Date: Wednesday, April 23, 2008

Page 8 of 17

Appendix E
Quality of Drinking Water Consumed

REVERSE OSMOSIS WATER QUALITY 2007



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: TOC 07-EU6

Taiga Sample ID: 005

Client Project:

Sample Type: Reverse osmosis

Received Date: 15-May-07

Sampling Date: 15-May-07

Sampling Time: 6:00

Location: RO TAP Wx OFFICE

Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifer
<u>Inorganics - Nutrients</u>							
Organic Carbon, Total	< 0.5	0.5	mg/L	22-May-07	SM5310:B		
<u>Major Ions</u>							
Hardness	1.7	0.7	mg/L	22-May-07	SM2340:B	010602	

ReportDate: Sunday, May 27, 2007
Print Date: Sunday, May 27, 2007

Page 13 of 23

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: METAL 07-EU9

Taiga Sample ID: 006

Client Project:
Sample Type: Reverse osmosis
Received Date: 15-May-07
Sampling Date: 15-May-07
Sampling Time: 6:00
Location: RO TAP Wx OFFICE
Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifier
<u>Trace Metals, Total</u>							
Aluminum	0.9	0.6	µg/L	25-May-07	EPA200.8	100107	
Barium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100139	
Beryllium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100105	
Boron	149	0.9	µg/L	25-May-07	EPA200.8		
Cadmium	< 0.05	0.05	µg/L	25-May-07	EPA200.8	100132	
Chromium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100110	
Cobalt	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100114	
Copper	10.1	0.1	µg/L	25-May-07	EPA200.8	100118	
Iron	< 50.0	50	µg/L	25-May-07	EPA200.8		
Lead	0.3	0.1	µg/L	25-May-07	EPA200.8	100146	
Manganese	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100112	
Molybdenum	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100152	
Nickel	3.4	0.1	µg/L	25-May-07	EPA200.8	100117	
Silver	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100131	
Strontium	0.4	0.1	µg/L	25-May-07	EPA200.8	100128	

ReportDate: Sunday, May 27, 2007
Print Date: Sunday, May 27, 2007

Appendix E

Quality of Drinking Water Consumed



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270218

- CERTIFICATE OF ANALYSIS -

Client Sample ID: METAL 07-EU9

Taiga Sample ID: 006

Thallium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100140
Titanium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	102642
Vanadium	< 0.1	0.1	µg/L	25-May-07	EPA200.8	100109
Zinc	413	0.4	µg/L	25-May-07	EPA200.8	100120

Subcontracted Metals

Silicon	0.07	0.05	mg/L	22-May-07	EPA200.8
---------	------	------	------	-----------	----------

Report Date: Sunday, May 27, 2007
Print Date: Sunday, May 27, 2007

Page 15 of 23

Appendix F

Quantity of Waste Water Discharged

QUANTITIES OF WASTE WATER DISCHARGED

Eureka 2010

Fresh Water: Fresh Water Lagoon

1. 1 pump capacity: Monarch Pump Model TT30 Type E ~ 280 gal/min
2. Pump time*: 20 hours x 60 min x 280 gal/min = ~ 336,000gal or ~ 1527m³

*Discharge commenced on July 6th, 2010 and ended on July 8th, 2010

Appendix G

Quality of Waste Water Discharged

ANALYSIS OF EUREKA SEWAGE PARAMETERS

Wastewater effluent at Eureka is governed by two guidelines: CCME's Canada-wide Strategy for the Management of Municipal Wastewater Effluent, 2009; and Guidelines for the Discharge of Municipal Wastewater in the Northwest Territories (NWT), 1992. The CCME guidelines address municipal wastewater facilities (owned by municipalities, communities, federal and other government entities, and facilities on federal and aboriginal lands) discharging effluent into surface water, including combined and sanitary sewer overflows. The NWT guidelines are also applicable to the Eureka lagoon. Under Eureka's water licence with the Nunavut Water Board, the NWT guidelines are referenced as the criteria to be used to assess compliance.

The Eureka wastewater lagoon effluent was sampled in 2007, 2008, 2009, and 2010 to determine the level of compliance with CCME and NWT guidelines for wastewater (Table 1). This report discusses each exceeding parameter over the 3-year period, potential causes of exceedance, and identifies corrective solutions if applicable.

Effluent exceedances and possible causes

1. Total suspended solids (TSS)

Effluent total suspended solids averaged approximately 145 mg/L in 2010 which is above Territorial guidelines. The elevated levels could be caused by¹:

- a. Suspended bacterial solids¹;
- b. Algae growth. Indicators of algae growth are as follows:
 - i. Biological demand (BOD) > 30mg/L (Eureka is consistently above this level)
 - ii. pH > 9 (Eureka is consistently above this level)
 - iii. TSS/BOD ratio > 2 (Eureka is consistently above this level)
- c. Silt, clay, cell debris, and bottom solids suspended from lagoon pumping.

2. pH

Ph results averaged 9.61 in 2010. This result exceeds the NWB license guidelines. High pH values are typically caused by excessive algae growth¹.

3. Iron (Fe)

Effluent iron averaged 0.255 mg/L which is within Territorial guidelines. The possible sources of iron (Fe) are²:

- a. Natural sources (land, water)
- b. Iron sediments or deposits in the lagoon which are being dissolved; and
- c. Industrial processes (either onsite or from DND) which are producing Fe waste streams.

¹Richard, Michael. Microbiological and Chemical Testing for Troubleshooting lagoons.2003

Appendix G

Quality of Waste Water Discharged

4. Manganese (Mn)

Manganese has been found at levels averaging 0.054 mg/L which is also above Territorial guidelines. Possible sources of manganese include³:

- a. Natural sources (soils, rocks, and water). Manganese can be found naturally in water in levels as high as 1.0mg/L. Manganese and iron are often found together in water.;
- b. Sources of pollution rich in organic matter (e.g. runoff from landfills, compost, brush or silage piles, or chemicals such as gasoline) can add to the background level by increasing manganese release from soil or bedrock into the surface water.

Next steps for elevated parameters

1. TSS, pH, iron, manganese

For all of these parameters, it is critical to identify the causes of elevated levels before identifying possible solutions. The following steps are proposed for the 2011 season:

- a. Collect and analyze the undisturbed effluent (before pumping) in the lagoon to determine TSS, Fe, and Mn concentration. The previous results may be elevated by sediments and are therefore not an accurate reflection of actual wastewater conditions.
- b. Collect and analyze waste samples before they reach the lagoon to determine TSS, Fe, and Mn concentrations as levels may be a result of natural systems or other pollution sources.
- c. Suspend the foot valve of the pumping system above the bottom sediments to limit contamination of effluent from bottom sediments. This practice may be particularly detrimental to TSS concentrations.
- d. Analyze the effluent TSS to determine if the nature of the particles are:
 - i. Sludge
 - ii. Filamentous bacteria
 - iii. Sulphur bacteria
 - iv. Algae

Additional Parameters for Analysis

The additional parameters to be analyzed as per the Nunavut Water Board recommendations include Sulphate (SO₄ Individual Anion), all the Major Cations, Ammonia – N, and Visible Oil & Grease.


²Tillman, Glenn. Wastewater Treatment: Troubleshooting and Problem Solving.

³Connecticut Department of Public Health. Fact Sheet: Manganese in Drinking Water. 2001


Appendix G

Quality of Waste Water Discharged

BOD Results for Eureka Wastewater Lagoon Effluent

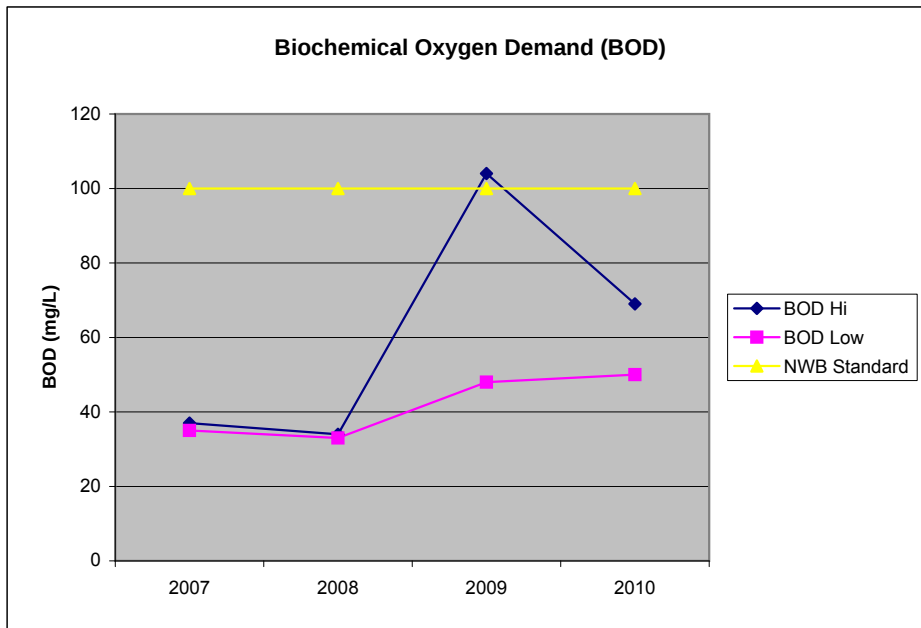


TSS Results for Eureka Wastewater Lagoon Effluent

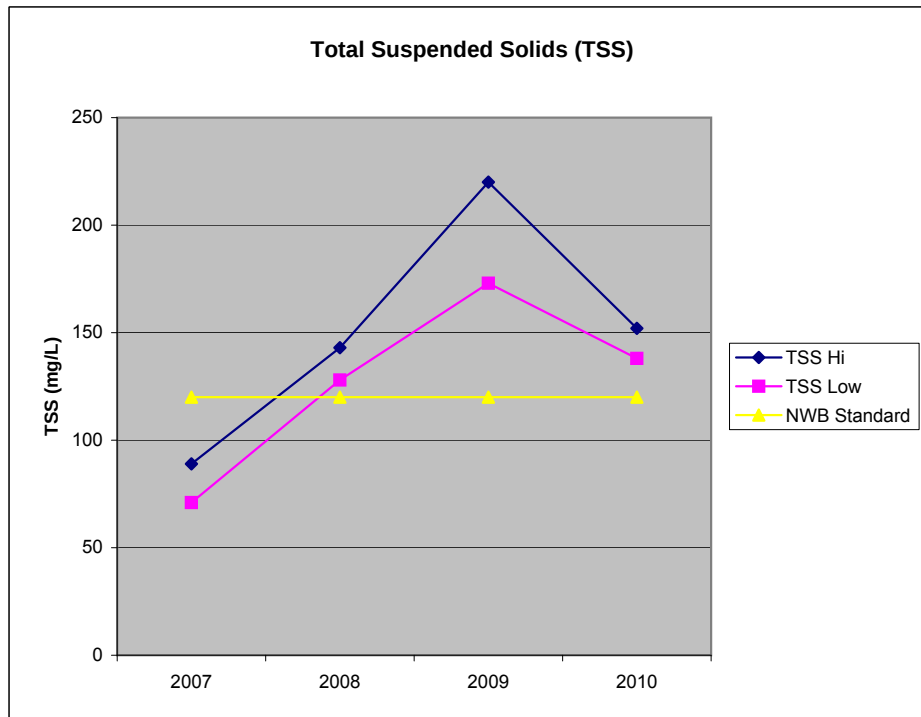

Appendix G

Quality of Waste Water Discharged

pH Results for Eureka Wastewater Lagoon Effluent

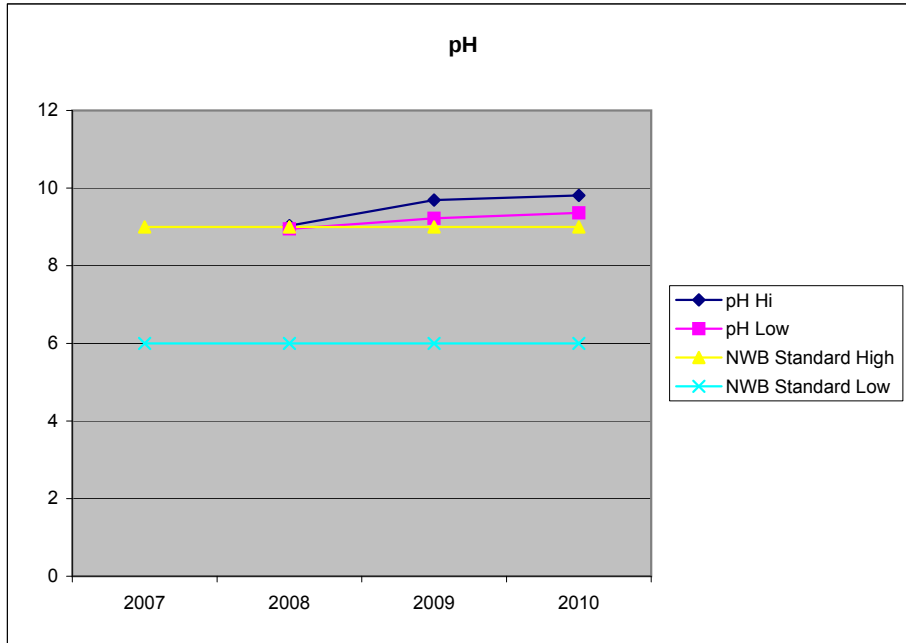


Phosphorous Results for Eureka Wastewater Lagoon Effluent




Appendix G

Quality of Waste Water Discharged

Iron Results for Eureka Wastewater Lagoon Effluent

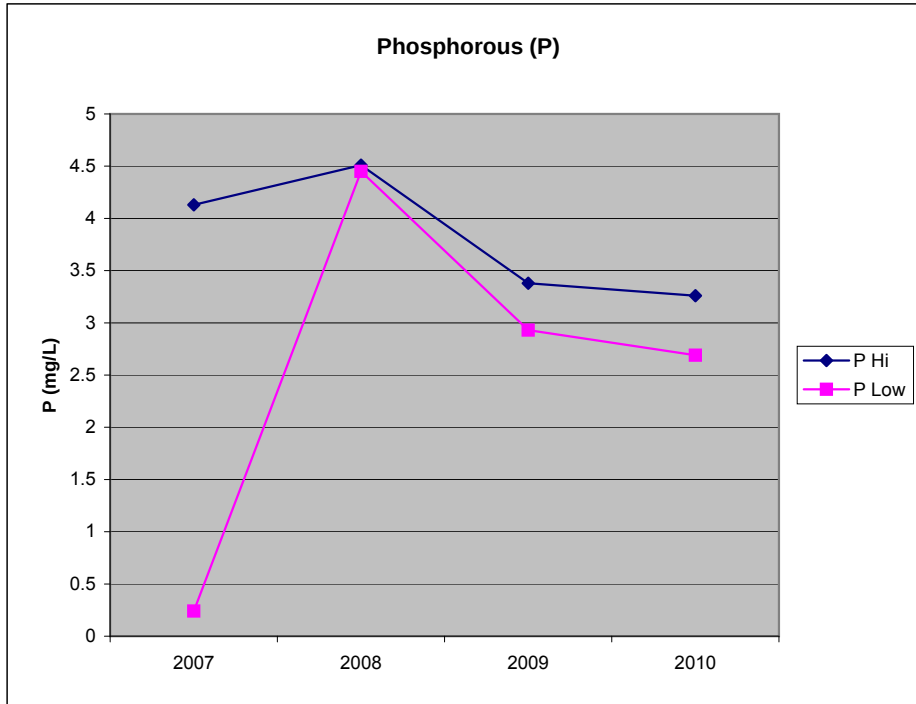


Manganese Results for Eureka Wastewater Lagoon Effluent

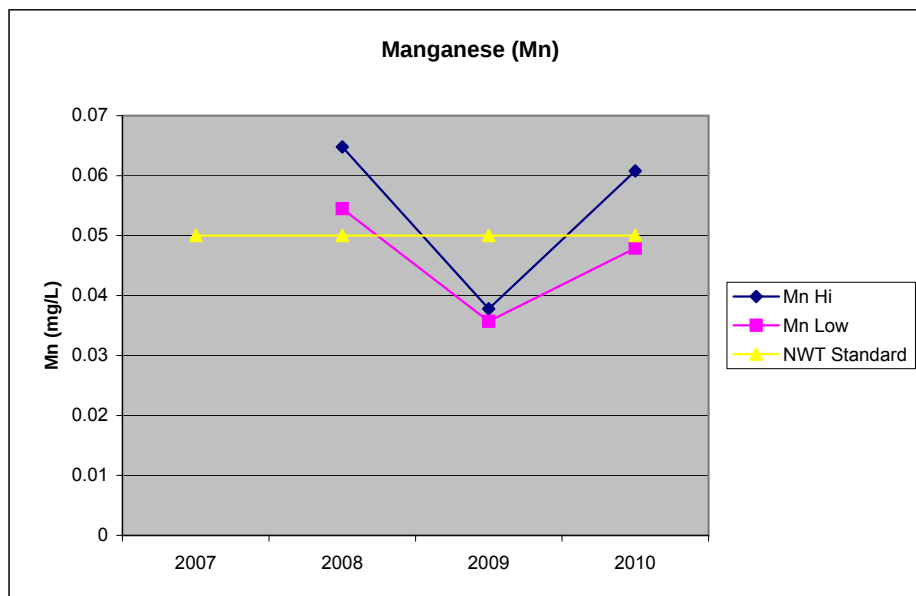

Appendix G


Quality of Waste Water Discharged

Total Coliform Results for Eureka Wastewater Lagoon Effluent

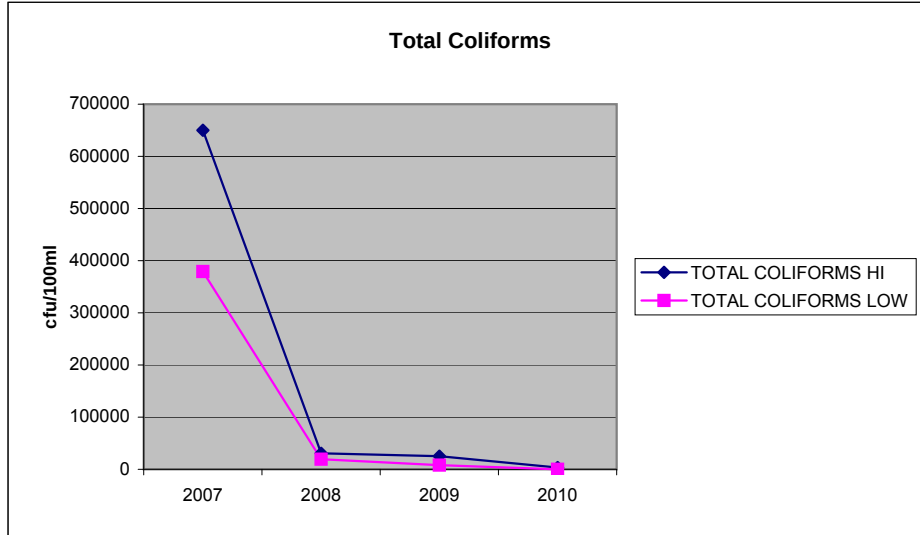

Note: cfu = colony forming units

Fecal Coliform Results for Eureka Wastewater Lagoon Effluent

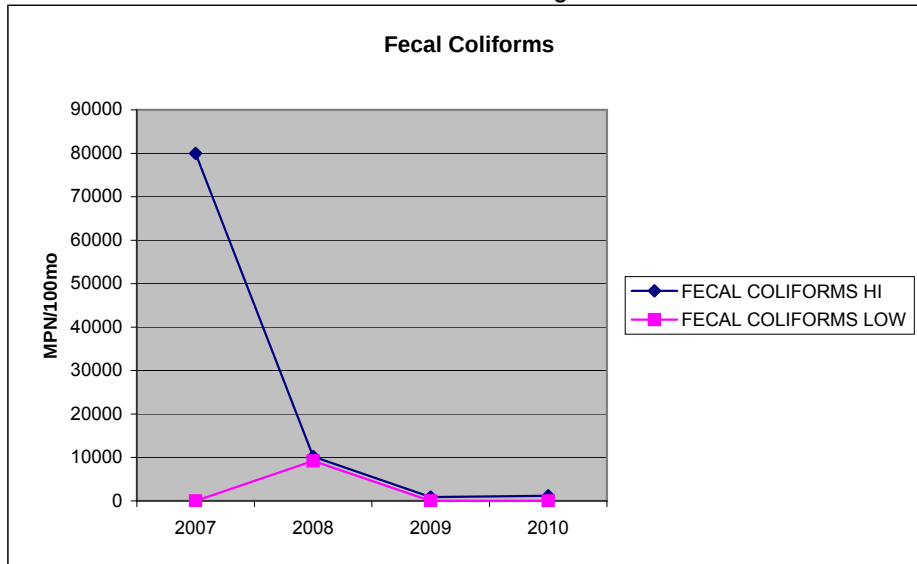


Note: MPN = Most Probable Number

Appendix G


Quality of Waste Water Discharged

Total Coliform Results for Eureka Wastewater Lagoon Effluent

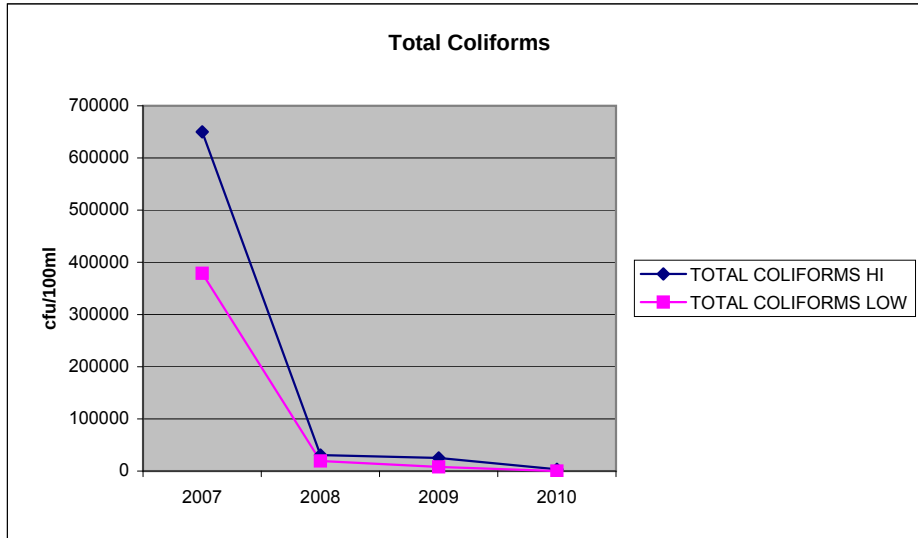

Note: cfu = colony forming units

Fecal Coliform Results for Eureka Wastewater Lagoon Effluent

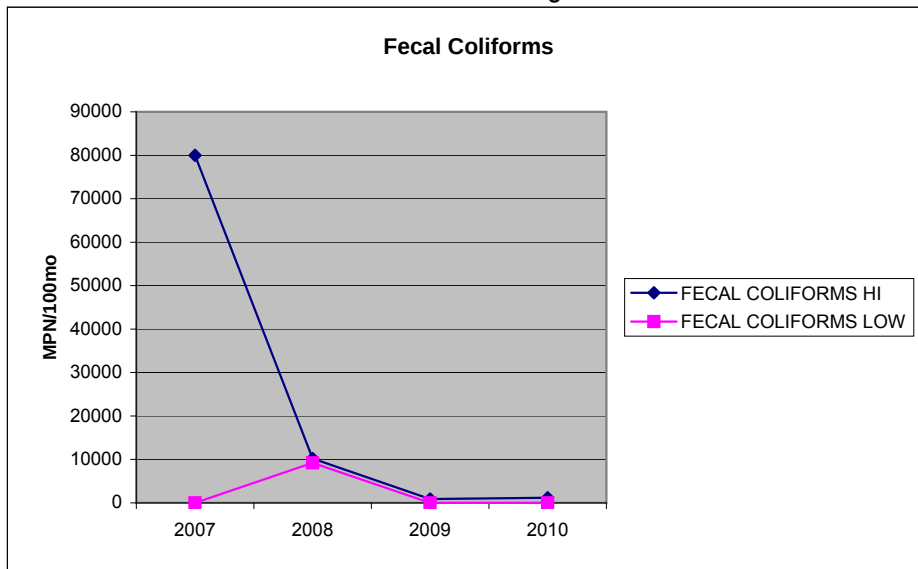

Note: MPN = Most Probable Number

Appendix G
Quality of Waste Water Discharged

EUREKA SEWAGE LAGOON: ANALYSIS RESULTS: 2010



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- FINAL REPORT -

Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attr: John MacIver

Facsimile:

Final report has been reviewed and approved by:

Helen Harper _____

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association for Laboratory Accreditation Inc. (CALA) as a testing laboratory for specific tests registered with CALA.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

Report Date: Tuesday, July 27, 2010
Print Date: Tuesday, July 27, 2010

Page 1 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT, X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-10

Taiga Sample ID: 001

Client Project:

Sample Type: wastewater 1/3

Received Date: 08-Jul-10

Sampling Date: 07-Jul-10

Sampling Time: 16:50

Location: Eureka Sewage Lagoon

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	4470	0.4	µS/cm	08-Jul-10	SM2510:B	
pH	9.81		pH units	08-Jul-10	SM4500-H:B	
Solids, Total Suspended	152	3	mg/L	12-Jul-10	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	50	2	mg/L	08-Jul-10	SM5210:B	6
Nitrate+Nitrite as Nitrogen	0.78	0.01	mg/L	09-Jul-10	SM4110:B	
Phosphorous, Total	2.69	0.01	mg/L	25-Jul-10	SM4500-P:D	
<u>Microbiology</u>						
Coliforms, Fecal	< 10	10	CFU/100mL	08-Jul-10	SM9222:D	68 6
Coliforms, Total	20.0	10.0	MPN/100mL	08-Jul-10	SM9223:B	6
<u>Organics</u>						
Hexane Extractable Material	10.2	2.0	mg/L	14-Jul-10	EPA1664A	
<u>Trace Metals, Total</u>						
Aluminum	69	5	µg/L	13-Jul-10	EPA200.8	

Report Date: Tuesday, July 27, 2010

Print Date: Tuesday, July 27, 2010

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-10

Taiga Sample ID: 001

Antimony	0.9	0.1	µg/L	13-Jul-10	EPA200.8
Arsenic	1.0	0.2	µg/L	13-Jul-10	EPA200.8
Barium	20.4	0.1	µg/L	13-Jul-10	EPA200.8
Beryllium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Cadmium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Cesium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Chromium	1.7	0.1	µg/L	13-Jul-10	EPA200.8
Cobalt	0.5	0.1	µg/L	13-Jul-10	EPA200.8
Copper	41.2	0.2	µg/L	13-Jul-10	EPA200.8
Iron	224	5	µg/L	13-Jul-10	EPA200.8
Lead	0.9	0.1	µg/L	13-Jul-10	EPA200.8
Lithium	16.8	0.2	µg/L	13-Jul-10	EPA200.8
Manganese	47.9	0.1	µg/L	13-Jul-10	EPA200.8
Molybdenum	0.3	0.1	µg/L	13-Jul-10	EPA200.8
Nickel	3.8	0.1	µg/L	13-Jul-10	EPA200.8
Rubidium	9.2	0.1	µg/L	13-Jul-10	EPA200.8
Selenium	0.8	0.5	µg/L	13-Jul-10	EPA200.8
Silver	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Strontium	423	0.1	µg/L	13-Jul-10	EPA200.8
Thallium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Titanium	1.2	0.1	µg/L	13-Jul-10	EPA200.8
Uranium	0.5	0.1	µg/L	13-Jul-10	EPA200.8
Vanadium	0.8	0.1	µg/L	13-Jul-10	EPA200.8
Zinc	67	5	µg/L	13-Jul-10	EPA200.8

Report Date: Tuesday, July 27, 2010

Page 3 of 8

Print Date: Tuesday, July 27, 2010

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT . X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-10

Taiga Sample ID: 001

Subcontracted Organics

Phenols, Total	0.001	0.001	mg/L	16-Jul-10	APHA 5530D
----------------	-------	-------	------	-----------	------------

Subcontracted Nutrients

Kjeldahl Nitrogen, Total	12.5	0.06	mg/L	14-Jul-10	ISO 11905-2
--------------------------	------	------	------	-----------	-------------

Report Date: Tuesday, July 27, 2010

Print Date: Tuesday, July 27, 2010

Page 4 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-10

Taiga Sample ID: 002

Client Project:

Sample Type: wastewater 2/3

Received Date: 08-Jul-10

Sampling Date: 08-Jul-10

Sampling Time: 6:45

Location: Eureka Sewage Lagoon

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	4750	0.4	µS/cm	08-Jul-10	SM2510:B	
pH	9.36		pH units	08-Jul-10	SM4500-H:B	
Solids, Total Suspended	138	3	mg/L	12-Jul-10	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	69	2	mg/L	08-Jul-10	SM5210:B	4
Nitrate+Nitrite as Nitrogen	0.62	0.01	mg/L	09-Jul-10	SM4110:B	
Phosphorous, Total	3.26	0.01	mg/L	25-Jul-10	SM4500-P:D	
<u>Microbiology</u>						
Coliforms, Fecal	1170	10	CFU/100mL	08-Jul-10	SM9222:D	6
Coliforms, Total	3260	10.0	MPN/100mL	08-Jul-10	SM9223:B	6
<u>Organics</u>						
Hexane Extractable Material	10.3	2.0	mg/L	14-Jul-10	EPA1664A	
<u>Trace Metals, Total</u>						
Aluminum	71	5	µg/L	13-Jul-10	EPA200.8	

Report Date: Tuesday, July 27, 2010

Print Date: Tuesday, July 27, 2010

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
 4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
 Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-10

Taiga Sample ID: 002

Antimony	0.8	0.1	µg/L	13-Jul-10	EPA200.8
Arsenic	1.1	0.2	µg/L	13-Jul-10	EPA200.8
Barium	20.3	0.1	µg/L	13-Jul-10	EPA200.8
Beryllium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Cadmium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Cesium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Chromium	2.1	0.1	µg/L	13-Jul-10	EPA200.8
Cobalt	0.5	0.1	µg/L	13-Jul-10	EPA200.8
Copper	41.2	0.2	µg/L	13-Jul-10	EPA200.8
Iron	286	5	µg/L	13-Jul-10	EPA200.8
Lead	1.0	0.1	µg/L	13-Jul-10	EPA200.8
Lithium	16.4	0.2	µg/L	13-Jul-10	EPA200.8
Manganese	60.8	0.1	µg/L	13-Jul-10	EPA200.8
Molybdenum	0.3	0.1	µg/L	13-Jul-10	EPA200.8
Nickel	4.1	0.1	µg/L	13-Jul-10	EPA200.8
Rubidium	9.6	0.1	µg/L	13-Jul-10	EPA200.8
Selenium	0.7	0.5	µg/L	13-Jul-10	EPA200.8
Silver	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Strontium	417	0.1	µg/L	13-Jul-10	EPA200.8
Thallium	< 0.1	0.1	µg/L	13-Jul-10	EPA200.8
Titanium	1.1	0.1	µg/L	13-Jul-10	EPA200.8
Uranium	0.5	0.1	µg/L	13-Jul-10	EPA200.8
Vanadium	0.9	0.1	µg/L	13-Jul-10	EPA200.8
Zinc	64	5	µg/L	13-Jul-10	EPA200.8

Report Date: Tuesday, July 27, 2010

Page 6 of 8

Print Date: Tuesday, July 27, 2010

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-10

Taiga Sample ID: 002

Subcontracted Organics

Phenols, Total	0.004	0.001	mg/L	16-Jul-10	APHA 5530D
----------------	-------	-------	------	-----------	------------

Subcontracted Nutrients

Kjeldahl Nitrogen, Total	16.1	0.06	mg/L	14-Jul-10	ISO 11905-2
--------------------------	------	------	------	-----------	-------------

Report Date: Tuesday, July 27, 2010

Print Date: Tuesday, July 27, 2010

Page 7 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
100358

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-10

Taiga Sample ID: 002

- DATA QUALIFIERS -

Data Qualifier Descriptions:

- 4 *Sample preserved only upon receipt at lab*
- 6 *Sample received above the recommended temperature*
- 68 *Unable to repeat analysis at lower dilution. Holding time exceeded.*

* Taiga analytical methods are based on the following standard analytical methods

SM - Standard Methods for the Examination of Water and Wastewater

EPA - United States Environmental Protection Agency

Report Date: Tuesday, July 27, 2010

Print Date: Tuesday, July 27, 2010

Page 8 of 8

Appendix G
Quality of Waste Water Discharged

EUREKA SEWAGE LAGOON: ANALYSIS RESULTS: 2009



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- FINAL REPORT -

Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:


Angelique Ruzindana
Quality Assurance Officer

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 1 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 001

Client Project:
Sample Type: wastewater 1/3
Received Date: 09-Jul-09
Sampling Date: 08-Jul-09
Sampling Time: 16:00
Location: Eureka Sewage Lagoon
Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifer
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	6140	0.4	µS/cm	10-Jul-09	SM2510:B	
pH	9.22		pH units	10-Jul-09	SM4500-H:B	
Solids, Total Suspended	173	3	mg/L	14-Jul-09	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	104	2	mg/L	10-Jul-09	SM5210:B	
Nitrate+Nitrite as Nitrogen	0.02	0.01	mg/L	14-Jul-09	SM4110:B	
Phosphorous, Total	3.38	0.01	mg/L	21-Jul-09	SM4500-P:D	
<u>Subcontracted Nutrients</u>						
Kjeldahl Nitrogen, Total	34.9	0.06	mg/L	14-Jul-09	ISO 11905-2	
<u>Microbiology</u>						
Coliforms, Fecal	900	100	CFU/100mL	09-Jul-09	SM9222:D	
Coliforms, Total	25100	100	MPN/100mL	09-Jul-09	SM9223:B	
<u>Organics</u>						
Hexane Extractable Material	4.5	2.0	mg/L	22-Jul-09	EPA1664A	

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 2 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 001

Trace Metals, Total

Aluminum	20	5	µg/L	21-Jul-09	EPA200.8
Antimony	0.9	0.1	µg/L	21-Jul-09	EPA200.8
Arsenic	0.7	0.2	µg/L	21-Jul-09	EPA200.8
Barium	28.5	0.1	µg/L	21-Jul-09	EPA200.8
Beryllium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cadmium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cesium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Chromium	1.0	0.1	µg/L	21-Jul-09	EPA200.8
Cobalt	0.4	0.1	µg/L	21-Jul-09	EPA200.8
Copper	41.9	0.2	µg/L	21-Jul-09	EPA200.8
Iron	138	5	µg/L	21-Jul-09	EPA200.8
Lead	0.5	0.1	µg/L	21-Jul-09	EPA200.8
Lithium	28.6	0.2	µg/L	21-Jul-09	EPA200.8
Manganese	37.8	0.1	µg/L	21-Jul-09	EPA200.8
Molybdenum	0.5	0.1	µg/L	21-Jul-09	EPA200.8
Nickel	5.0	0.1	µg/L	21-Jul-09	EPA200.8
Rubidium	11.1	0.1	µg/L	21-Jul-09	EPA200.8
Selenium	1.5	0.5	µg/L	21-Jul-09	EPA200.8
Silver	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Strontium	862	0.1	µg/L	21-Jul-09	EPA200.8
Thallium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Titanium	0.4	0.1	µg/L	21-Jul-09	EPA200.8
Uranium	0.7	0.1	µg/L	21-Jul-09	EPA200.8

ReportDate: Thursday, July 23, 2009
Print Date: Thursday, July 23, 2009

Page 3 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 001

Vanadium	0.3	0.1	µg/L	21-Jul-09	EPA200.8
Zinc	50	5	µg/L	21-Jul-09	EPA200.8

Subcontracted Organics

Phenols, Total	0.140	0.001	mg/L	16-Jul-09	APHA 5530D
----------------	-------	-------	------	-----------	------------

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 002

Client Project:

Sample Type: wastewater 1/3

Received Date: 09-Jul-09

Sampling Date: 08-Jul-09

Sampling Time: 16:00

Location: Eureka Sewage Lagoon

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	6180	0.4	µS/cm	10-Jul-09	SM2510:B	
pH	9.69		pH units	10-Jul-09	SM4500-H:B	
Solids, Total Suspended	220	3	mg/L	14-Jul-09	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	48	2	mg/L	10-Jul-09	SM5210:B	
Nitrate+Nitrite as Nitrogen	< 0.01	0.01	mg/L	14-Jul-09	SM4110:B	
Phosphorous, Total	2.93	0.01	mg/L	21-Jul-09	SM4500-P:D	
<u>Subcontracted Nutrients</u>						
Kjeldahl Nitrogen, Total	32.2	0.06	mg/L	14-Jul-09	ISO 11905-2	
<u>Microbiology</u>						
Coliforms, Fecal	< 100	100	CFU/100mL	09-Jul-09	SM9222:D	
Coliforms, Total	7990	100	MPN/100mL	09-Jul-09	SM9223:B	
<u>Organics</u>						
Hexane Extractable Material	7.7	2.0	mg/L	22-Jul-09	EPA1664A	

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 5 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 002

Trace Metals, Total

Aluminum	24	5	µg/L	21-Jul-09	EPA200.8
Antimony	0.8	0.1	µg/L	21-Jul-09	EPA200.8
Arsenic	0.8	0.2	µg/L	21-Jul-09	EPA200.8
Barium	28.2	0.1	µg/L	21-Jul-09	EPA200.8
Beryllium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cadmium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Cesium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Chromium	1.3	0.1	µg/L	21-Jul-09	EPA200.8
Cobalt	0.4	0.1	µg/L	21-Jul-09	EPA200.8
Copper	43.1	0.2	µg/L	21-Jul-09	EPA200.8
Iron	171	5	µg/L	21-Jul-09	EPA200.8
Lead	0.6	0.1	µg/L	21-Jul-09	EPA200.8
Lithium	29.8	0.2	µg/L	21-Jul-09	EPA200.8
Manganese	35.7	0.1	µg/L	21-Jul-09	EPA200.8
Molybdenum	0.5	0.1	µg/L	21-Jul-09	EPA200.8
Nickel	5.0	0.1	µg/L	21-Jul-09	EPA200.8
Rubidium	10.4	0.1	µg/L	21-Jul-09	EPA200.8
Selenium	1.6	0.5	µg/L	21-Jul-09	EPA200.8
Silver	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Strontium	853	0.1	µg/L	21-Jul-09	EPA200.8
Thallium	< 0.1	0.1	µg/L	21-Jul-09	EPA200.8
Titanium	0.3	0.1	µg/L	21-Jul-09	EPA200.8
Uranium	0.9	0.1	µg/L	21-Jul-09	EPA200.8

ReportDate: Thursday, July 23, 2009

Print Date: Thursday, July 23, 2009

Page 6 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
290375

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-09

Taiga Sample ID: 002

Vanadium	0.4	0.1	µg/L	21-Jul-09	EPA200.8
Zinc	49	5	µg/L	21-Jul-09	EPA200.8

Subcontracted Organics

Phenols, Total	0.011	0.001	mg/L	16-Jul-09	APHA 5530D
----------------	-------	-------	------	-----------	------------

Appendix G
Quality of Waste Water Discharged

EUREKA SEWAGE LAGOON: ANALYSIS RESULTS: 2008



Taiga Environmental Laboratory

4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3

Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- FINAL REPORT -


Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn:

Facsimile:

Final report has been reviewed and approved by:


Angelique Ruzindana
Quality Assurance Officer

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

ReportDate: Tuesday, July 22, 2008
Print Date: Tuesday, July 22, 2008

Page 1 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-08

Taiga Sample ID: 001

Client Project:

Sample Type: Wastewater

Received Date: 03-Jul-08

Sampling Date: 02-Jul-08

Sampling Time: 20:00

Location: Eureka Sewage Lagoon

Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifier
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	5370	0.4	µS/cm	04-Jul-08	SM2510:B	
pH	9.03		pH units	03-Jul-08	SM4500-H:B	
Solids, Total Suspended	143	3	mg/L	15-Jul-08	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	34	2	mg/L	04-Jul-08	SM5210:B	81
Nitrate+Nitrite as Nitrogen	1.10	0.01	mg/L	10-Jul-08	SM4110:B	
Phosphorous, Total	4.45	0.01	mg/L	15-Jul-08	SM4500-P:D	
<u>Subcontracted Nutrients</u>						
Kjeldahl Nitrogen, Total	30.6	0.06	mg/L	10-Jul-08	ISO 11905-2	
<u>Microbiology</u>						
Coliforms, Fecal	9200	100	CFU/100mL	03-Jul-08	SM9222:D	
Coliforms, Total	19200	100	MPN/100mL	03-Jul-08	SM9223:B	
<u>Organics</u>						
Hexane Extractable Material	7.0	2.0	mg/L	21-Jul-08	EPA1664A	

ReportDate: Tuesday, July 22, 2008

Print Date: Tuesday, July 22, 2008

Page 2 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-08

Taiga Sample ID: 001

Trace Metals, Total

Aluminum	284	5	µg/L	15-Jul-08	EPA200.8
Antimony	1.9	0.1	µg/L	15-Jul-08	EPA200.8
Arsenic	0.9	0.2	µg/L	15-Jul-08	EPA200.8
Barium	23.9	0.1	µg/L	15-Jul-08	EPA200.8
Beryllium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Cadmium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Cesium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Chromium	1.2	0.1	µg/L	15-Jul-08	EPA200.8
Cobalt	0.9	0.1	µg/L	15-Jul-08	EPA200.8
Copper	30.0	0.2	µg/L	15-Jul-08	EPA200.8
Iron	539	5	µg/L	15-Jul-08	EPA200.8
Lead	1.5	0.1	µg/L	15-Jul-08	EPA200.8
Lithium	27.3	0.2	µg/L	15-Jul-08	EPA200.8
Manganese	54.5	0.1	µg/L	15-Jul-08	EPA200.8
Molybdenum	0.7	0.1	µg/L	15-Jul-08	EPA200.8
Nickel	5.4	0.1	µg/L	15-Jul-08	EPA200.8
Rubidium	13.5	0.1	µg/L	15-Jul-08	EPA200.8
Selenium	0.8	0.5	µg/L	15-Jul-08	EPA200.8
Silver	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Strontium	612	0.1	µg/L	15-Jul-08	EPA200.8
Thallium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Titanium	13.2	0.1	µg/L	15-Jul-08	EPA200.8
Uranium	0.8	0.1	µg/L	15-Jul-08	EPA200.8

ReportDate: Tuesday, July 22, 2008
Print Date: Tuesday, July 22, 2008

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #1-08

Taiga Sample ID: 001

Vanadium	0.8	0.1	µg/L	15-Jul-08	EPA200.8
Zinc	51	5	µg/L	15-Jul-08	EPA200.8

Subcontracted Organics

Phenols, Total	0.023	0.001	mg/L	11-Jul-08	APHA 5530D
----------------	-------	-------	------	-----------	------------

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-08

Taiga Sample ID: 002

Client Project:
Sample Type: Wastewater
Received Date: 03-Jul-08
Sampling Date: 03-Jul-08
Sampling Time: 6:00
Location: Eureka Sewage Lagoon
Report Status: Final

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	Qualifer
<u>Inorganics - Physicals</u>						
Conductivity, Specific (@ 25°C)	5440	0.4	µS/cm	04-Jul-08	SM2510:B	
pH	8.95		pH units	03-Jul-08	SM4500-H:B	
Solids, Total Suspended	128	3	mg/L	15-Jul-08	SM2540:D	
<u>Inorganics - Nutrients</u>						
Biochemical Oxygen Demand	33	2	mg/L	04-Jul-08	SM5210:B	81
Nitrate+Nitrite as Nitrogen	1.80	0.01	mg/L	10-Jul-08	SM4110:B	
Phosphorous, Total	4.51	0.01	mg/L	15-Jul-08	SM4500-P:D	
<u>Subcontracted Nutrients</u>						
Kjeldahl Nitrogen, Total	33.7	0.06	mg/L	10-Jul-08	ISO 11905-2	
<u>Microbiology</u>						
Coliforms, Fecal	10200	100	CFU/100mL	03-Jul-08	SM9222:D	
Coliforms, Total	30800	100	MPN/100mL	03-Jul-08	SM9223:B	
<u>Organics</u>						
Hexane Extractable Material	2.8	2.0	mg/L	21-Jul-08	EPA1664A	

ReportDate: Tuesday, July 22, 2008
Print Date: Tuesday, July 22, 2008

Page 5 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-08

Taiga Sample ID: 002

Trace Metals, Total

Aluminum	274	5	µg/L	15-Jul-08	EPA200.8
Antimony	2.1	0.1	µg/L	15-Jul-08	EPA200.8
Arsenic	1.0	0.2	µg/L	15-Jul-08	EPA200.8
Barium	23.3	0.1	µg/L	15-Jul-08	EPA200.8
Beryllium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Cadmium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Cesium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Chromium	1.1	0.1	µg/L	15-Jul-08	EPA200.8
Cobalt	1.0	0.1	µg/L	15-Jul-08	EPA200.8
Copper	30.0	0.2	µg/L	15-Jul-08	EPA200.8
Iron	543	5	µg/L	15-Jul-08	EPA200.8
Lead	1.3	0.1	µg/L	15-Jul-08	EPA200.8
Lithium	27.4	0.2	µg/L	15-Jul-08	EPA200.8
Manganese	64.8	0.1	µg/L	15-Jul-08	EPA200.8
Molybdenum	0.6	0.1	µg/L	15-Jul-08	EPA200.8
Nickel	6.1	0.1	µg/L	15-Jul-08	EPA200.8
Rubidium	13.6	0.1	µg/L	15-Jul-08	EPA200.8
Selenium	0.8	0.5	µg/L	15-Jul-08	EPA200.8
Silver	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Strontium	606	0.1	µg/L	15-Jul-08	EPA200.8
Thallium	< 0.1	0.1	µg/L	15-Jul-08	EPA200.8
Titanium	13.4	0.1	µg/L	15-Jul-08	EPA200.8
Uranium	0.8	0.1	µg/L	15-Jul-08	EPA200.8

ReportDate: Tuesday, July 22, 2008
Print Date: Tuesday, July 22, 2008

Page 6 of 8

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-08

Taiga Sample ID: 002

Vanadium	0.8	0.1	µg/L	15-Jul-08	EPA200.8
Zinc	51	5	µg/L	15-Jul-08	EPA200.8

Subcontracted Organics

Phenols, Total	0.044	0.001	mg/L	11-Jul-08	APHA 5530D
----------------	-------	-------	------	-----------	------------

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
280324

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW #2-08

Taiga Sample ID: 002

- DATA QUALIFIERS -

Data Qualifier Descriptions:

81 *Results are inconclusive due to insufficient depletion of sample, minimum 2 mg/L required over 5 days.*

* Taiga analytical methods are based on the following standard analytical methods

SM - Standard Methods for the Examination of Water and Wastewater

EPA - United States Environmental Protection Agency

ReportDate: Tuesday, July 22, 2008

Print Date: Tuesday, July 22, 2008

Page 8 of 8

Appendix G
Quality of Waste Water Discharged

EUREKA SEWAGE LAGOON: ANALYSIS RESULTS: 2007

APPENDIX C : EUREKA WASTE WATER
RESULTS 2007

17



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270391

- FINAL REPORT -


Prepared For: Environment Canada
Eureka Weather Station

Address: 123 Main Street
Suite 150
Winnipeg, MB
R3C 4W2

Attn: Harvey Pukin

Facsimile:

Final report has been reviewed and approved by:


Angelique Ruzindana
Quality Assurance Officer

NOTES:

- Test methods and data are validated by the laboratory's Quality Assurance Program. Taiga Environmental Laboratory is accredited by the Canadian Association of Environmental Analytical Laboratories (CAEAL) as a testing laboratory for specific tests registered with CAEAL.
- Routine methods are based on recognized procedures from sources such as
 - Standard Methods for the Examination of Water and Wastewater APHA AWWA WEF;
 - Environment Canada
 - USEPA
- Samples shall be kept for thirty (30) days after the final report is issued. All microbiological samples shall be disposed of immediately upon completion of analysis to minimize biohazardous risks to laboratory personnel. Please contact the laboratory if you have any special requirements.
- Final results are based on the specific tests at the time of analysis and do not represent the conditions during sampling.

Report Date: Friday, July 20, 2007
Print Date: Friday, July 20, 2007

Page 1 of 6

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270391

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW#1

Taiga Sample ID: 001

Client Project:

Sample Type: Wastewater

Received Date: 05-Jul-07

Sampling Date: 04-Jul-07

Sampling Time:

Location: Eureka Sewage Lagoon

Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifier
<u>Inorganics - Physicals</u>							
Solids, Total Suspended	71	3	mg/L	10-Jul-07	SM2540:D	106005	
<u>Inorganics - Nutrients</u>							
Biological Oxygen Demand	35	2	mg/L	05-Jul-07	SM5210:B		
Nitrate+Nitrite as Nitrogen	< 0.01	0.01	mg/L	18-Jul-07	SM4110:B	106000	
Phosphorous, Total	0.24	0.01	mg/L	13-Jul-07	SM4500-P:D	106007	
<u>Subcontracted Nutrients</u>							
Kjeldahl Nitrogen, Total	43.7	0.06	mg/L	19-Jul-07	ISO 11905-2		
<u>Major Ions</u>							
Magnesium	81.2	0.1	mg/L	19-Jul-07	SM4110:B	106011	
Sodium	967	0.1	mg/L	19-Jul-07	SM4110:B	106012	
<u>Microbiology</u>							
Coliforms, Fecal	< 10000	10000	CFU/100mL	05-Jul-07	SM9222:D	036014	68
Coliforms, Total	379000	10000	MPN/100mL	05-Jul-07	SM9223:B	103454	

Report Date: Friday, July 20, 2007

Print Date: Friday, July 20, 2007

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270391

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW#1

Taiga Sample ID: 001

Subcontracted Organics

Phenols, Total	0.040	0.001	mg/L	12-Jul-07	APHA 5530D
----------------	-------	-------	------	-----------	------------

ReportDate: Friday, July 20, 2007
Print Date: Friday, July 20, 2007

Page 3 of 6

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270391

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW#2

Taiga Sample ID: 002

Client Project:
Sample Type: Wastewater
Received Date: 05-Jul-07
Sampling Date: 04-Jul-07
Sampling Time:
Location: Eureka Sewage Lagoon
Report Status: FINAL

Test Parameter	Result	Detection Limit	Units	Analysis Date	Analytical Method *	VMV Code	Qualifier
<u>Inorganics - Physicals</u>							
Solids, Total Suspended	89	3	mg/L	10-Jul-07	SM2540:D	106005	
<u>Inorganics - Nutrients</u>							
Biological Oxygen Demand	37	2	mg/L	05-Jul-07	SM5210:B		
Nitrate+Nitrite as Nitrogen	1.11	0.01	mg/L	18-Jul-07	SM4110:B	106000	
Phosphorous, Total	4.13	0.01	mg/L	13-Jul-07	SM4500-P:D	106007	
<u>Subcontracted Nutrients</u>							
Kjeldahl Nitrogen, Total	42.7	0.06	mg/L	19-Jul-07	ISO 11905-2		
<u>Major Ions</u>							
Magnesium	78.4	0.1	mg/L	19-Jul-07	SM4110:B	106011	
Sodium	850	0.1	mg/L	19-Jul-07	SM4110:B	106012	
<u>Microbiology</u>							
Coliforms, Fecal	80000	10000	CFU/100mL	05-Jul-07	SM9222:D	036014	
Coliforms, Total	650000	10000	MPN/100mL	05-Jul-07	SM9223:B	103454	
<u>Subcontracted Organics</u>							

Report Date: Friday, July 20, 2007
Print Date: Friday, July 20, 2007

Appendix G

Quality of Waste Water Discharged



Taiga Environmental Laboratory
4601-52nd Ave., Box 1500, Yellowknife, NT. X1A 2R3
Tel: (867)-669-2788 Fax: (867)-669-2718

Taiga Batch No.:
270391

- CERTIFICATE OF ANALYSIS -

Client Sample ID: EUWW#2

Taiga Sample ID: 002

Phenols, Total	0.055	0.001	mg/L	12-Jul-07	APHA 5530D
----------------	-------	-------	------	-----------	------------

Appendix H

GPS Coordinates

GPS Coordinates for water sources utilized

Source Description	Latitude			Longitude		
	° Deg	' Min	" Sec	° Deg	' Min	" Sec
Station Creek	79	59	21	85	57	4
Water Lagoon	79	59	20	85	56	46

GPS Locations of areas of waste disposal

Location Description (type)	Latitude			Longitude		
	° Deg	' Min	" Sec	° Deg	' Min	" Sec
Sewage Lagoon	79	59	23	85	50	11
East Landfill	79	59	29	85	46	20
Asbestos Landfill	79	59	17	85	46	50
Crushed Barrel Landfill	79	59	38	85	49	38
Ash Landfill	79	59	32	85	47	52
Contaminated Soil Pit	79	59	40	85	49	34
Land Farm	79	59	40	85	50	11
DND Sewage Lagoon	79	59	23	85	50	11